



**University
of Victoria**

Facilities
Management

Exterior Wayfinding Signage

Specifications and Details



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign design - graphic design details - cont
06	sign construction - sections
07	sign construction - details
08	general notes


Sign No. 1

Vehicular - Main Gateway


core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
crest - reversed monochromatic




garry oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

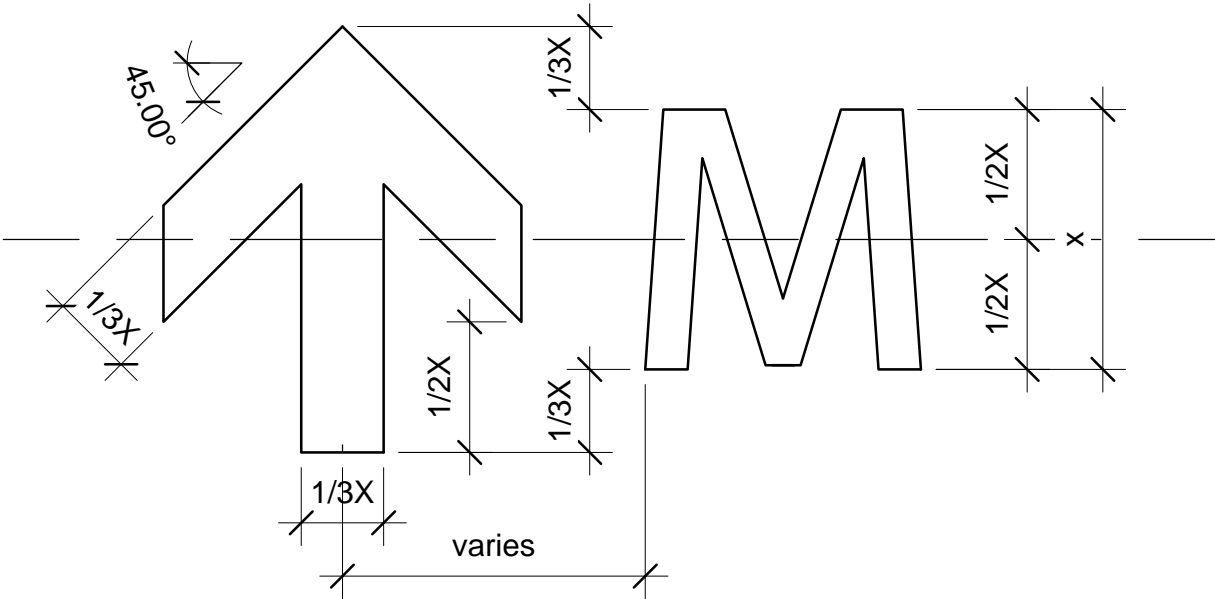


University of Victoria Logo, horizontal standard



University
of Victoria

full colour



University
of Victoria

opaque monochromatic



University
of Victoria

opaque monochromatic reversed







side



front

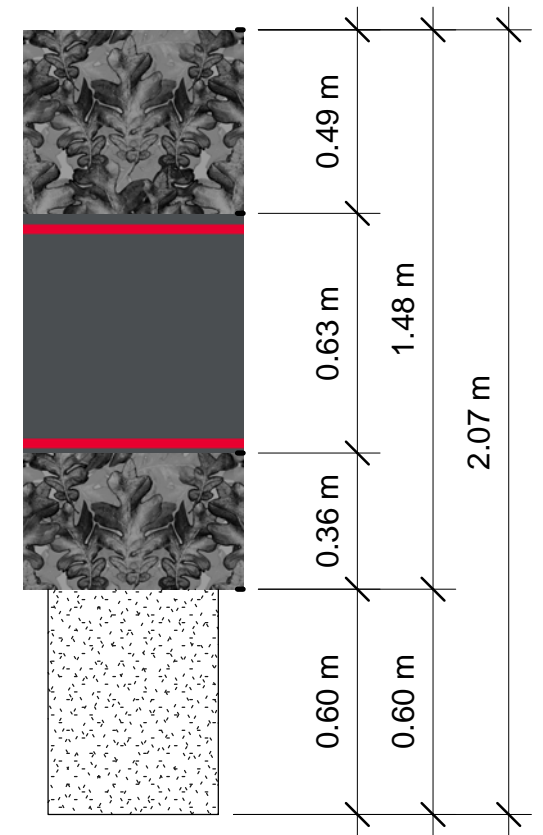

side

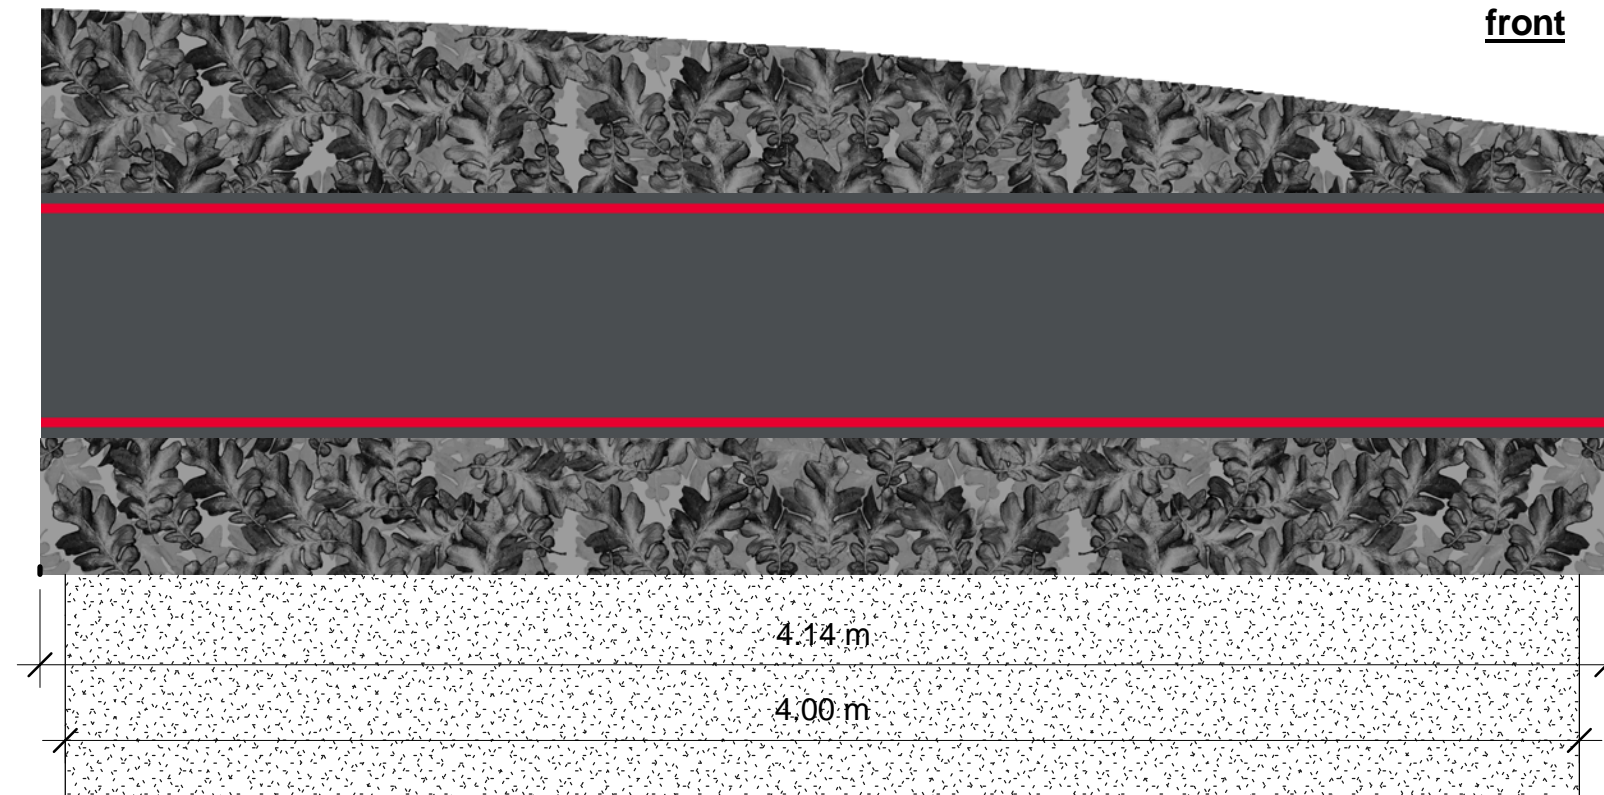

back

gateway sign scale 1:20

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 1 - Main Gateway
sheet name: sign design - overview
scale: as noted

sheet
number:

03



Back panel (not shown here) to be one piece, digitally printed vinyl protected with anti-graffiti, optically clear overlamine. Aluminum panel thickness to be 3.2mm

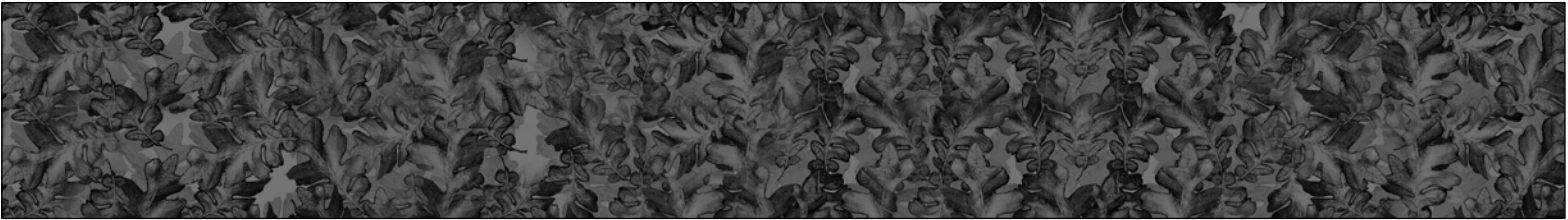

(top) Digitally printed vinyl protected with anti-graffiti, optically clear overlamine.
Aluminum panel size: 4130mm x 485mm x 6.4mm



(front - top) Digitally printed vinyl protected with anti-graffiti, optically clear overlamine.
Aluminum panel size: 4130mm x 485mm x 6.4mm



(front - main) Digitally printed vinyl protected with anti-graffiti, optically clear overlamine, with push-thru acrylic pictograms.
Aluminum panel size: 4130mm x 650mm x 6.4mm




(front - bottom) Digitally printed vinyl protected with anti-graffiti, optically clear overlamine.
Aluminum panel size: 4130mm x 360mm x 6.4mm

Clear acrylic (pictograms):
Plaskolite OPTIX, Chemcast GP or equivalent

First surface prints:
Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.

2nd surface prints:
CAV-50 reverse print - i/w/i (2nd surface)
Overlamine: 3M 8914, Avery DOL 6060 or equivalent (first surface)

- 1) Vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Where applicable wrap vinyl and overlamine over the edges of the alu. panel.
- 4) All panels to be mechanically fastened to substrate.
- 5) Manufacturer to confirm all dimensions prior to fabrication.
- 6) Manufacturer to ensure watertightness of panel connections.

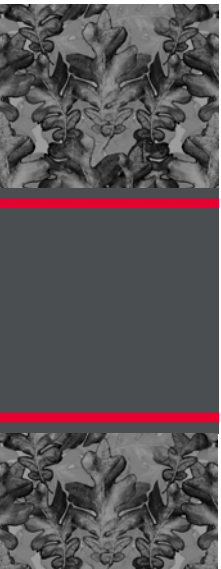

Digitally printed vinyl protected with anti-graffiti, optically clear overlamine.
Aluminum panel size:
580 mm x 1495 mm x 3.2 mm

scale 1:20

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 1 - Main Gateway
sheet name: sign design - graphic design details
scale: as noted

sheet
number:


04



**University
of Victoria**

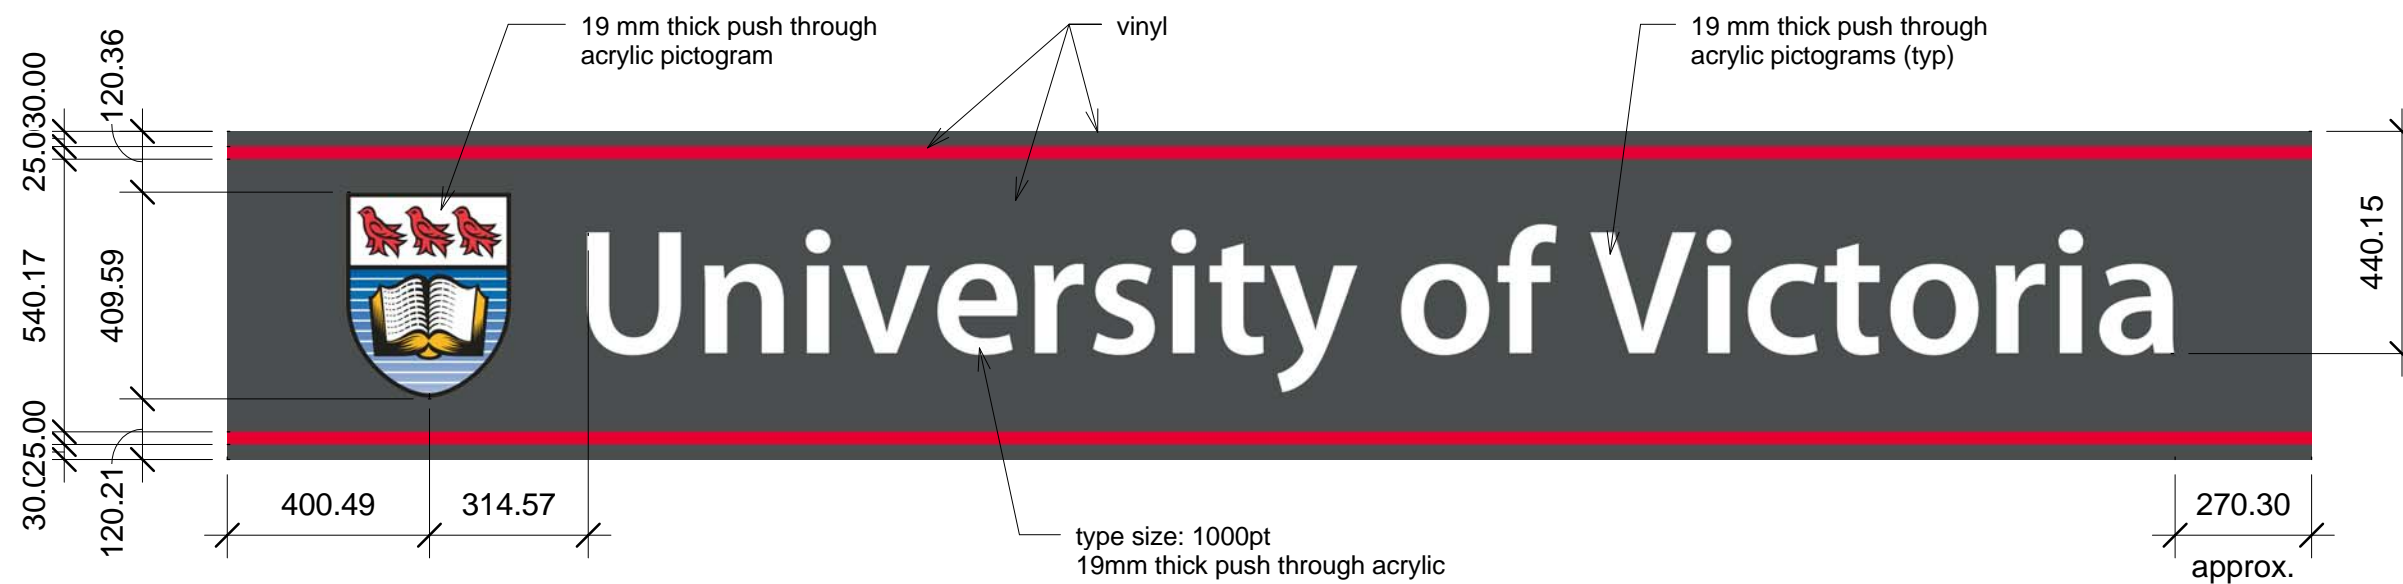


front panel with push through pictograms
scale 1:15

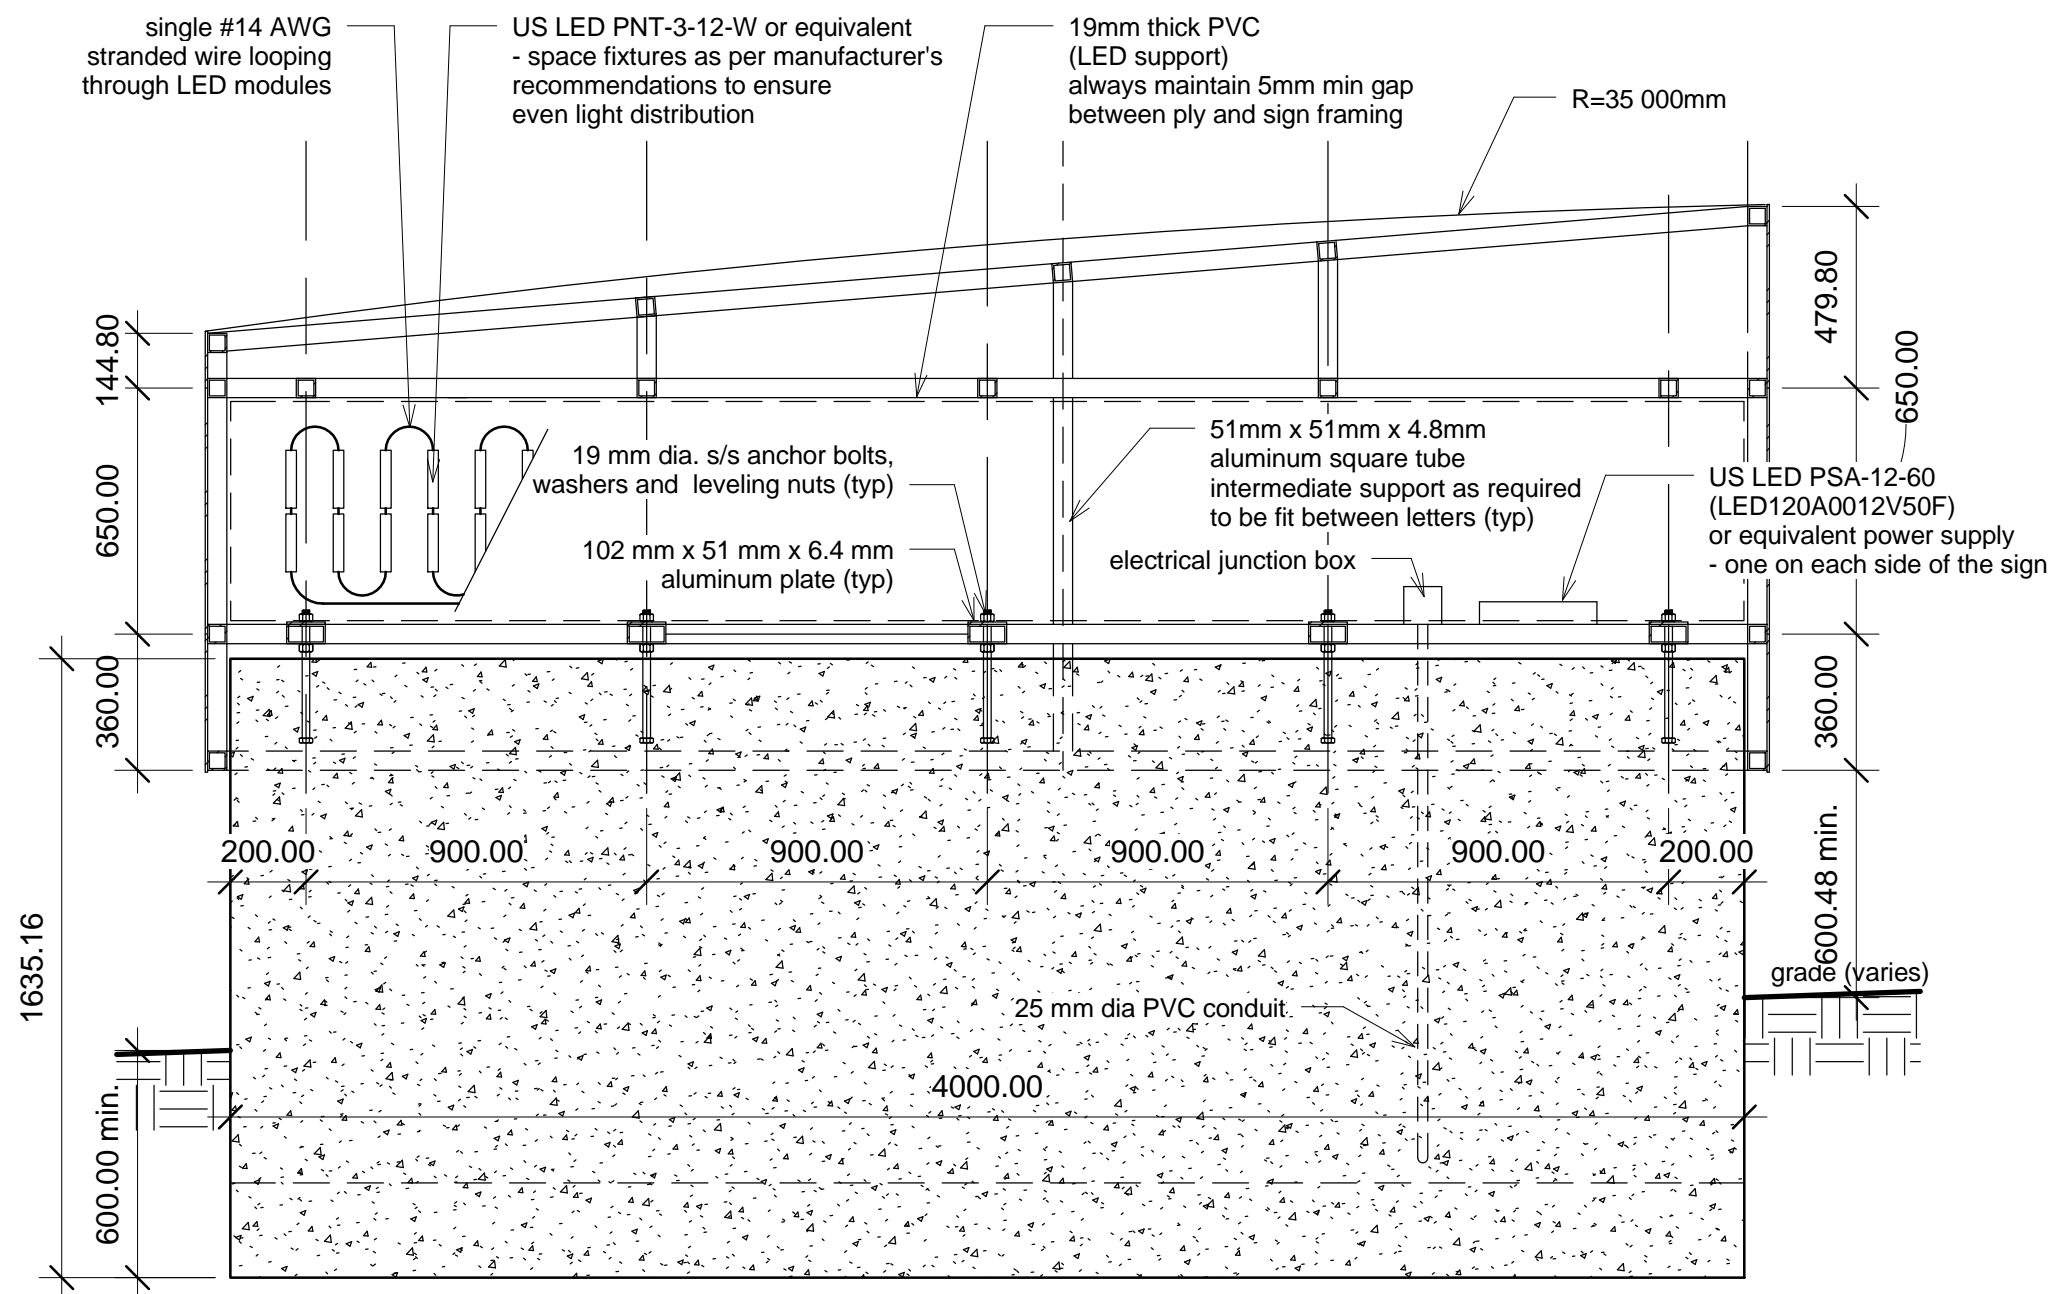

General Notes:

- 1) provide ventilation holes as required
- 2) US LED PSA-12-60 power supply to provide ource of power to a max. of 50 MegaBright 12 LED Modules
- 3) Sign must have a CSA label as an assembly
4. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

long section scale 1:20

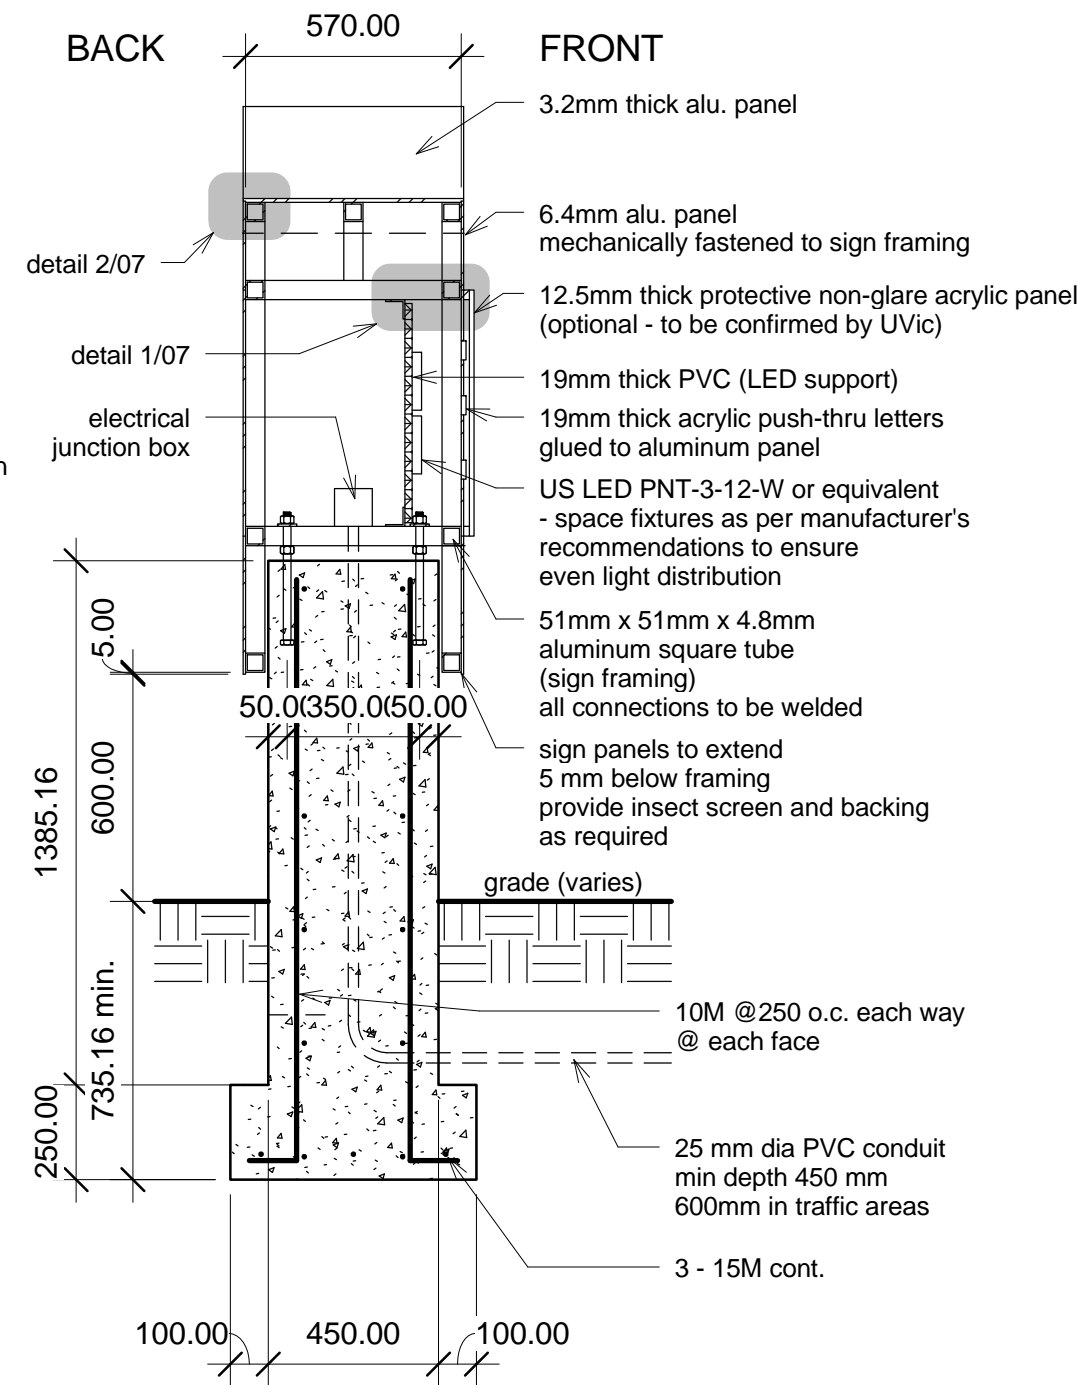

cross section scale 1:20

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 1 - Main Gateway
sheet name: sign construction - sections
scale: as noted

sheet
number:

06




**University
of Victoria**

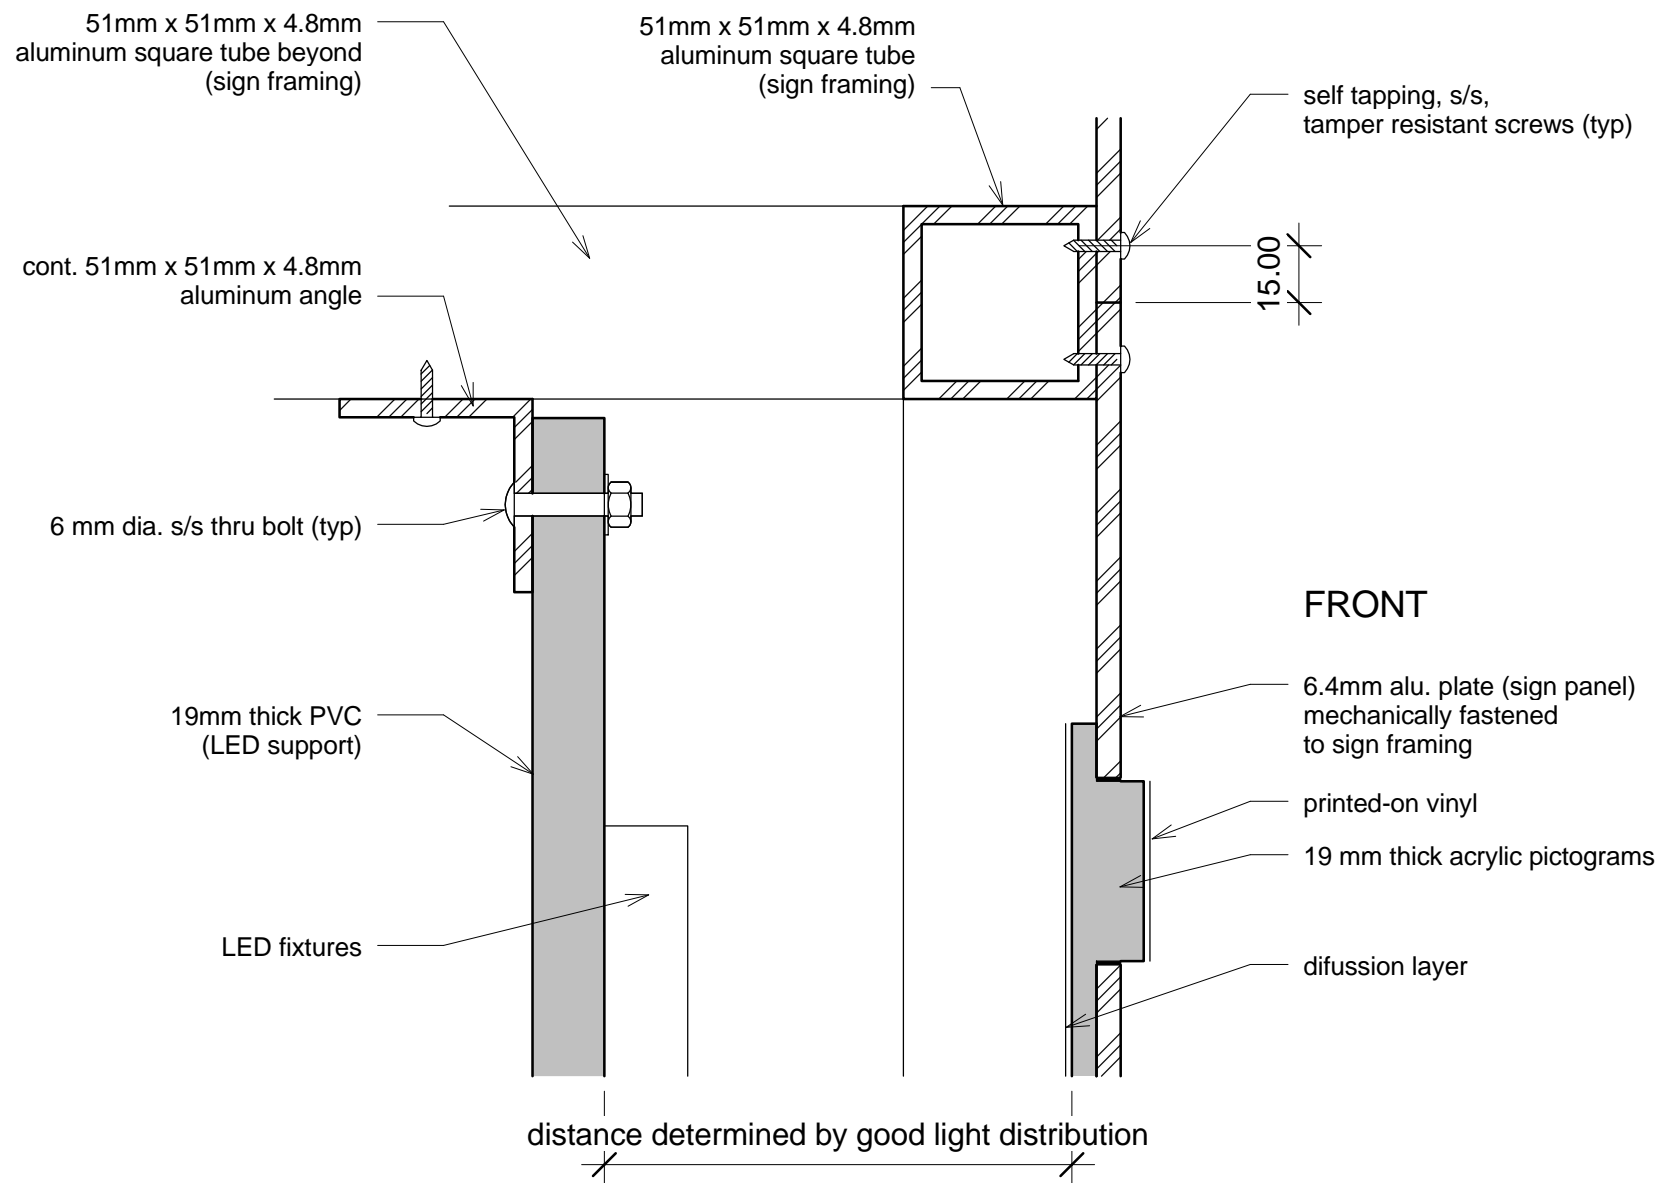

detail 1 scale 1:2

General Notes:

- 1) provide ventilation holes as required
- 2) US LED PSA-12-60 power supply to provide ource of power to a max. of 50 MegaBright 12 LED Modules
- 3) Sign must have a CSA label as an assembly
4. Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

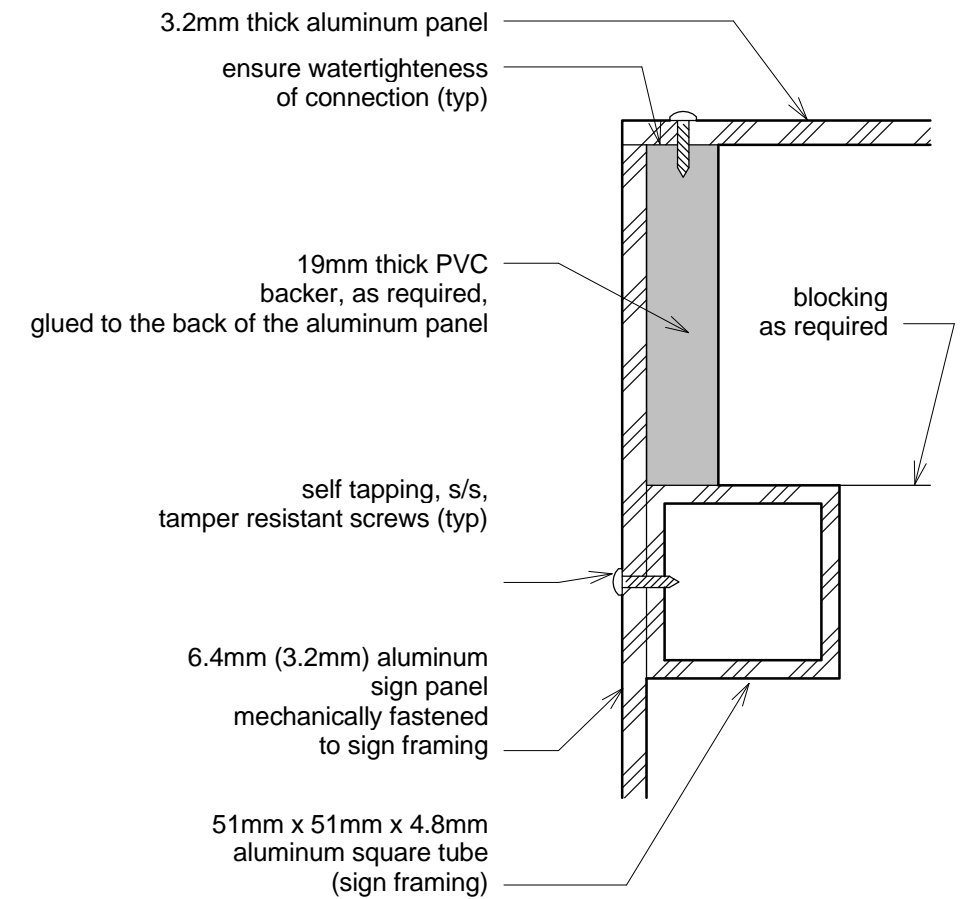

detail No. 2 scale 1:2

project: Campus Wayfinding
 number: FM 09-8567
 issue date: Jan 31, 2012

sign: Sign No. 1 - Main Gateway
 sheet name: sign construction - details
 scale: as noted

sheet
 number:

07



**University
 of Victoria**

GENERAL NOTES

- 1. Provide sign ID stickers as per proposed location plan.
Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL NOTES (cont)

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.


TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant "Torx-Pin" screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be "Pentagon" tamper resistant bolts, with "Pentagon" nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with "Pentagon" security nuts.

ELECTRICAL NOTES

- 1. Signs must be provided with CSA label
- 2. LED modules, power supplies, cable, wire and junction box must be integral with signs
- 3. All electrical installations to be done in accordance with the Canadian Electrical Code and as recommended by the LED lighting manufacturer.
- 4. Run 2#8 +GND conductors in 27mm PVC conduit from sign to existing campus exterior lighting pole standard. Intercept existing underground conduit, install an H20 rated flush junction box with bolt-on cover and splice into exterior lighting circuit.
- 4. The sign manufacturer shall provide an electrical shop drawings indicating input power requirements and a schematic wiring diagram for the sign.



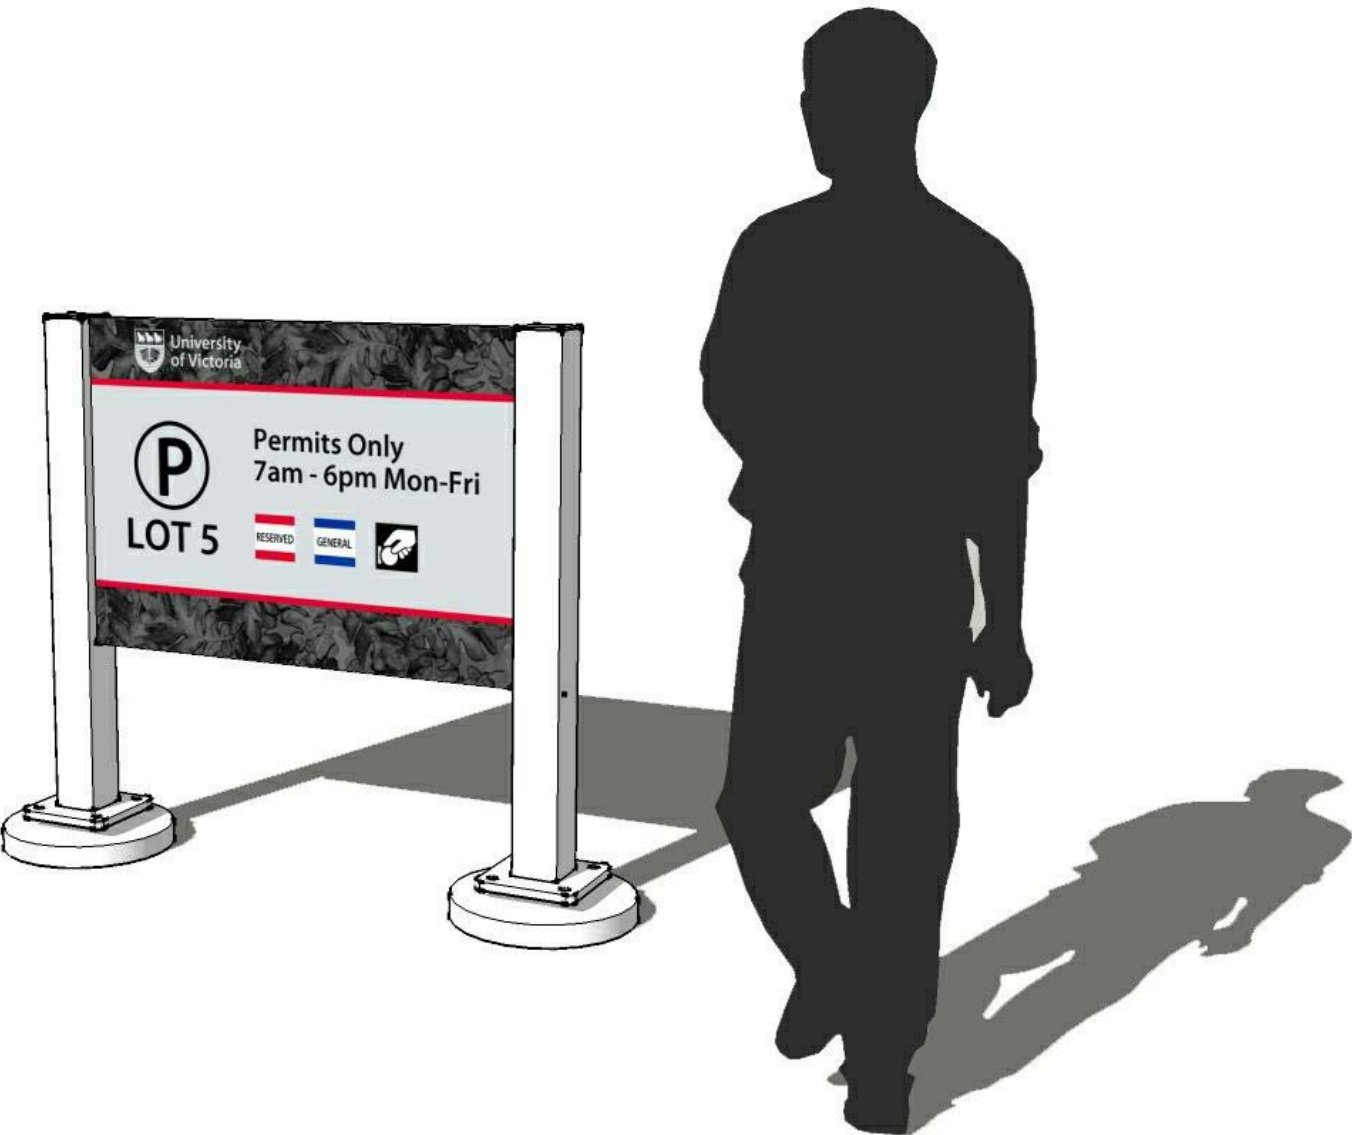

Sign No. 2A

Vehicular - Parking Lot

Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 2A - Parking Lot
sheet name: title sheet and drawing list
scale: as noted

sheet number: 01

core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTEONE 7541 C
application: background,
back panel (single sided sign)
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

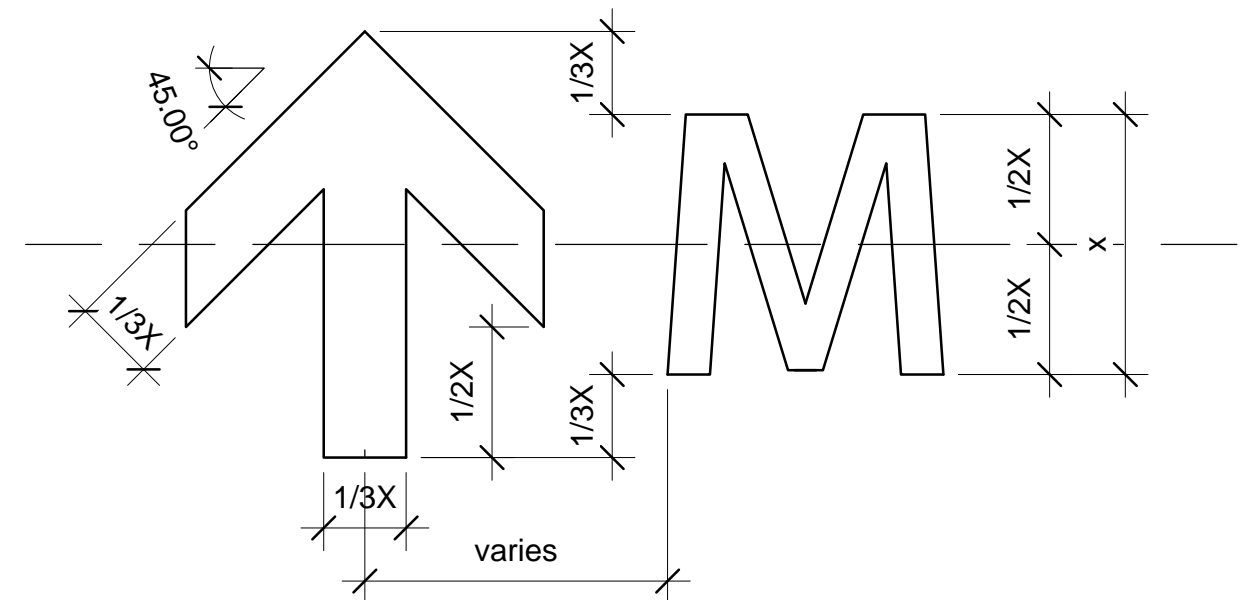

University of Victoria Logo, horizontal standard



University of Victoria



University of Victoria



full colour

opaque monochromatic

opaque monochromatic reversed

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 2A - Parking Lot
sheet name: typography, colours and pictograms
scale: as noted

sheet
number:


02



**University
of Victoria**

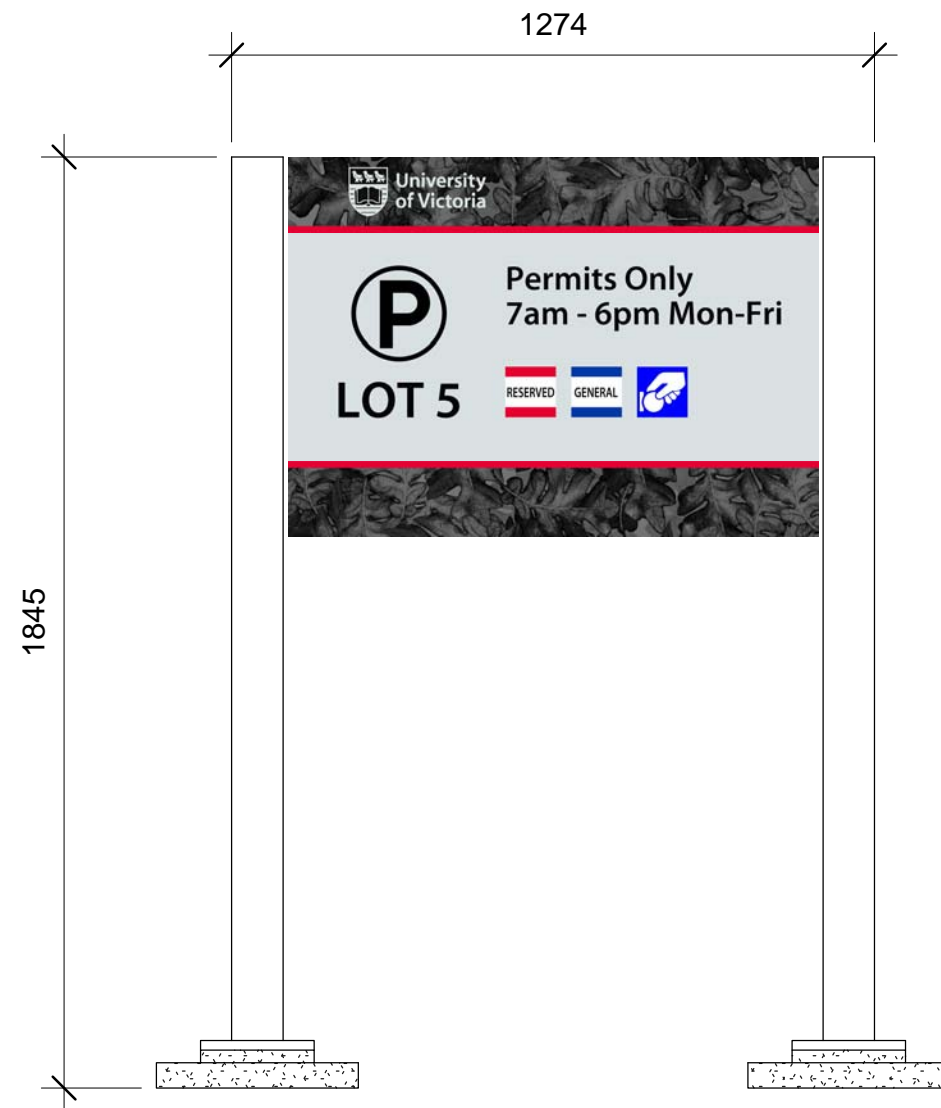


Parking Lot A - version 1
scale 1:15

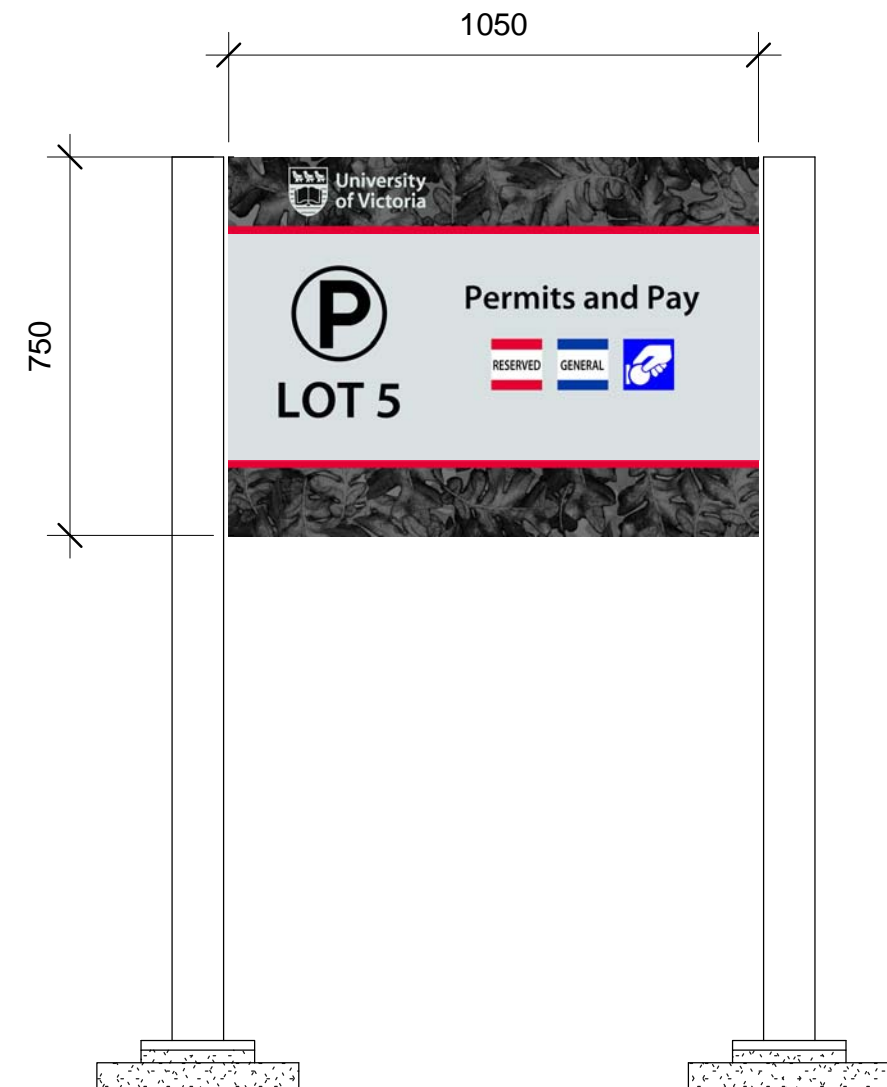

Parking Lot A - version 2
scale 1:15



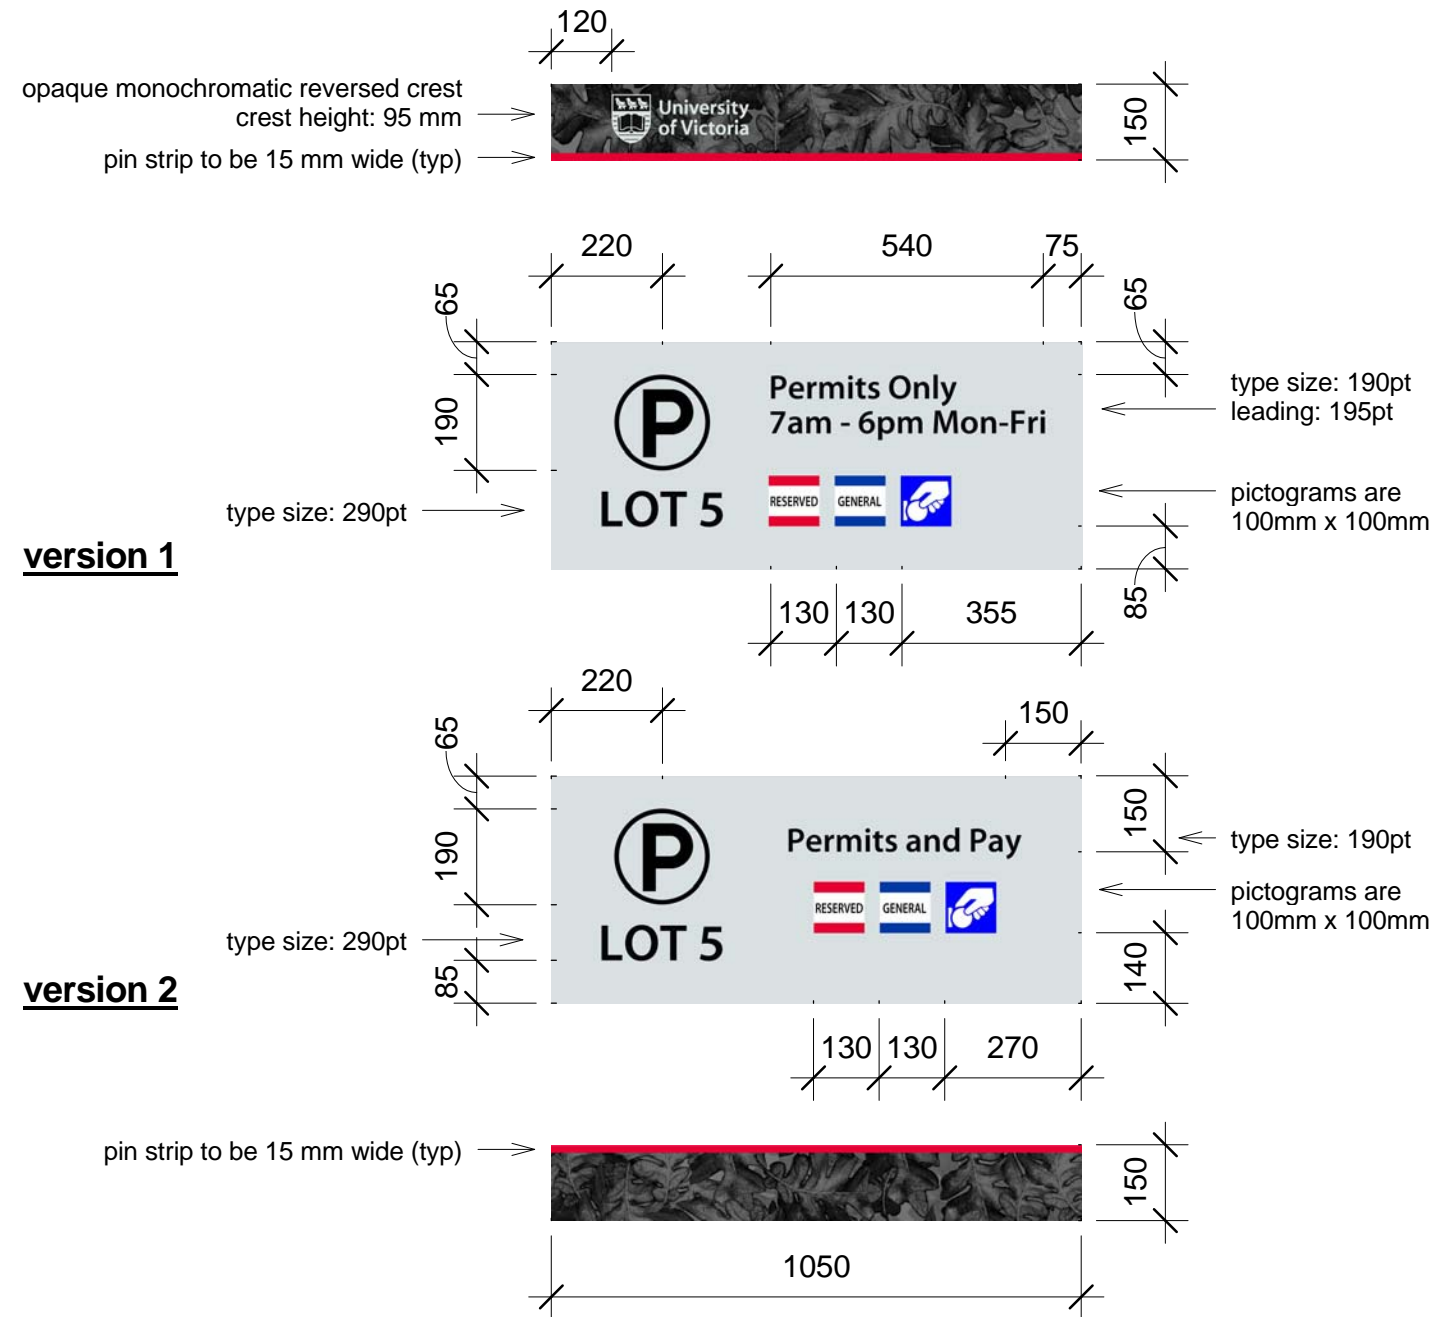


scale 1:15

Description
Digitally printed vinyl protected with anti-graffiti, optically clear overlamine
Aluminum panel size (one piece): 1050 mm x 750 mm x 6.4 mm
See sheet 05 for details.




Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and overlamine over the edges of the aluminum panel.
- 4) If single sided sign then back panel to receive vinyl printed with PANTEONE 7541 C

Refer to Adobe Photoshop files for detailed sample layout

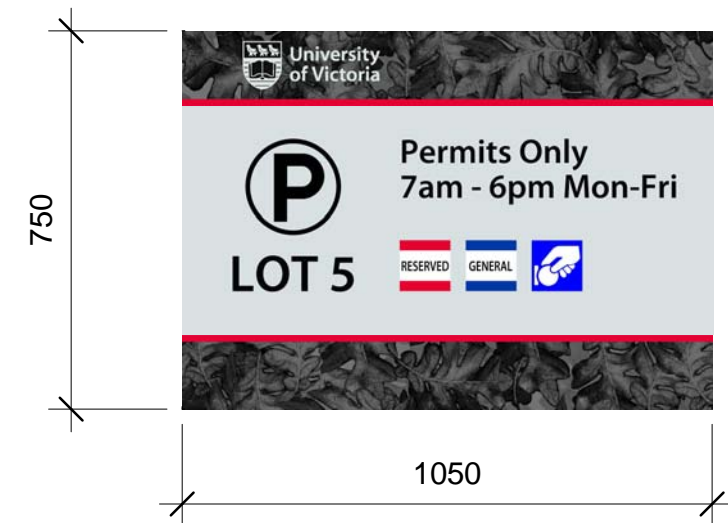

scale 1:15

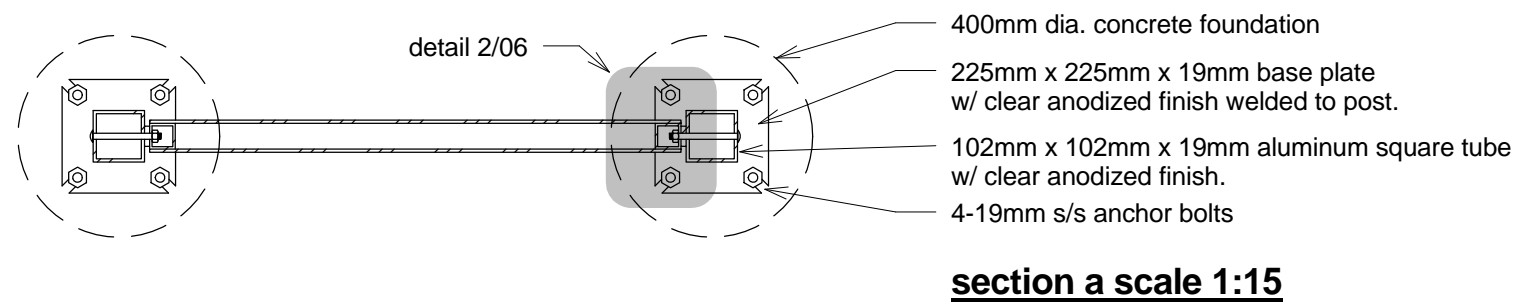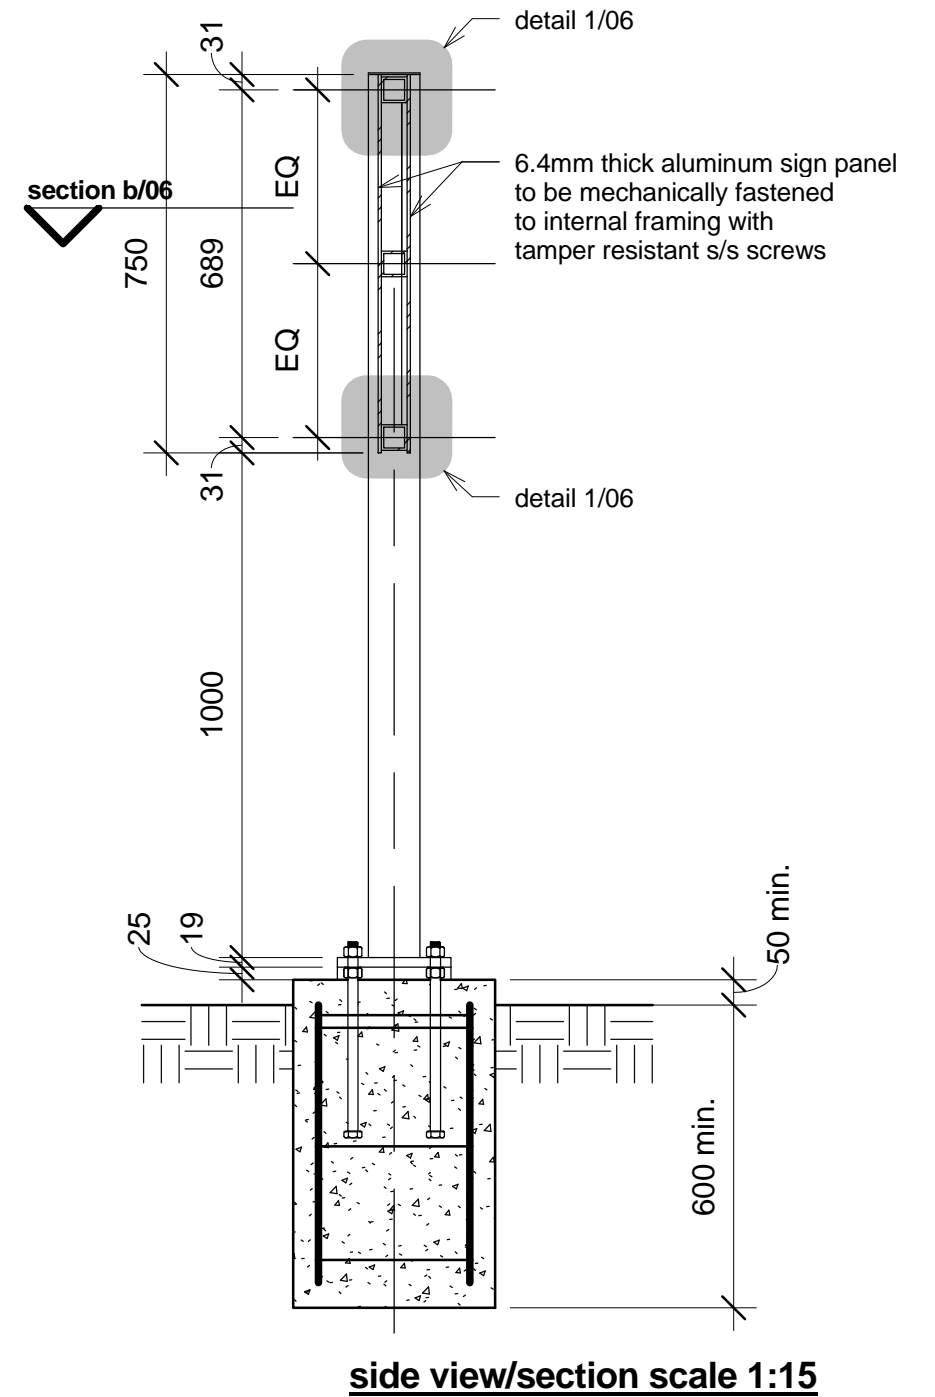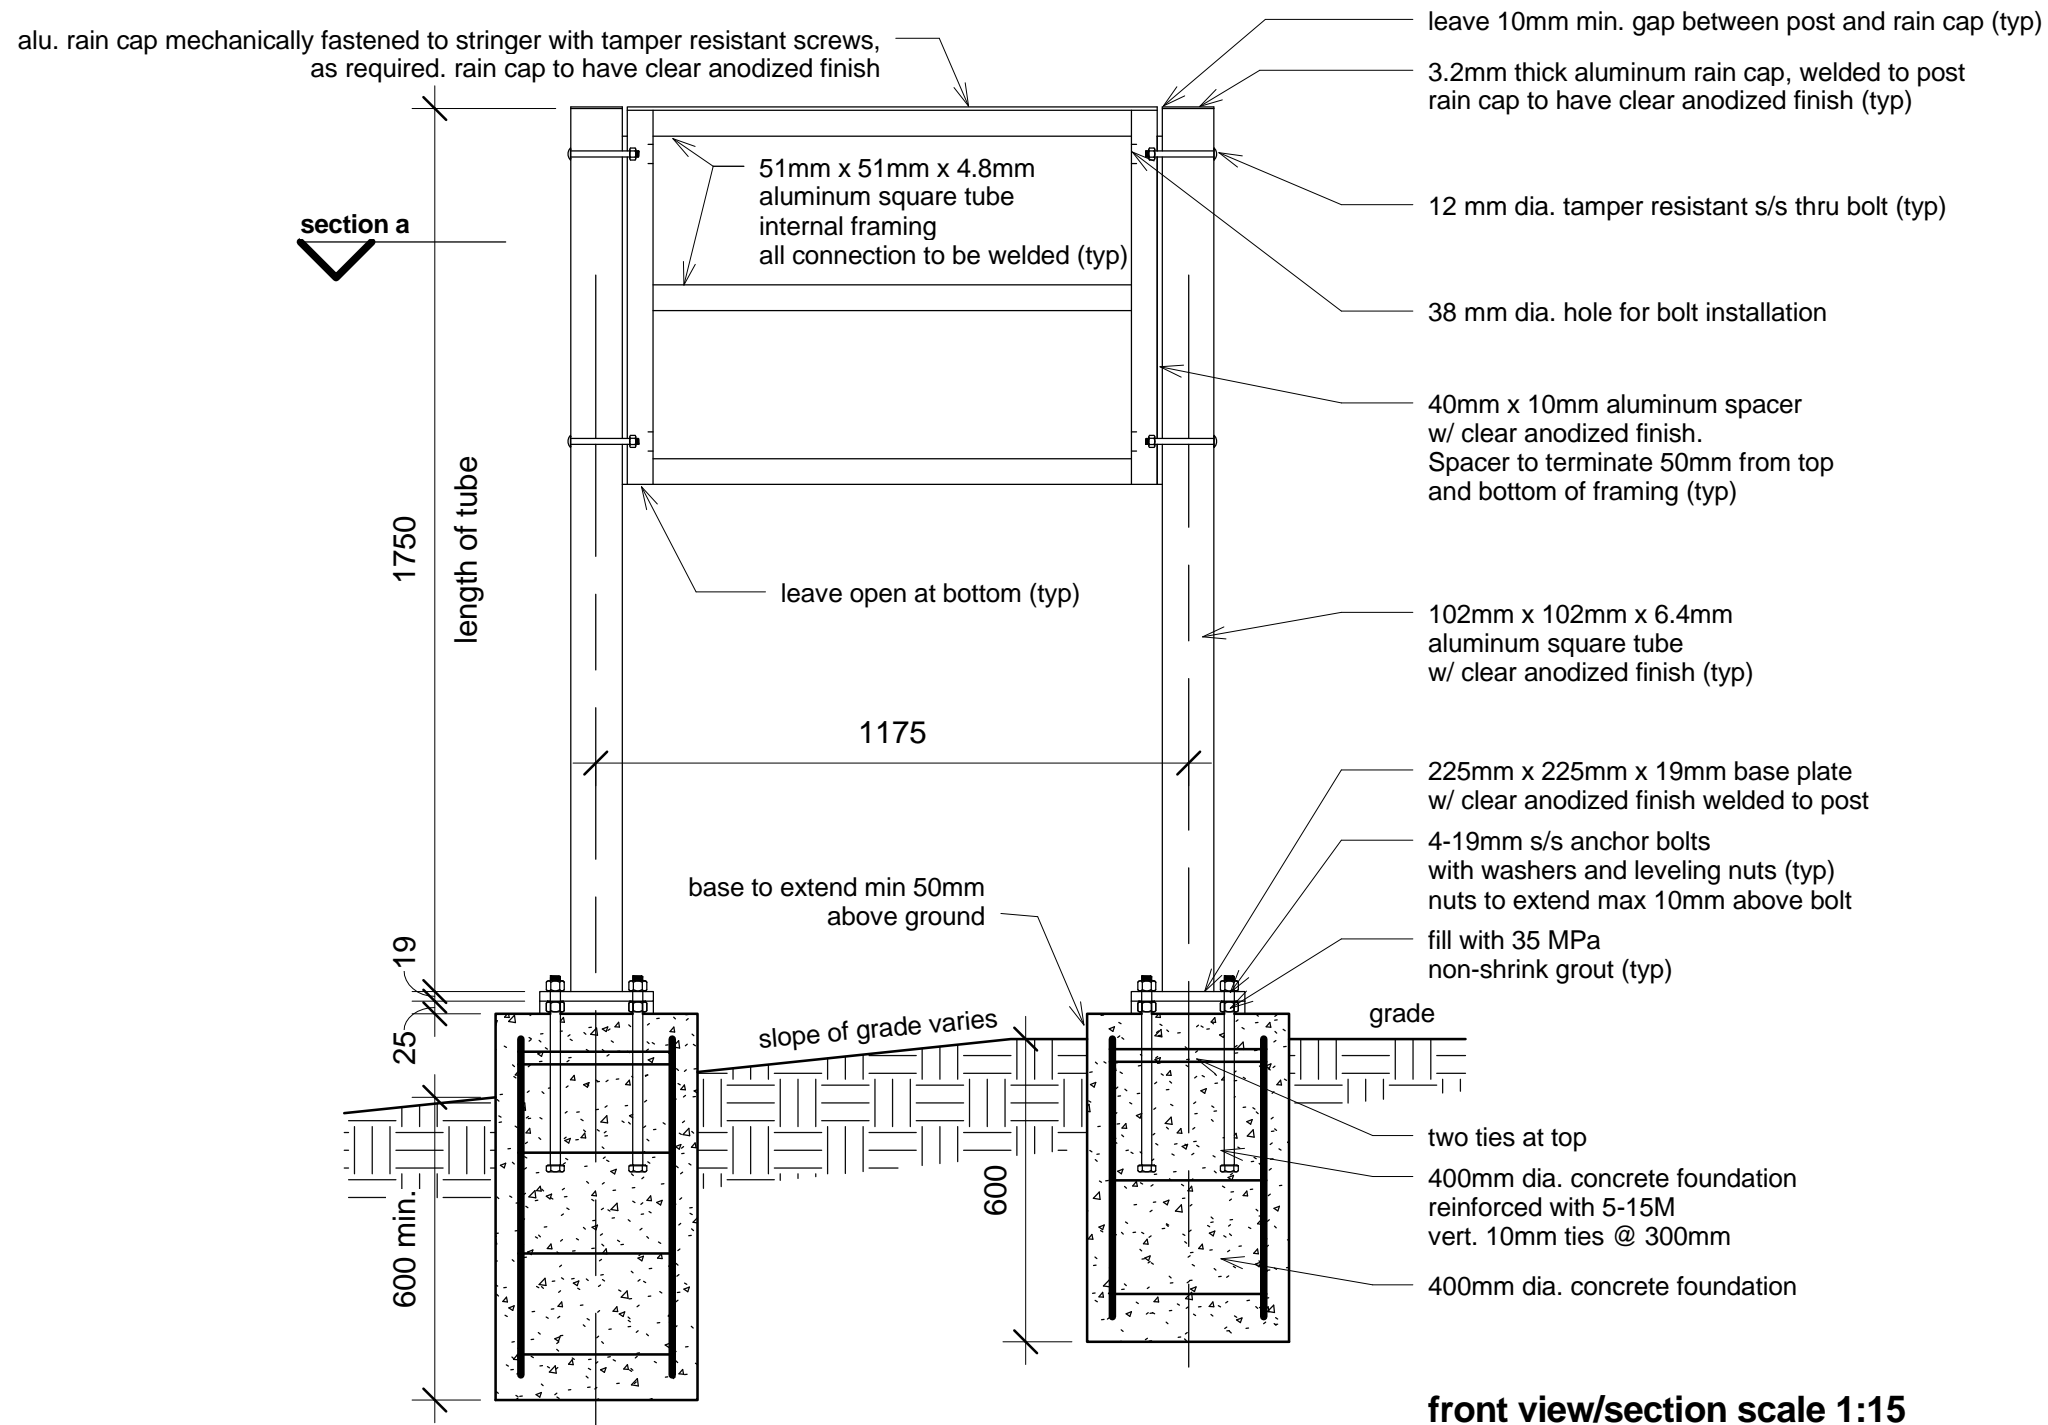

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 2A - Parking Lot
sheet name: sign construction - sections
scale: as noted

sheet number:

05




University of Victoria

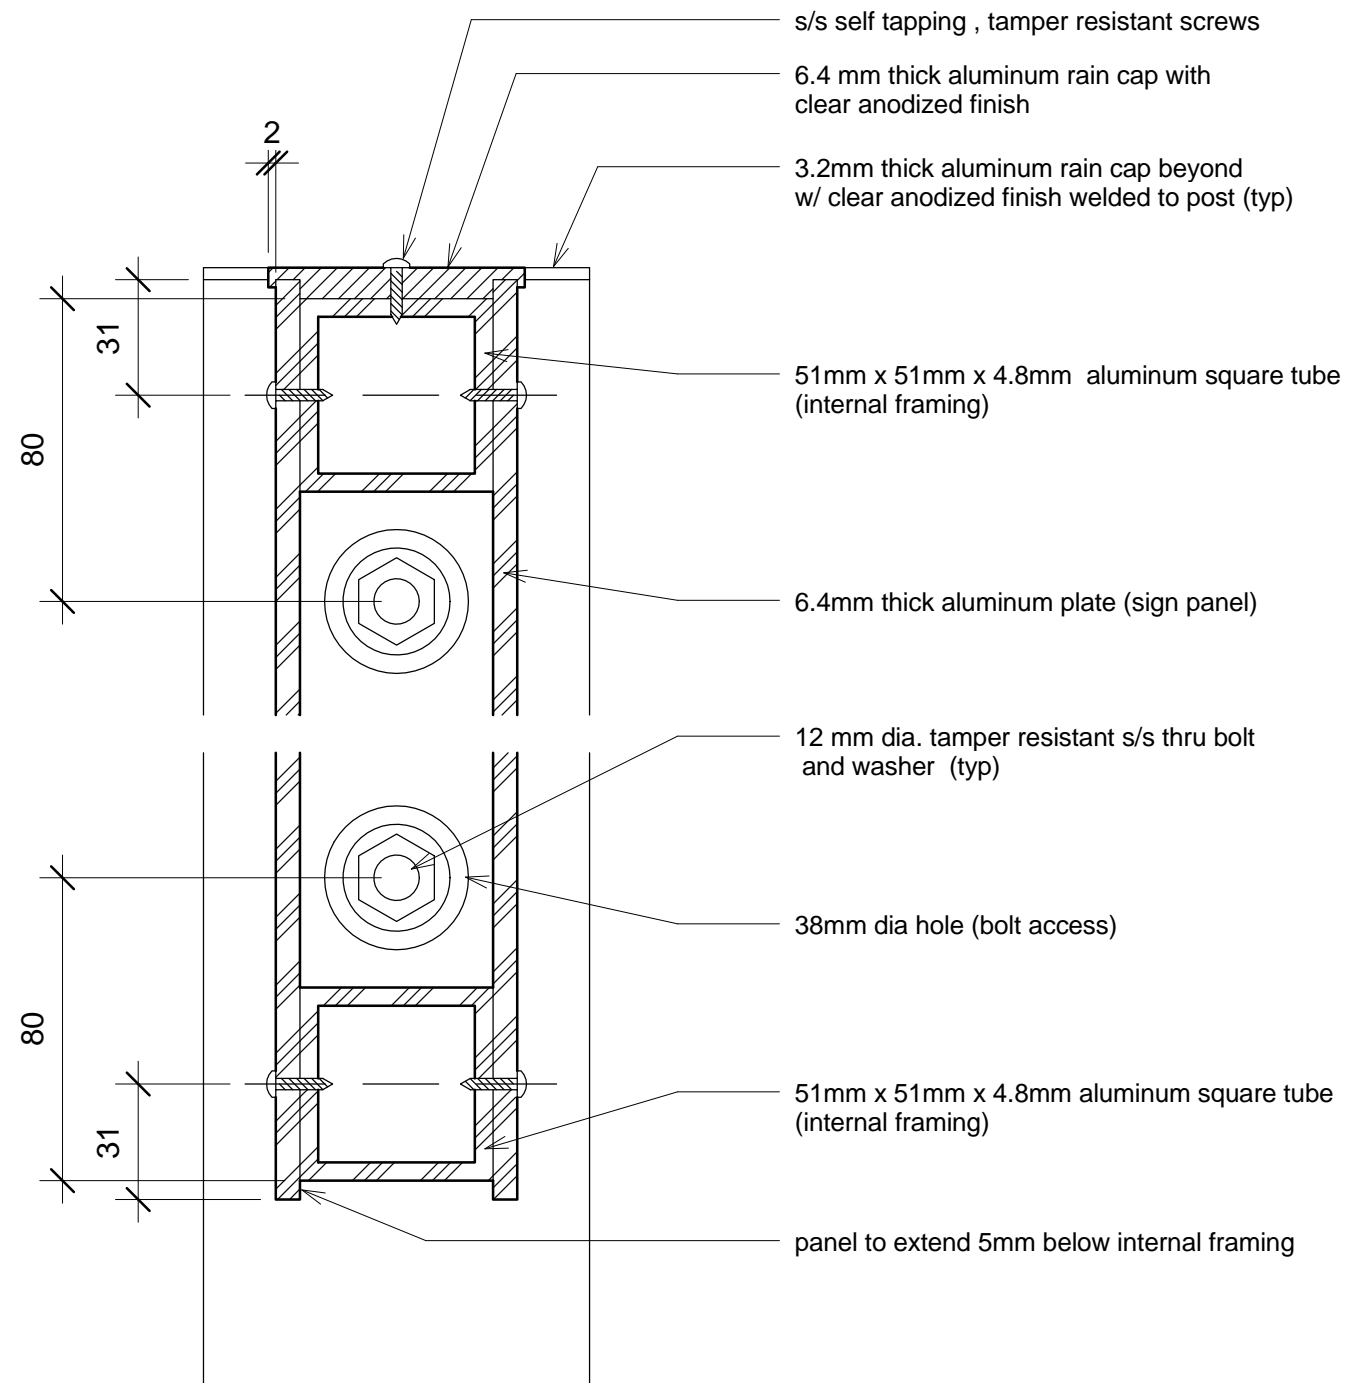


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section detail 1 scale 1:2

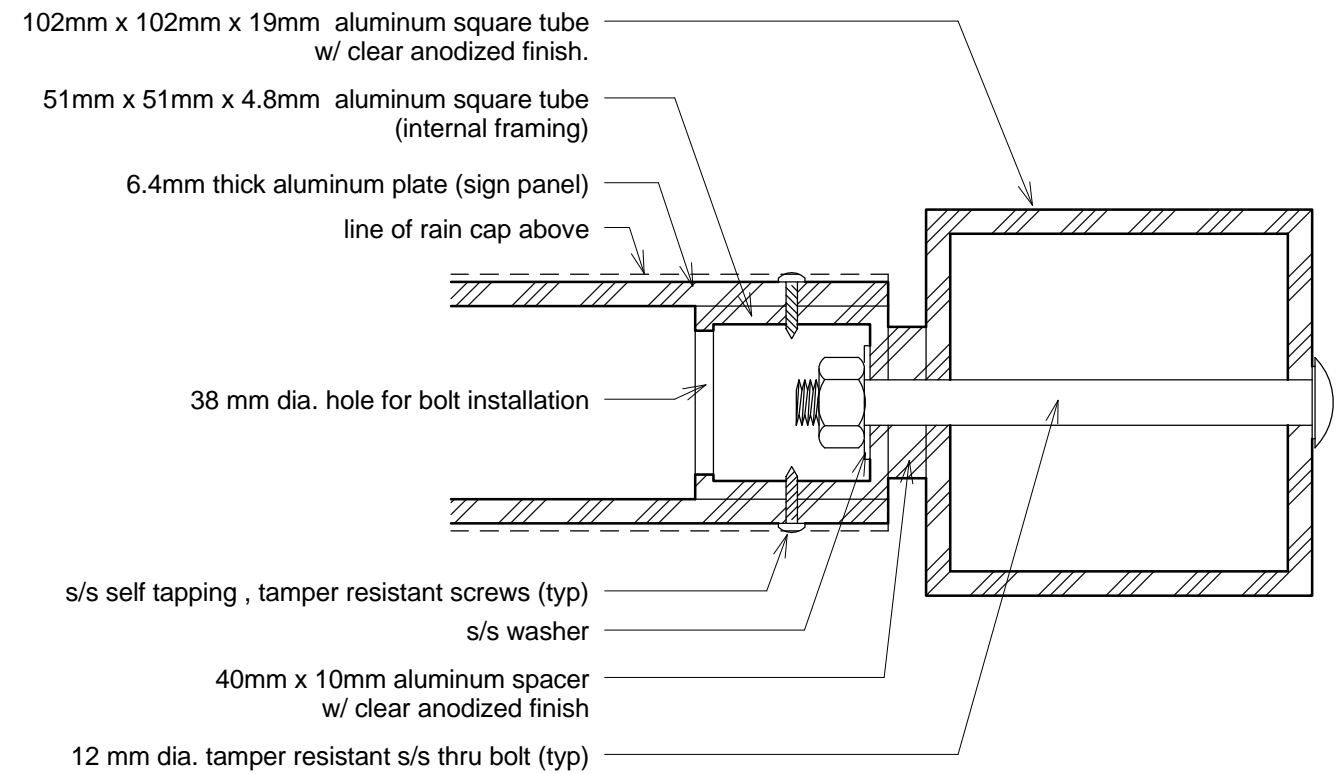

section detail 2 scale 1:2

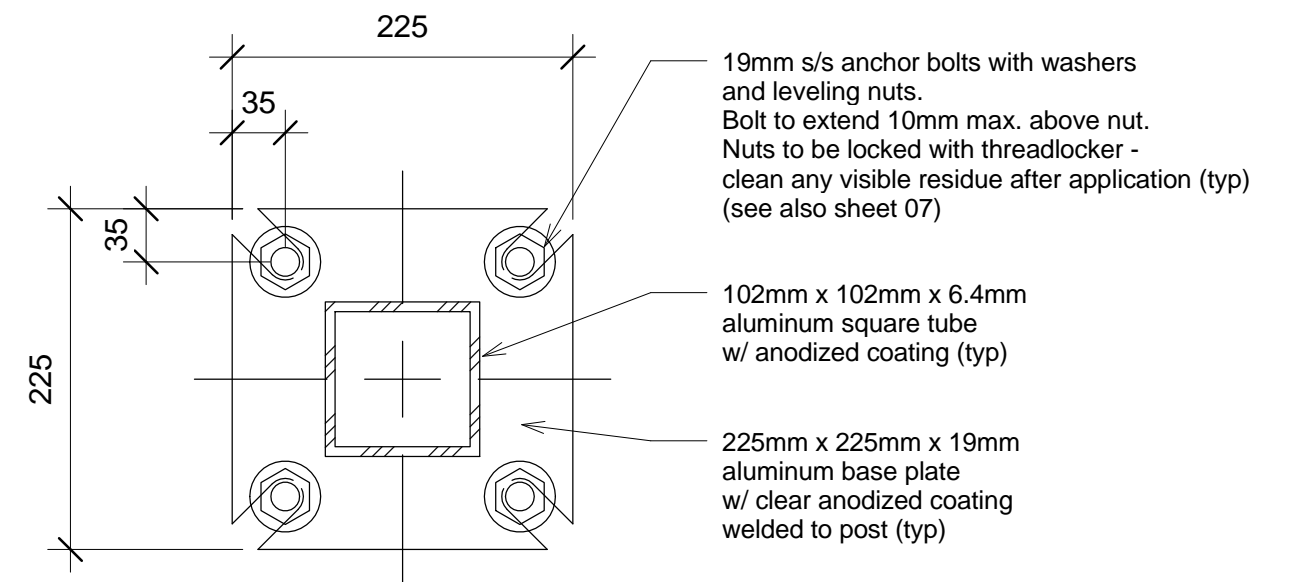

section b (slip base) scale 1:5

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 2A - Parking Lot
sheet name: sign construction - details
scale: as noted

sheet
number:

06



**University
of Victoria**

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
- Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #174786 (1/2" s/s x 5" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
 - rain cap attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes




Sign No. 2C

Vehicular - Parking Lot

core colours



clear anodized coating
application: sign structure




PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 424 C
application: background



PANTEONE 7541 C
application: background,
back panel (single sided sign)
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

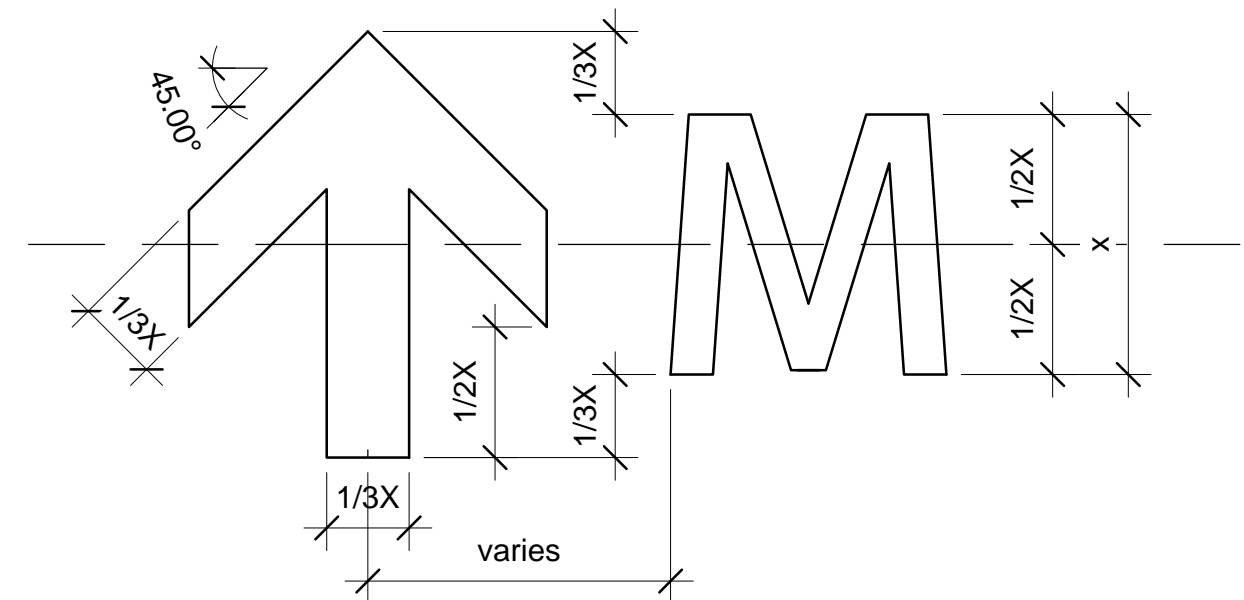

University of Victoria Logo, horizontal standard



University of Victoria



University of Victoria



full colour

opaque monochromatic

opaque monochromatic reversed

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 2C - Parking Lot
sheet name: typography, colours and pictograms
scale: as noted

sheet
number:



02



**University
of Victoria**

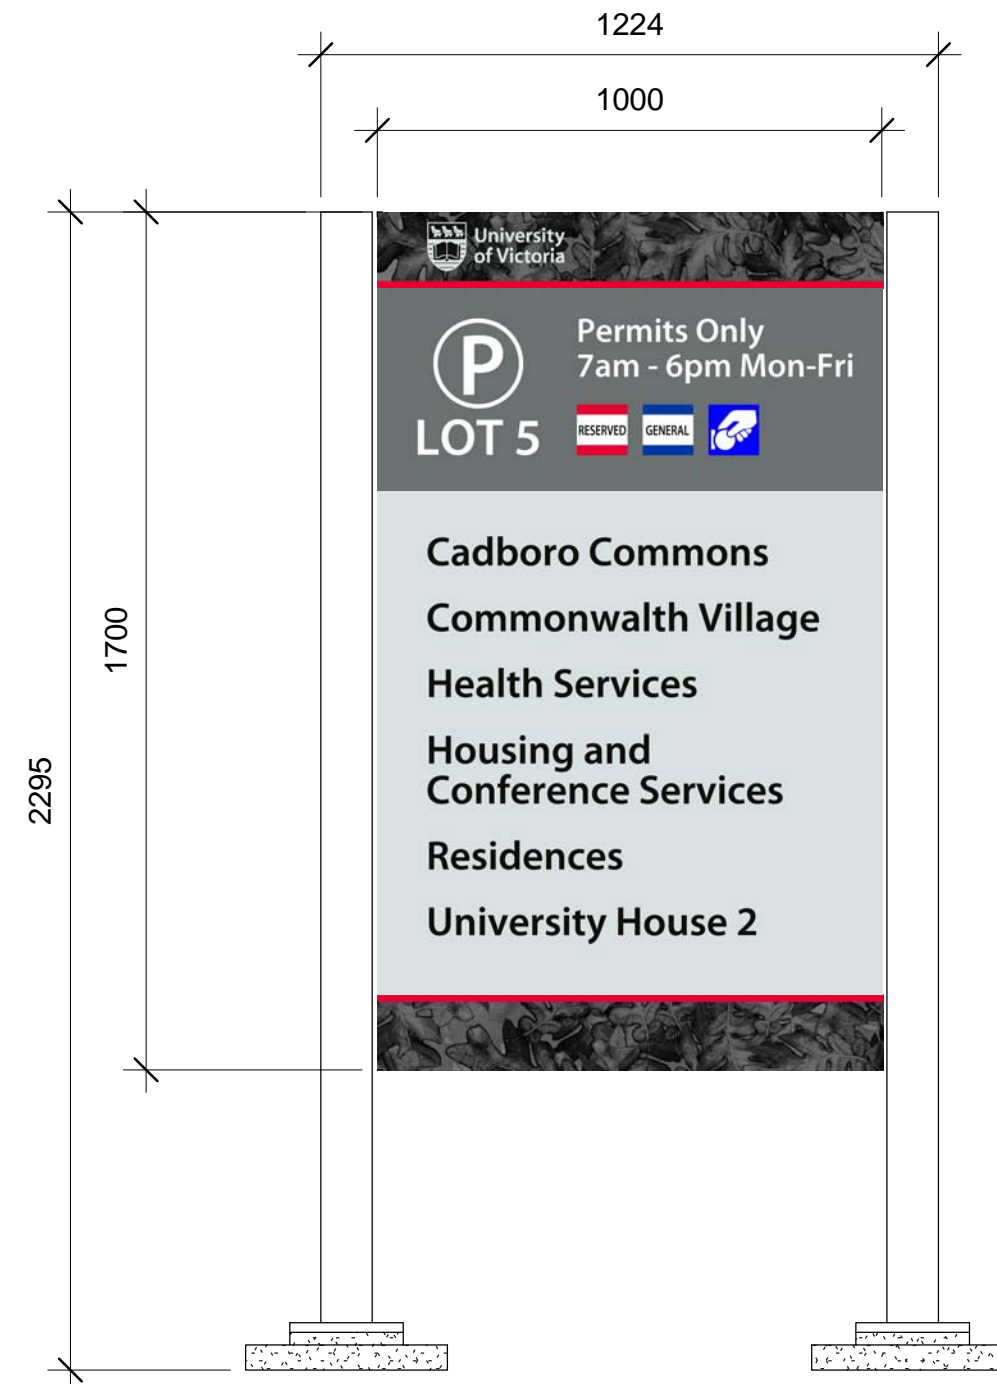

Parking Lot C
scale 1:15

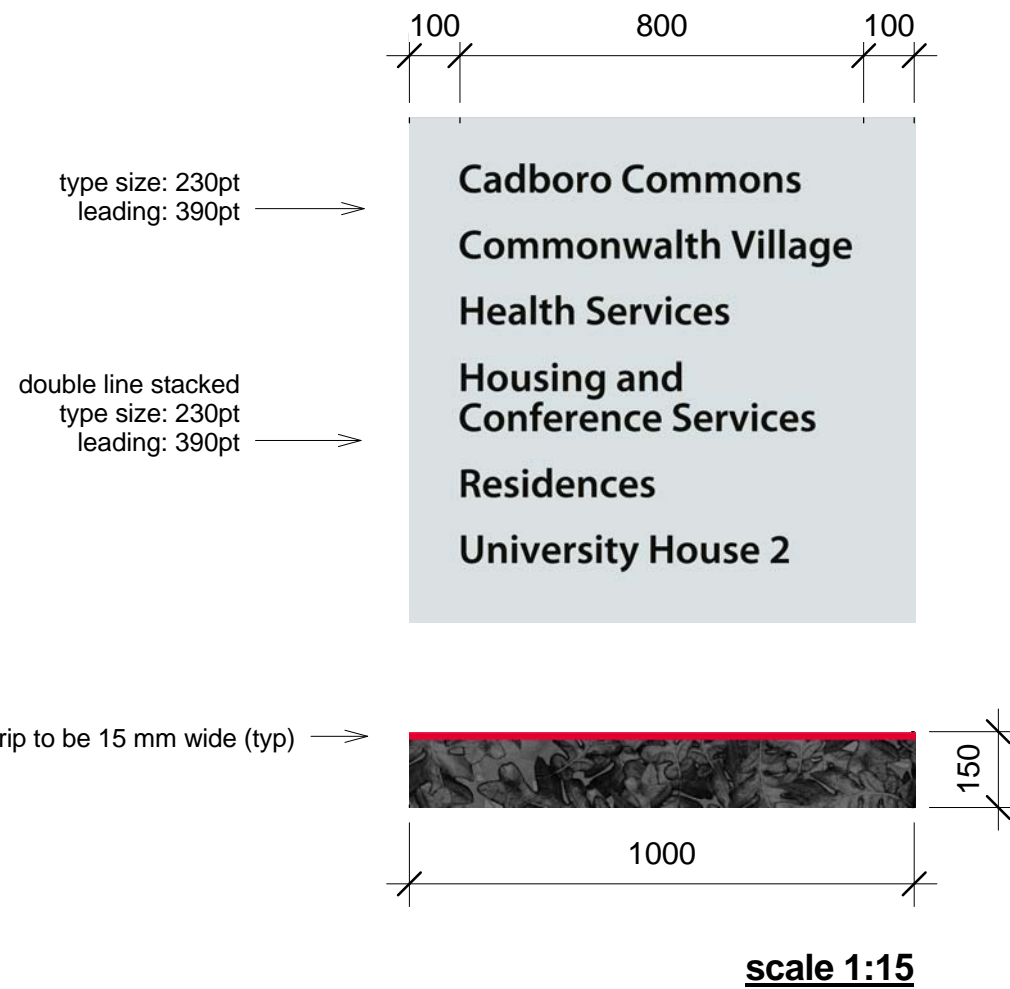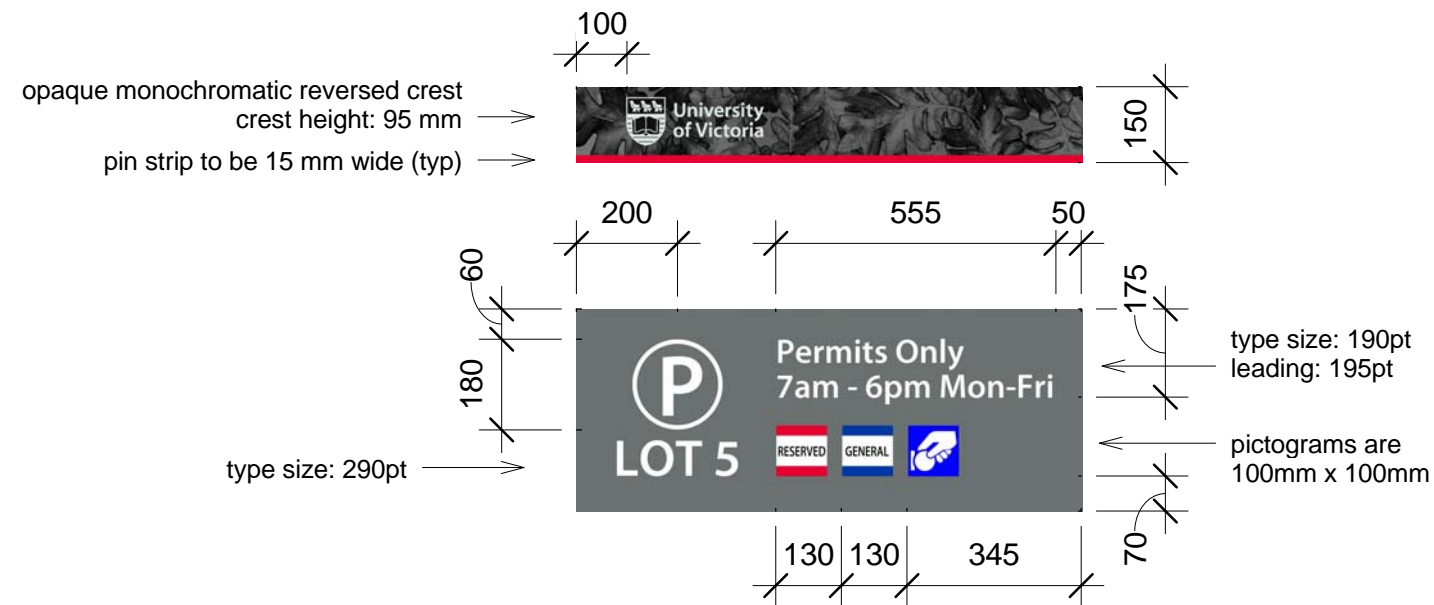



Description
Digitally printed vinyl protected with
anti-graffiti, optically clear overlamine
Aluminum panel size (one piece): 1050 mm x 750 mm x 6.4 mm
See sheet 05 for details.

Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.


- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlamines as recommended by manufacturer
- 3) Wrap vinyl and overlamine over the edges of the aluminum panel.
- 4) If single sided sign then back panel to receive vinyl printed with PANTEONE 7541 C

Refer to Adobe Photoshop files for detailed sample layout

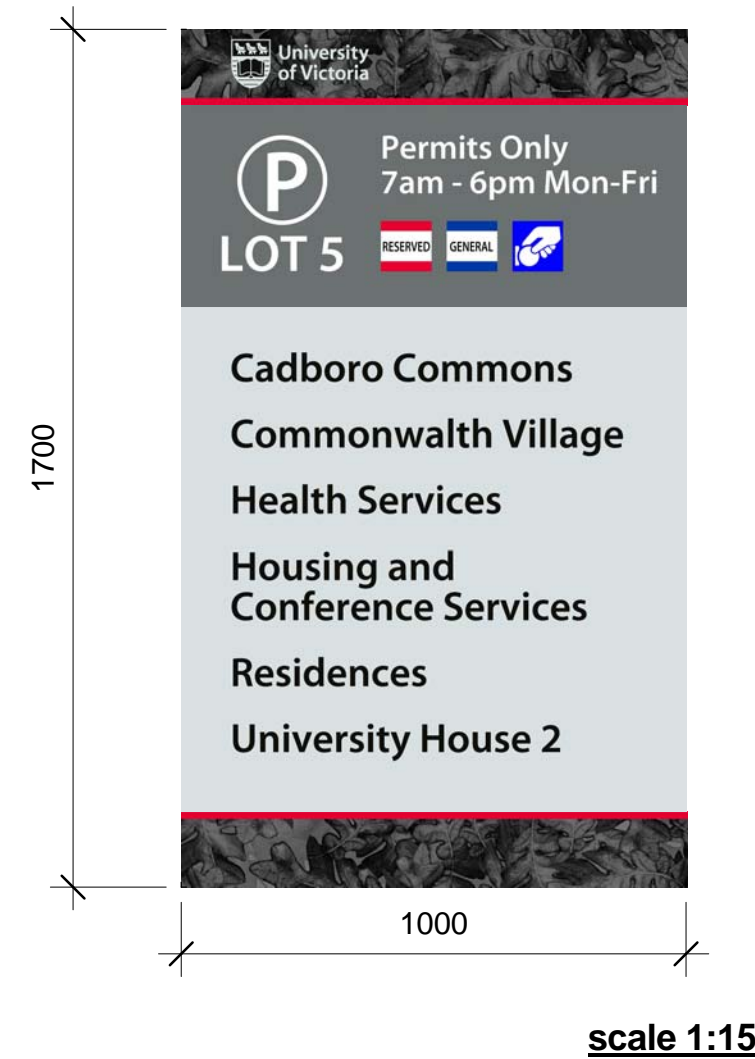

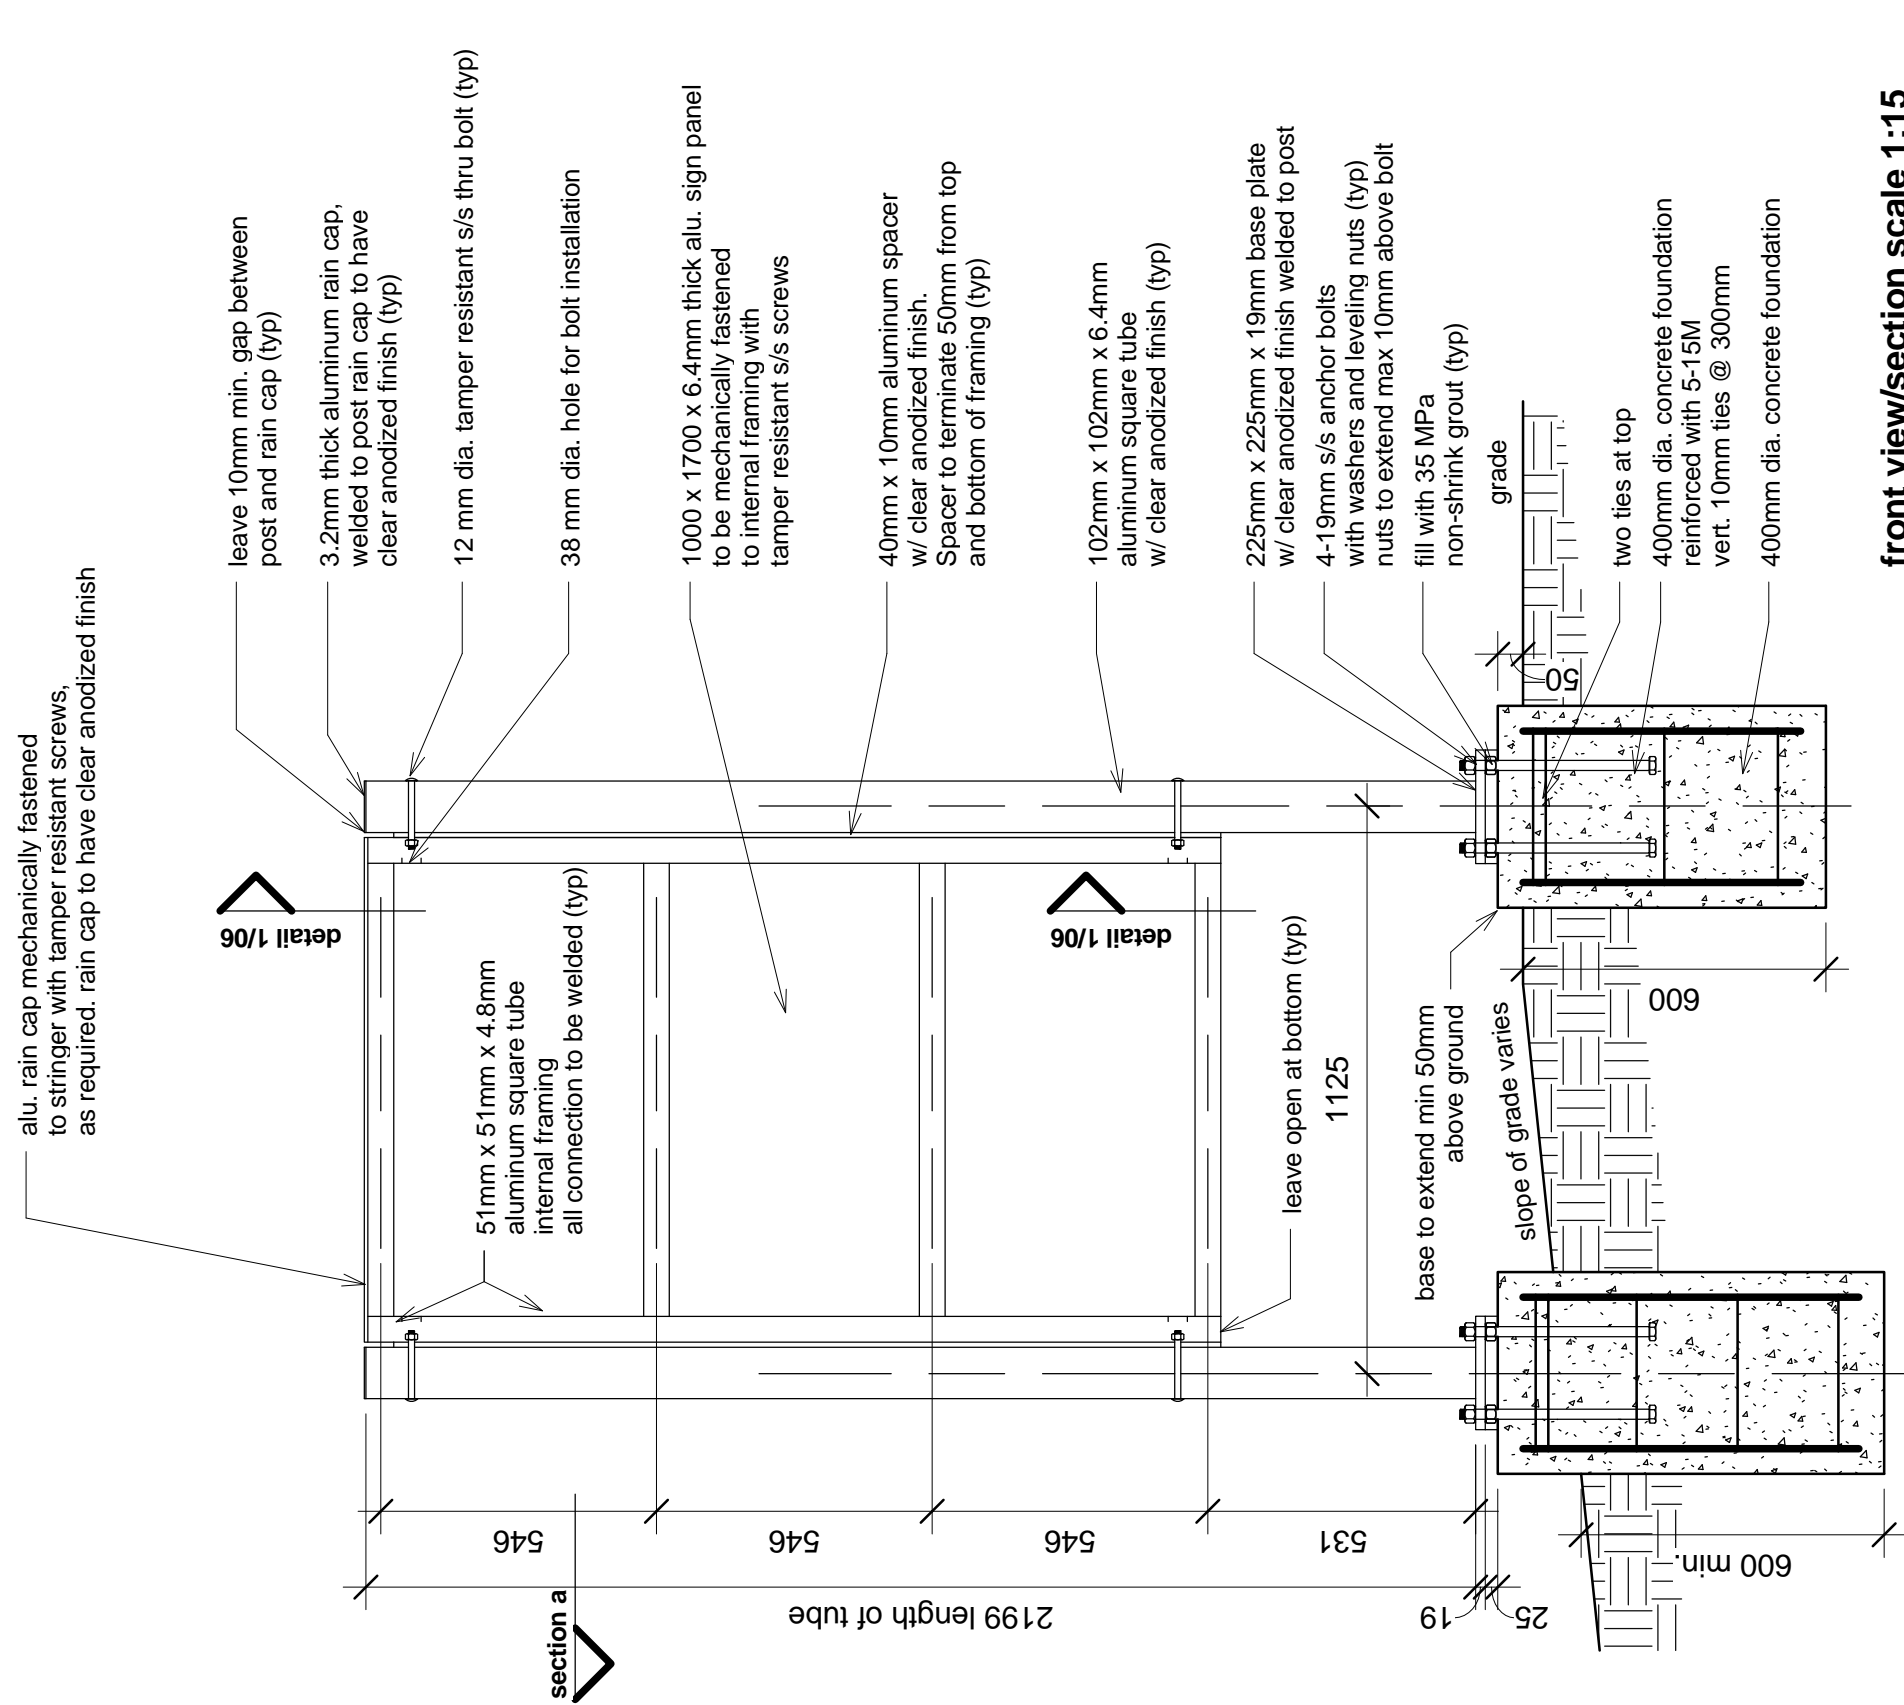


front view/section scale 1:15

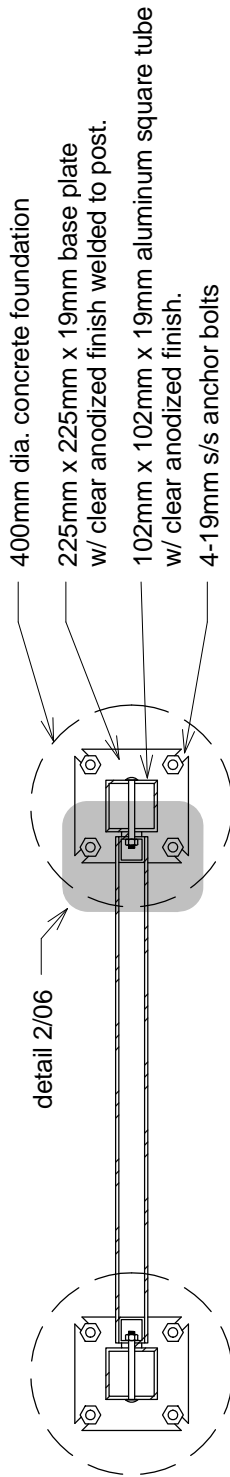


section a scale 1:15

General Note:
Manufacturer to verify all diemnsions
prior to sign fabrication. All discrepancies
should be reported to the Architect.

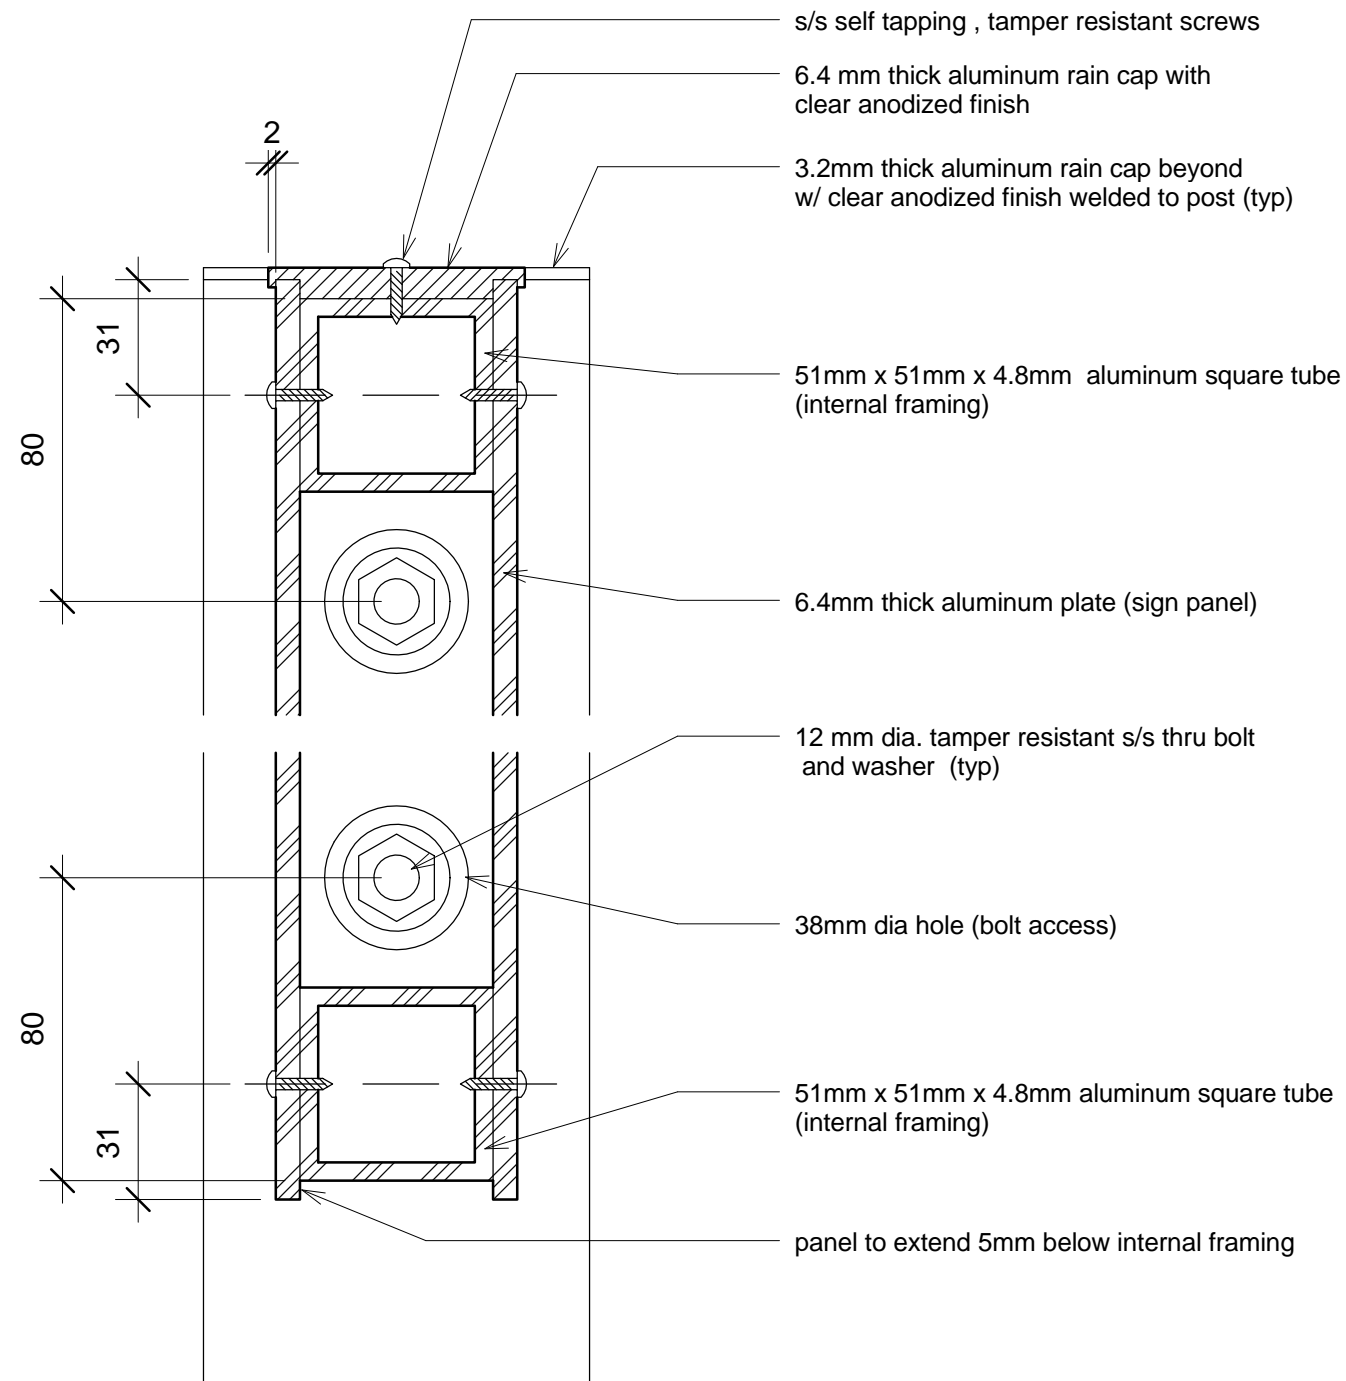


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section detail 1 scale 1:2

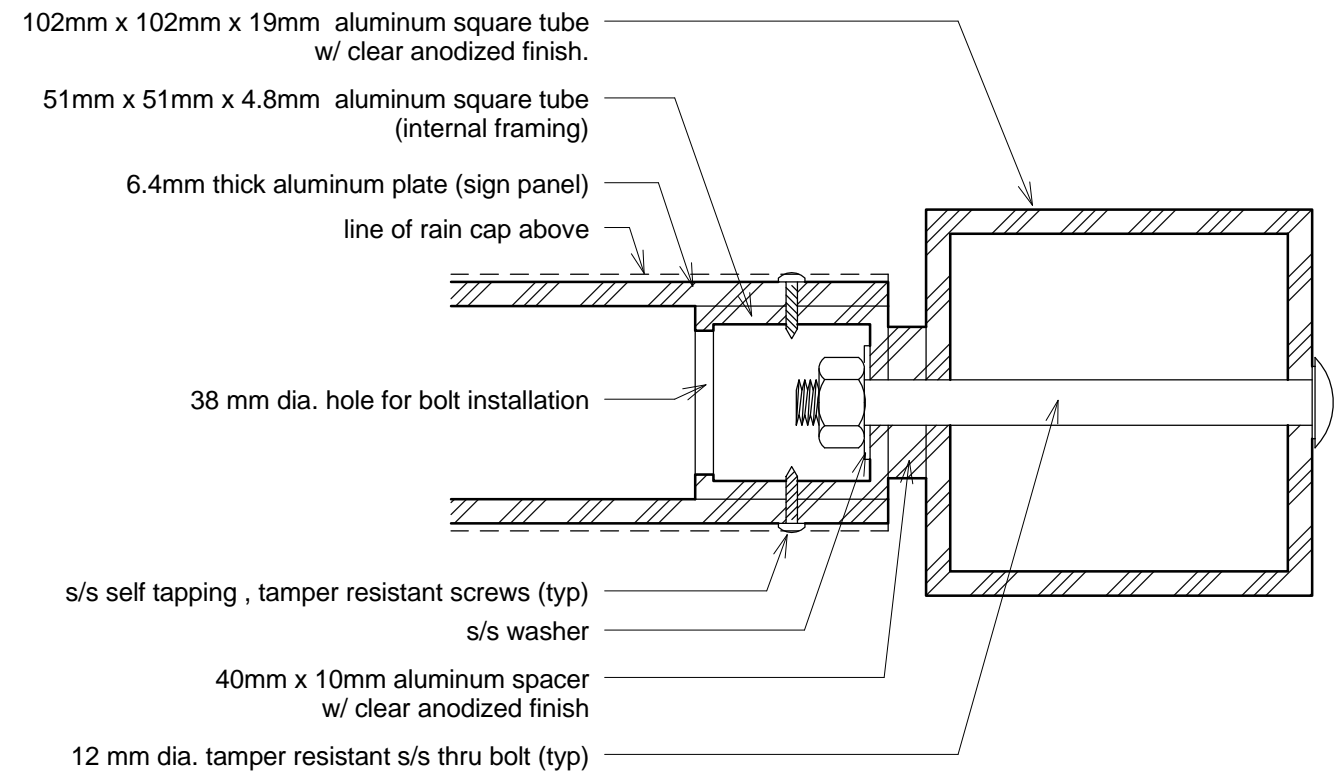

section detail 2 scale 1:2

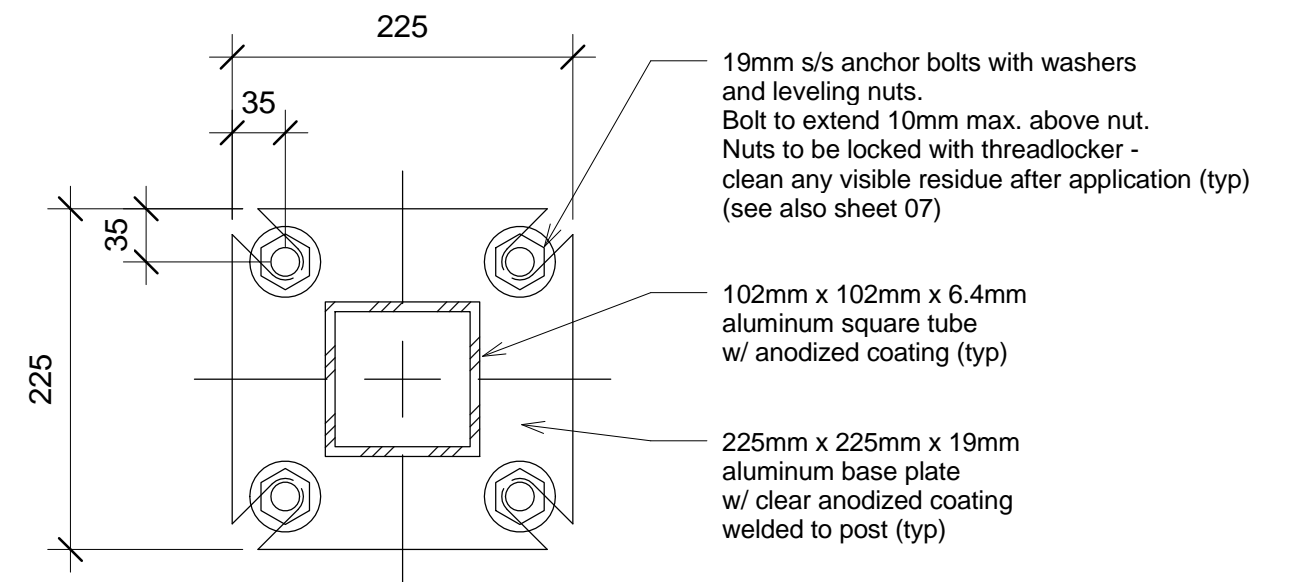

section b (slip base) scale 1:5

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 2C - Parking Lot
sheet name: sign construction - details
scale: as noted

sheet
number:

06



University
of Victoria

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
- Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #174786 (1/2" s/s x 5" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
 - rain cap attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.





Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes

Sign No. 3A

Vehicular - Building Identification

project: Campus Wayfinding

number: FM 09-8567

issue date: Jan 31, 2012


sign: Sign No. 3A - Building Identification

sheet name: title sheet and drawing list


scale: as noted

sheet number: 01

core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
back panel (single sided sign)
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

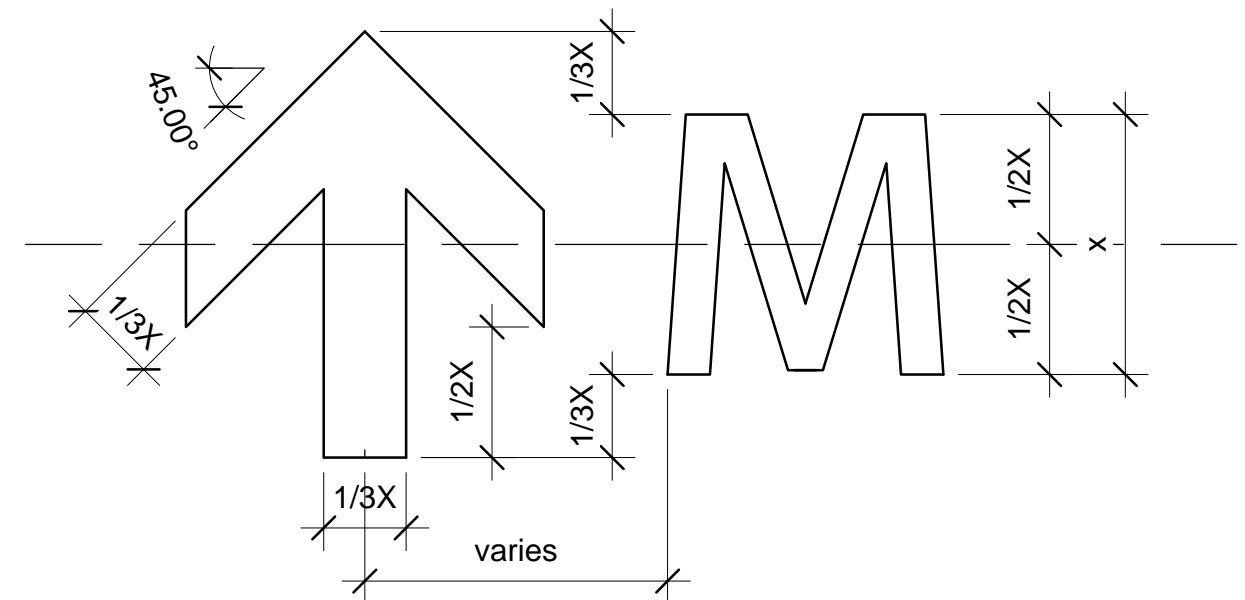

University of Victoria Logo, horizontal standard



University
of Victoria



University
of Victoria



University
of Victoria

full colour

opaque monochromatic

opaque monochromatic reversed

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 3A - Building Identification
sheet name: typography, colours and pictograms
scale: as noted

sheet
number:


02



University
of Victoria

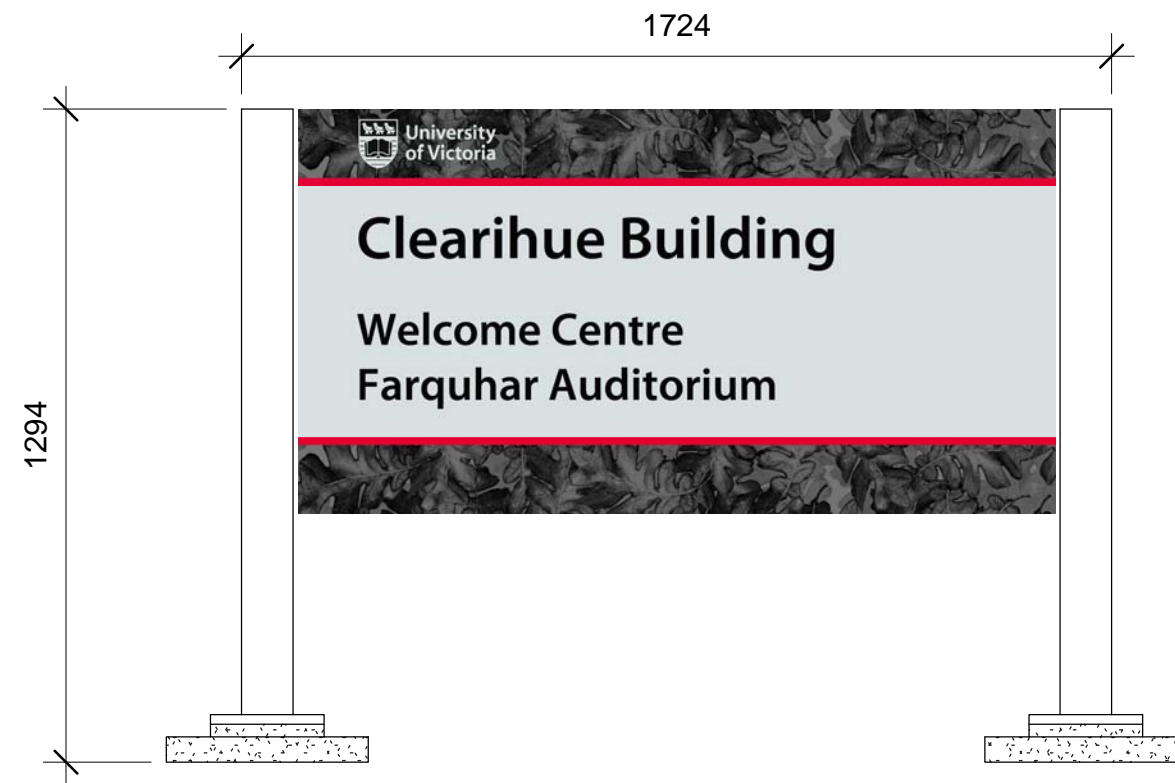


building name with occupant names
scale 1:15

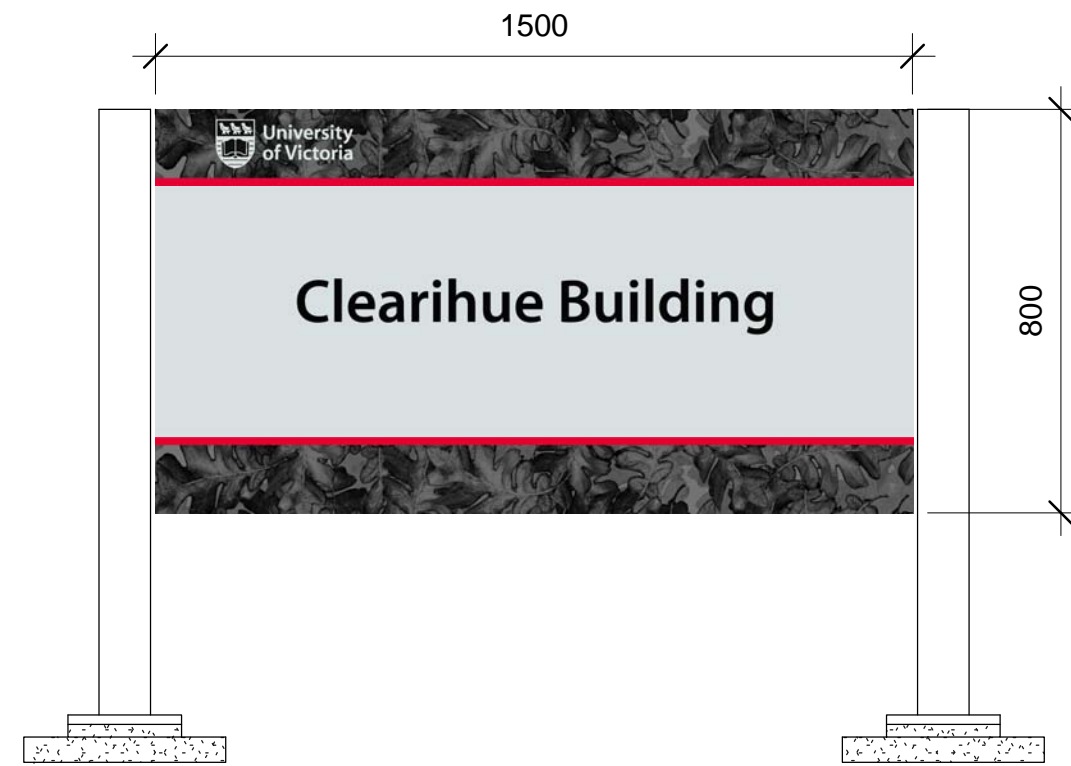


building name, text in one line
scale 1:15



building name, text in two lines
scale 1:15

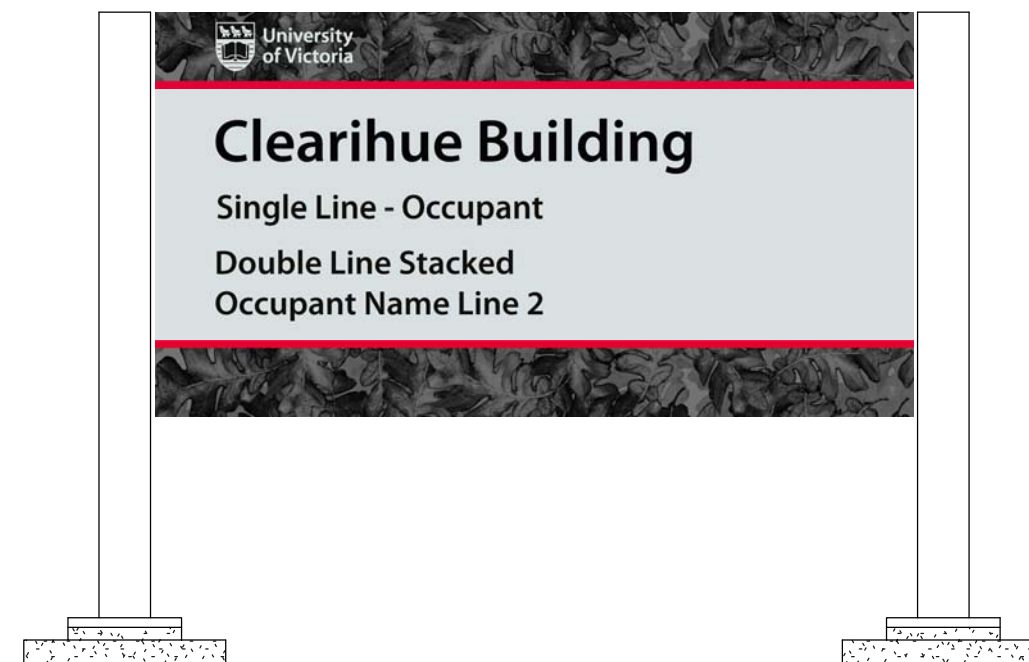

building name, text in two lines (double line stacked)
scale 1:15

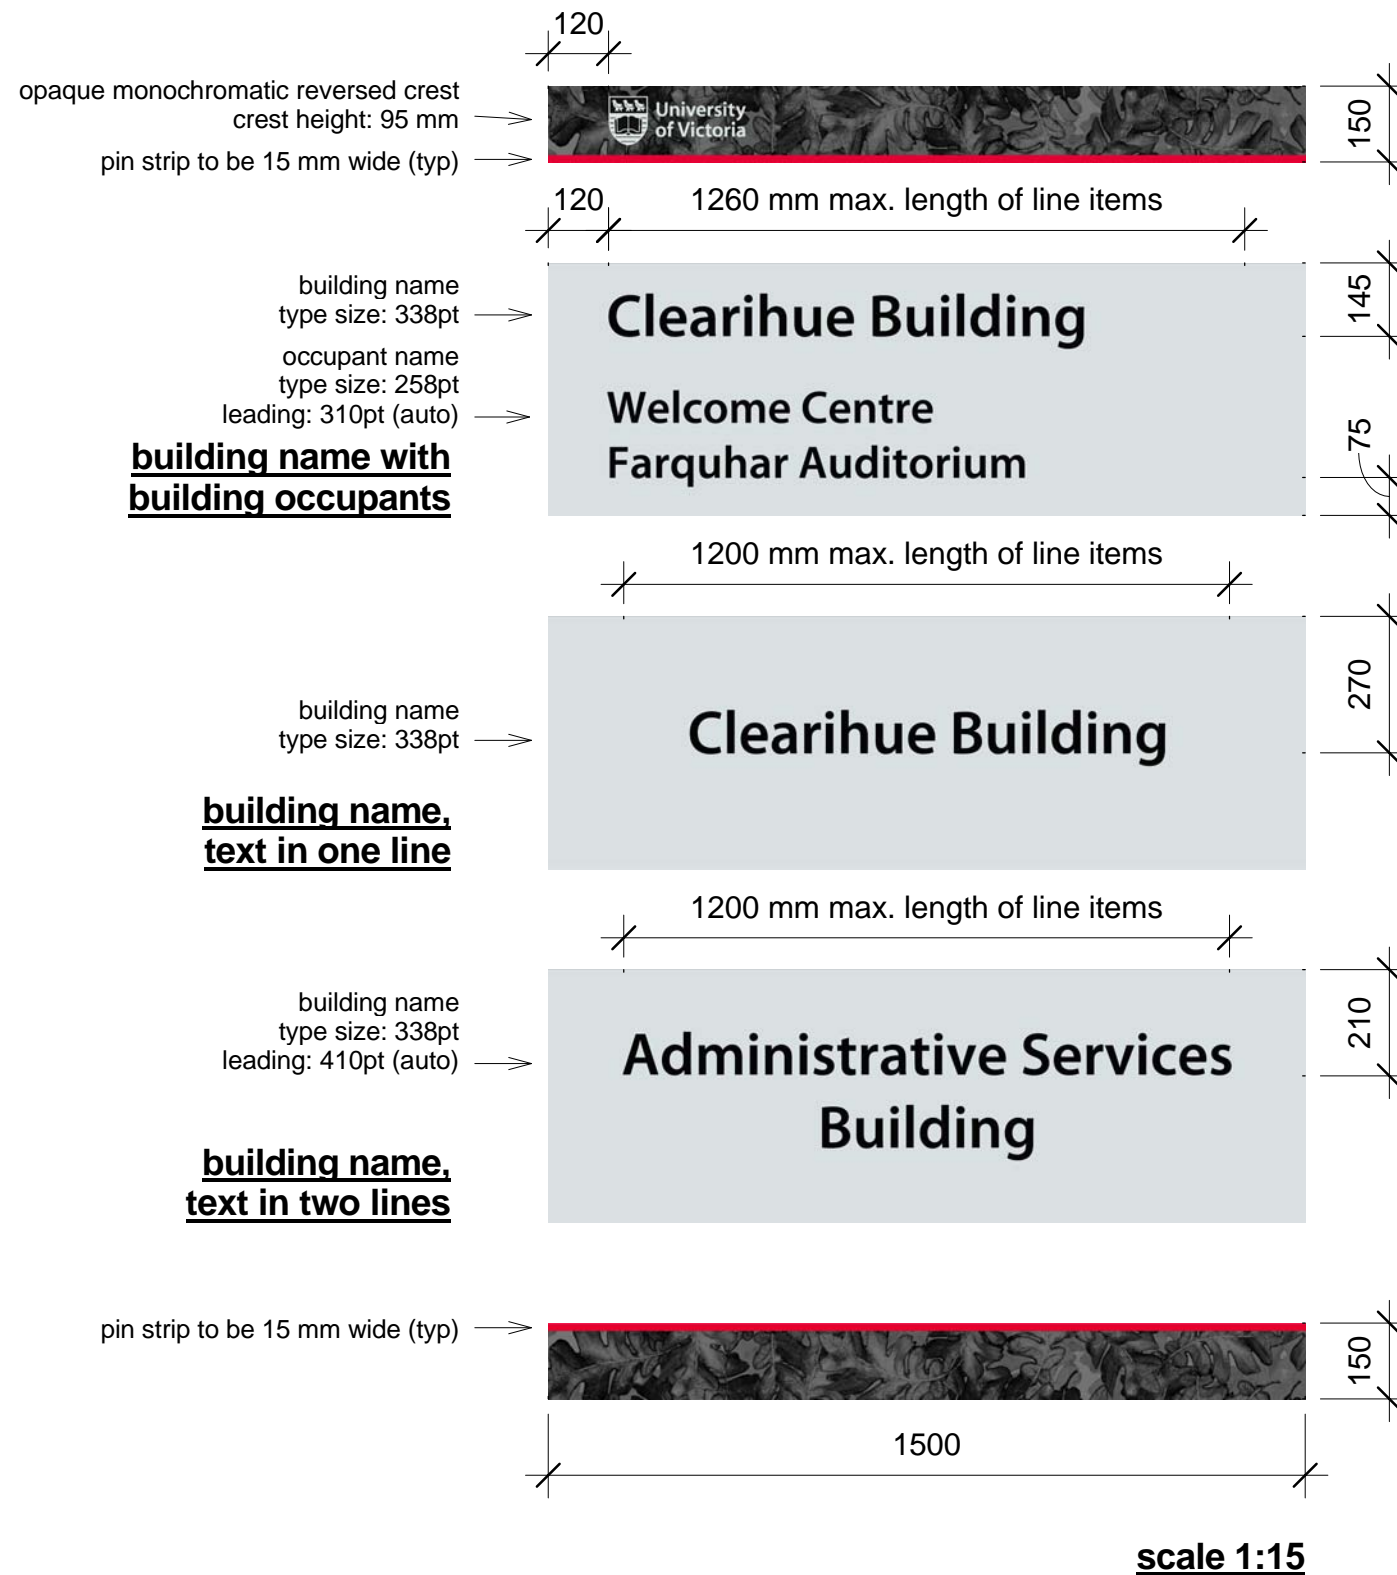


Description
Digitally printed vinyl protected with
anti-graffiti, optically clear overlaminate
Aluminum panel size (one piece): 1500 mm x 800 mm x 6.4 mm
See sheet 05 for details.

Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and overlaminate over the edges of the aluminum panel.
- 4) If single sided sign then back panel to receive vinyl printed with PANTEONE 7541 C

Refer to Adobe Photoshop files for detailed sample layout

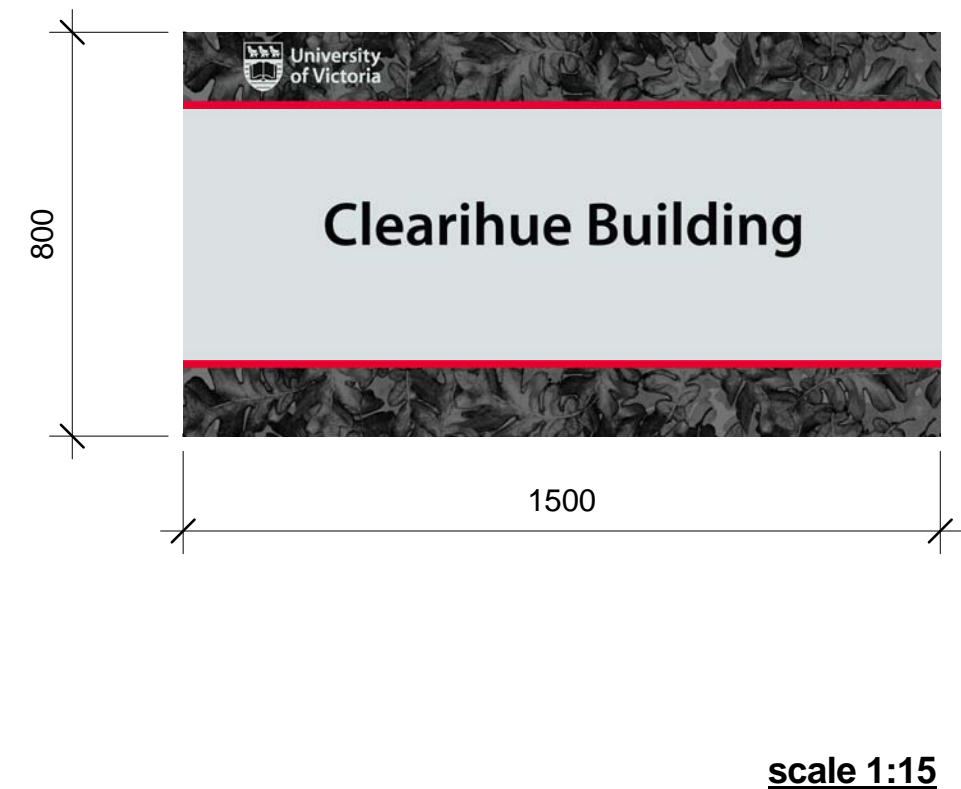

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 3A - Building Identification
sheet name: sign design - graphic design details
scale: as noted

sheet
number:


04




University
of Victoria

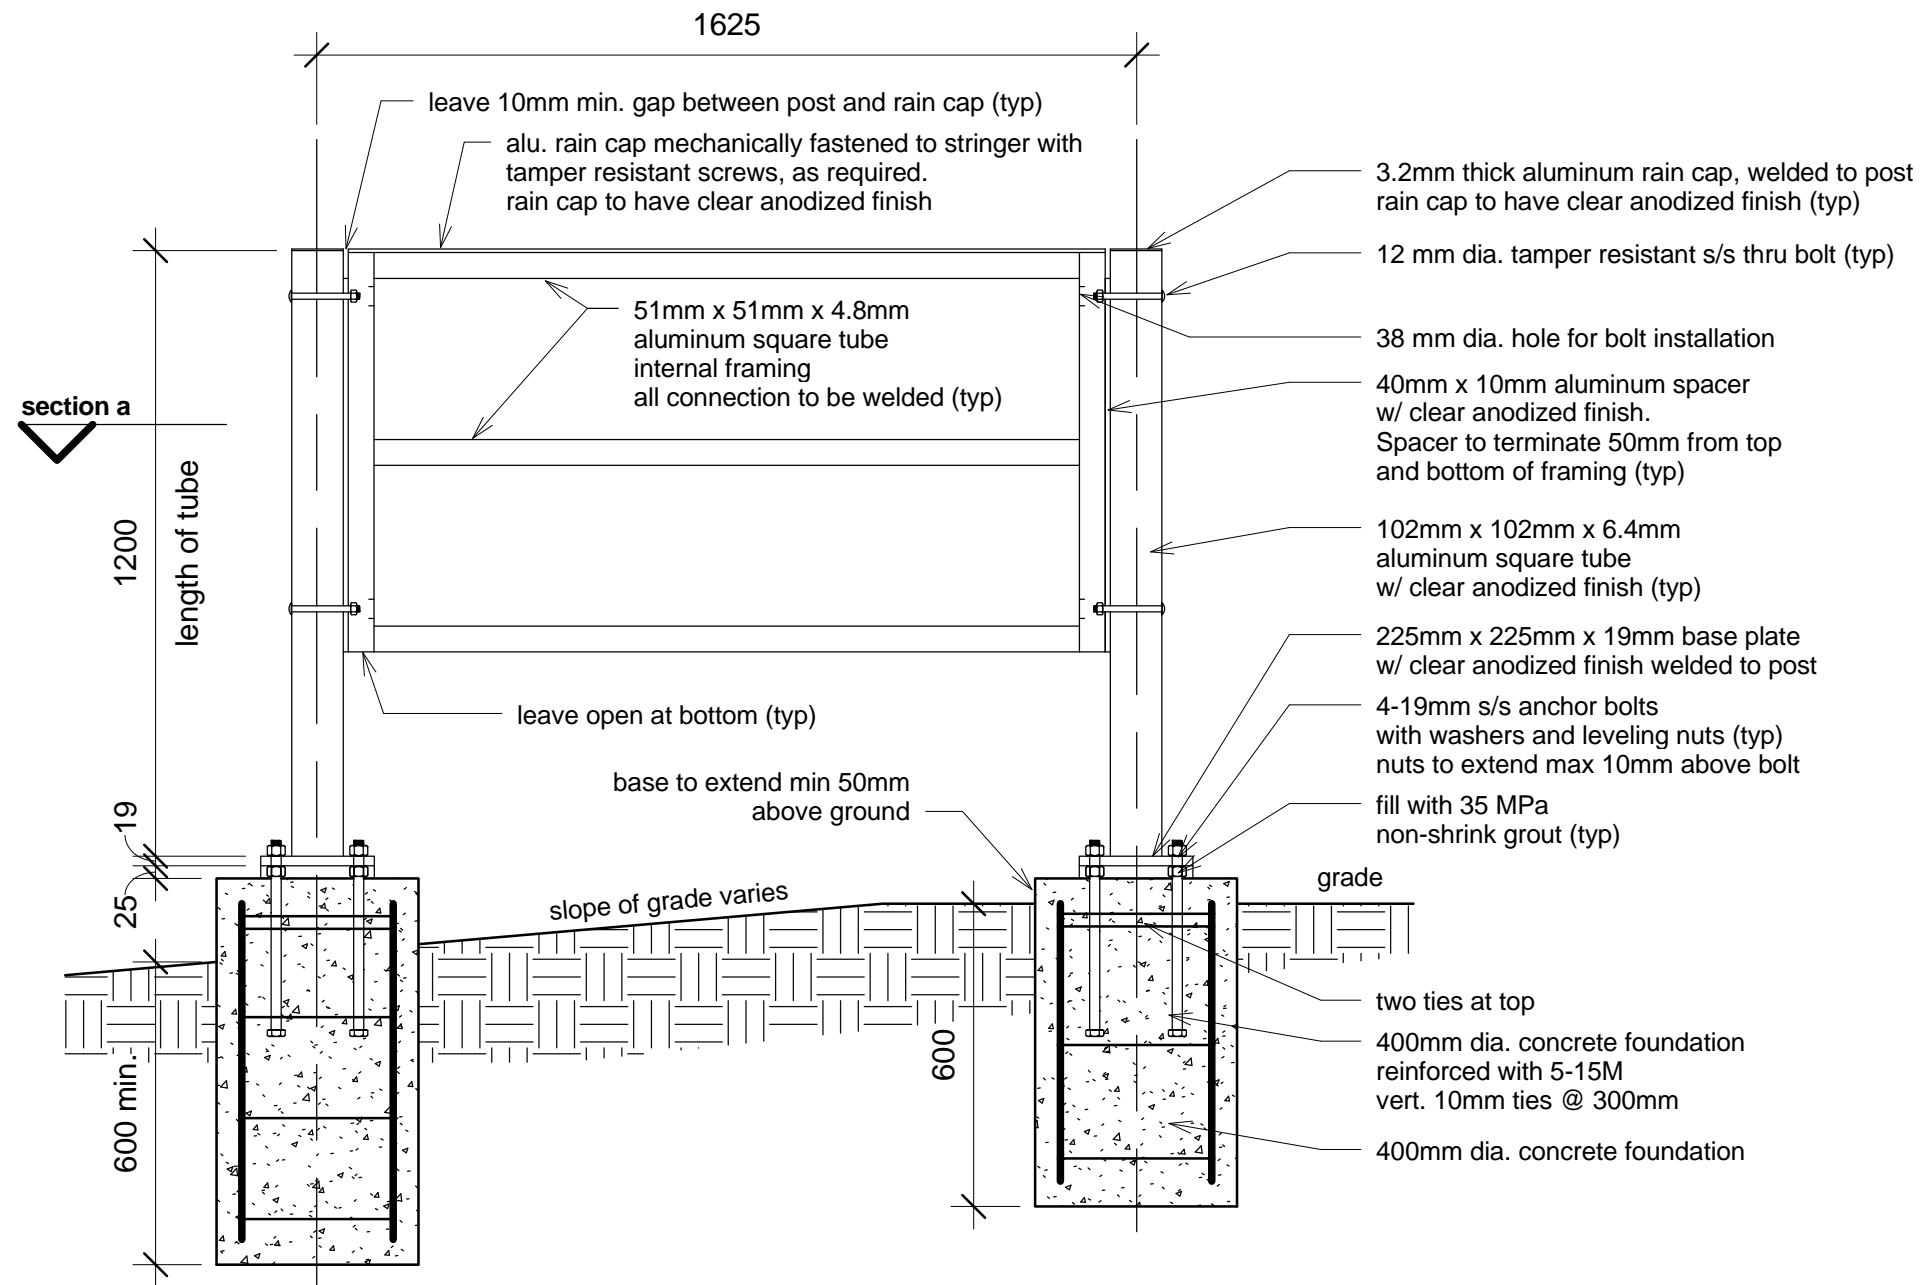

front view/section scale 1:15

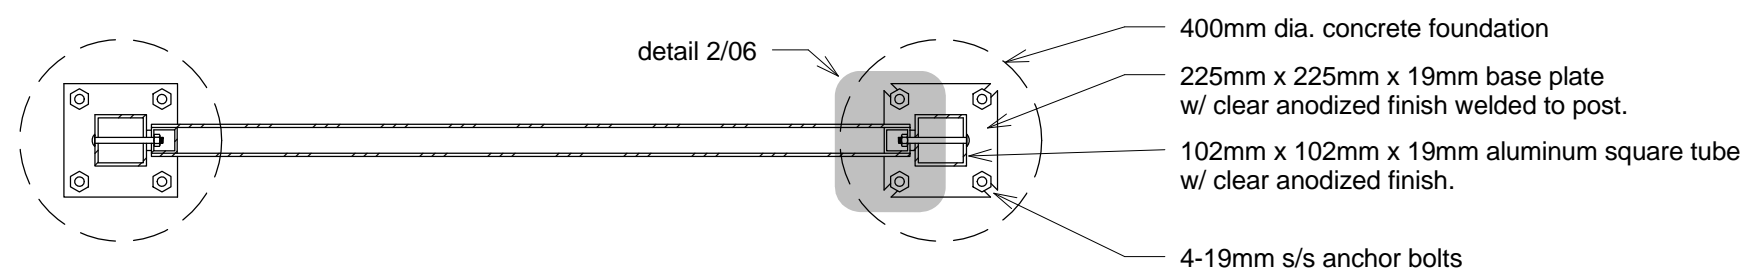


section a scale 1:15

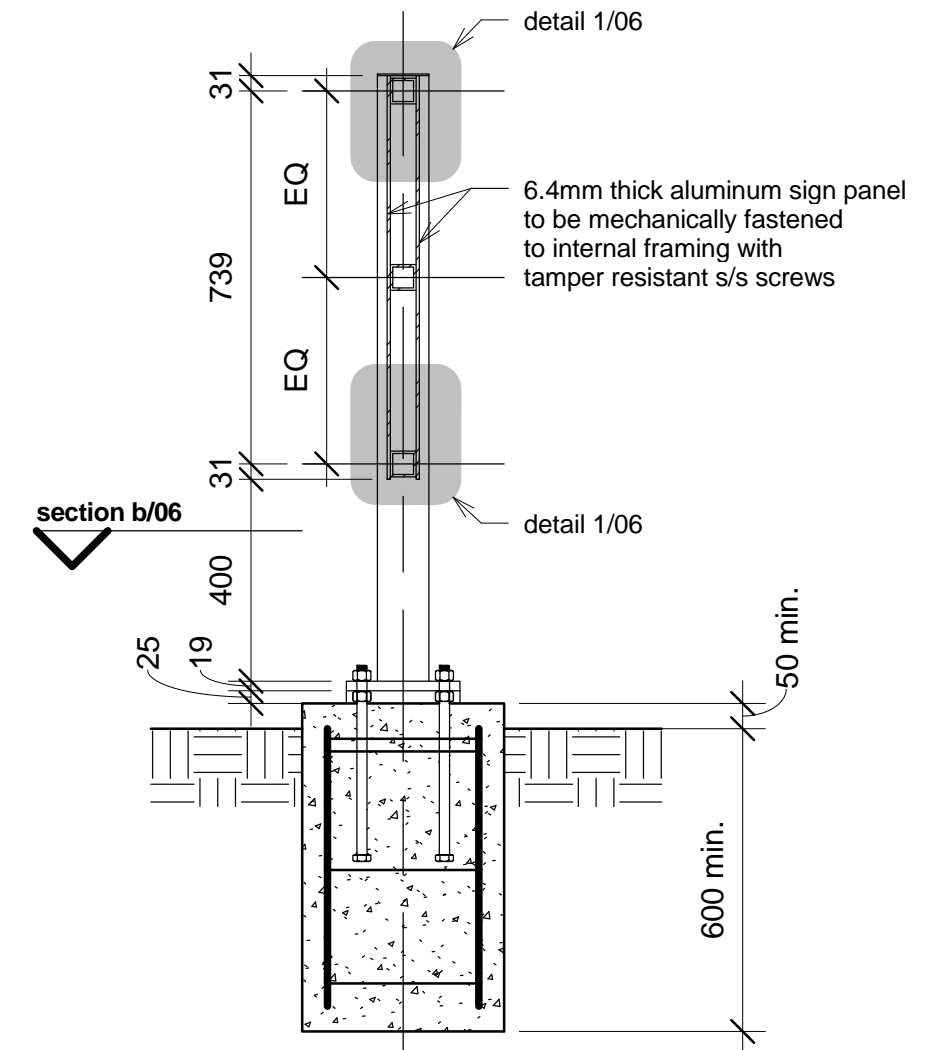


side view/section scale 1:15

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

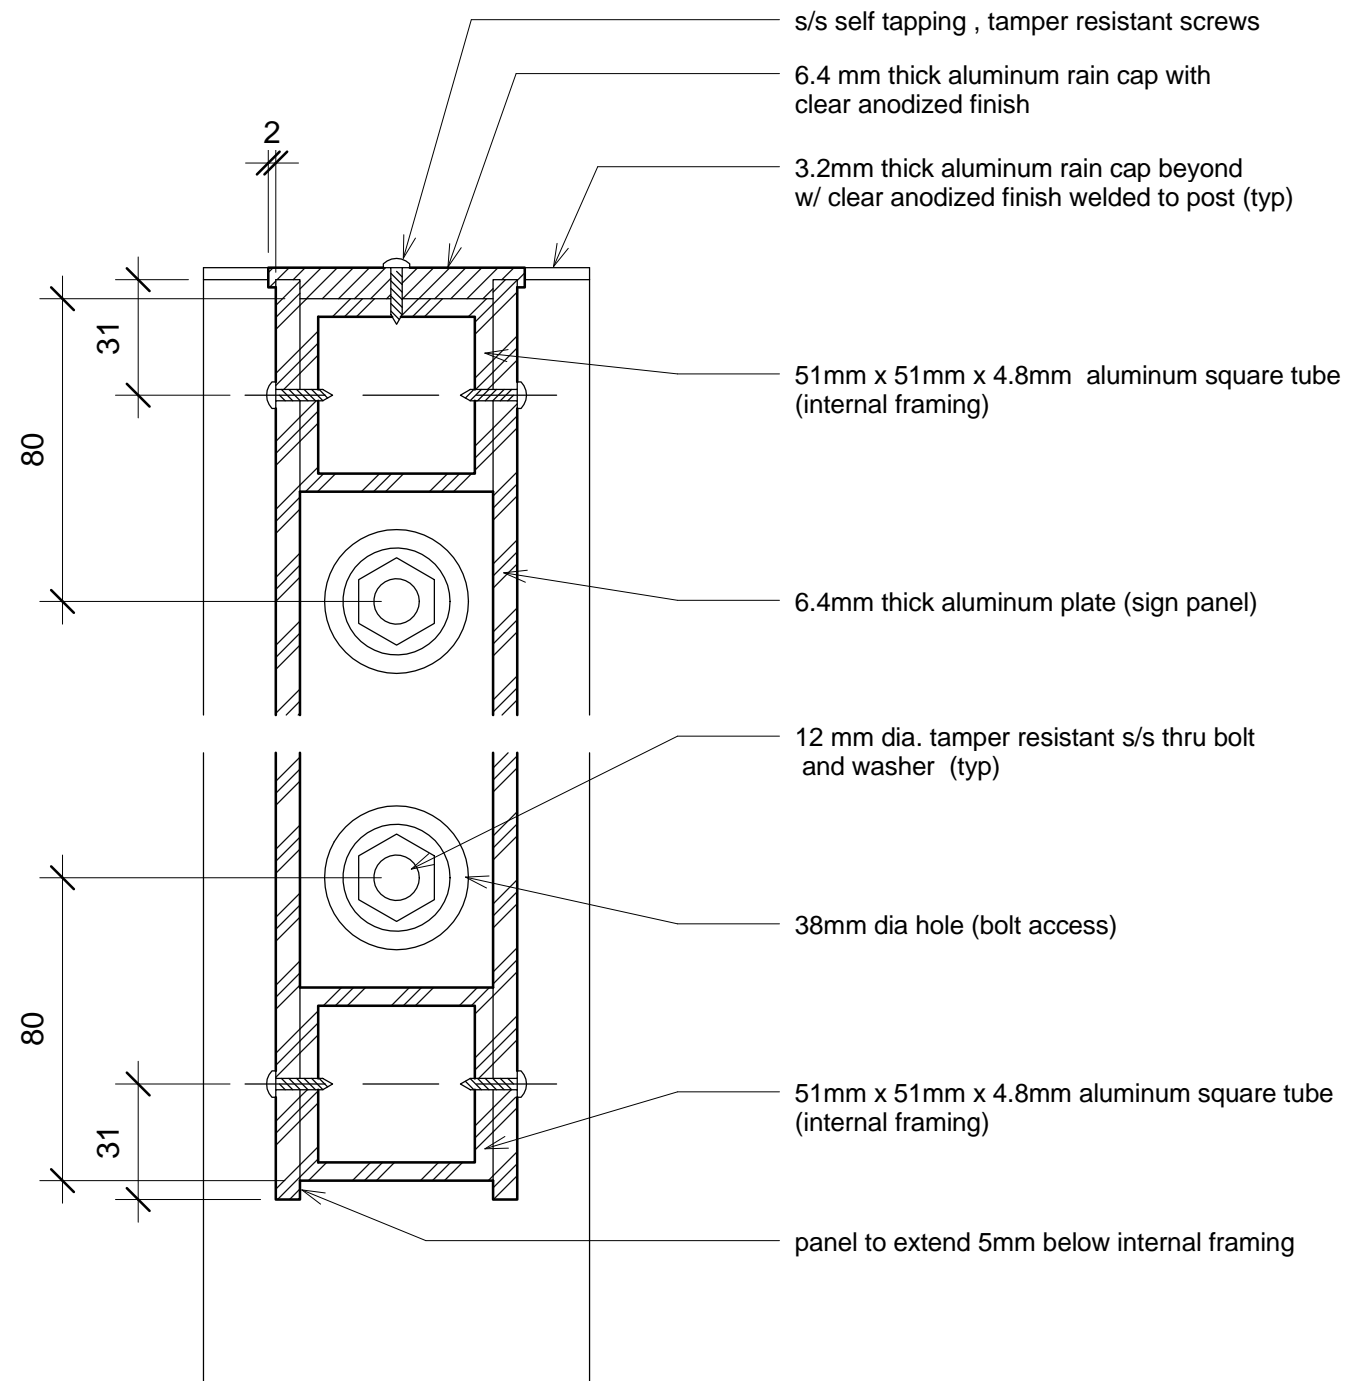


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section detail 1 scale 1:2

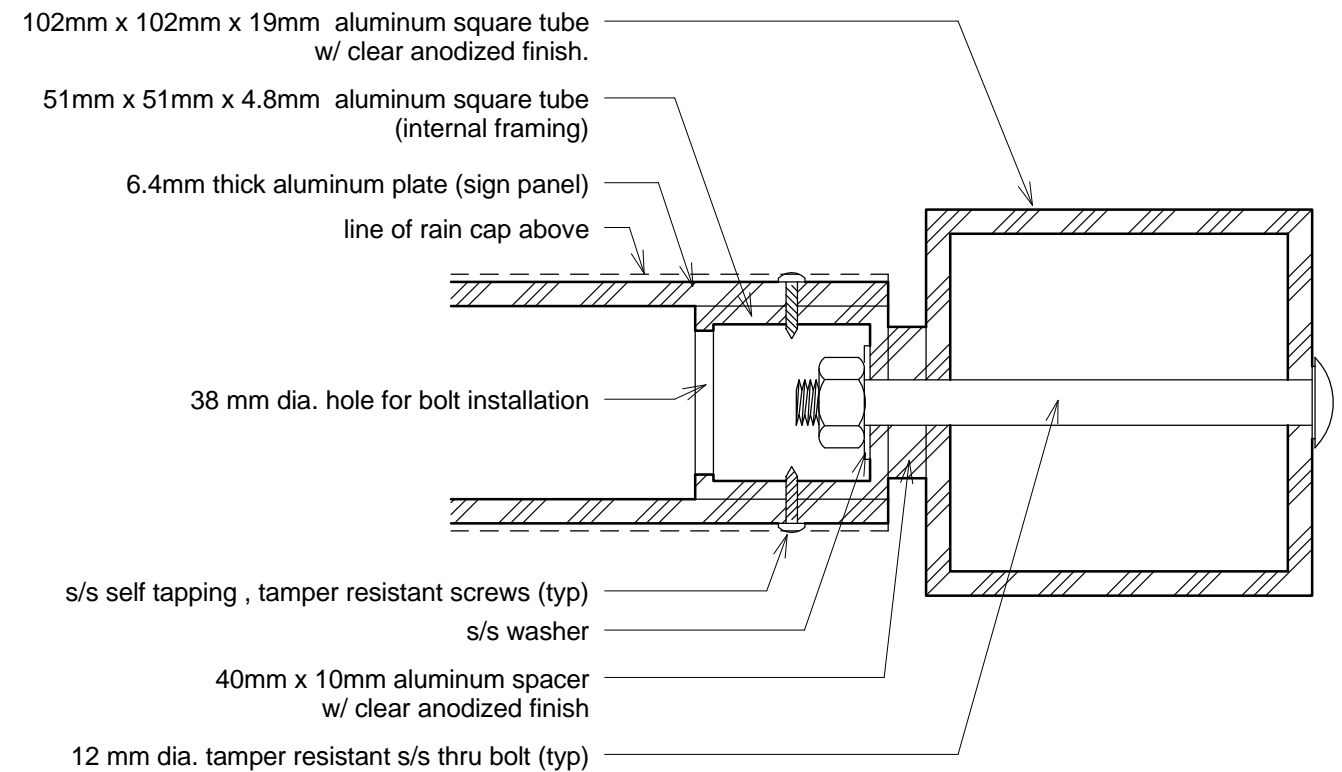

section detail 2 scale 1:2

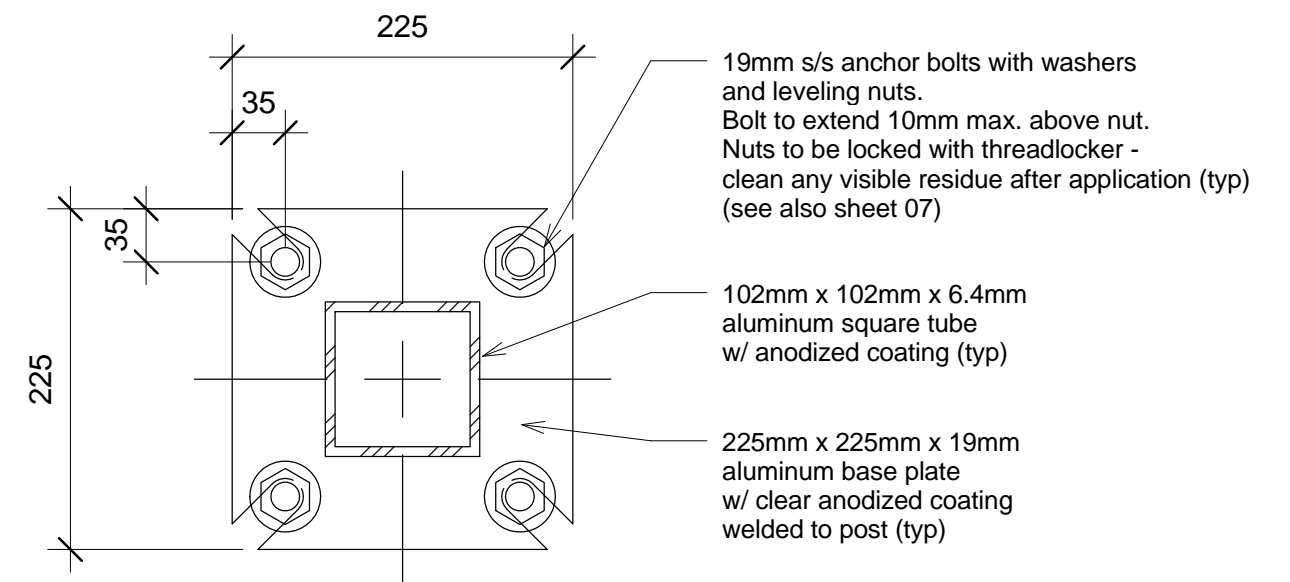

section b (slip base) scale 1:5

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 3A - Building Identification
sheet name: sign construction - details
scale: as noted

sheet
number:

06



**University
of Victoria**

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
- Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #174786 (1/2" s/s x 5" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
 - rain cap attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.





Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes


Sign No. 3B

Vehicular - Building Identification

core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
back panel (single sided sign)
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family


Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890


arrow style and arrow size in relation to text height

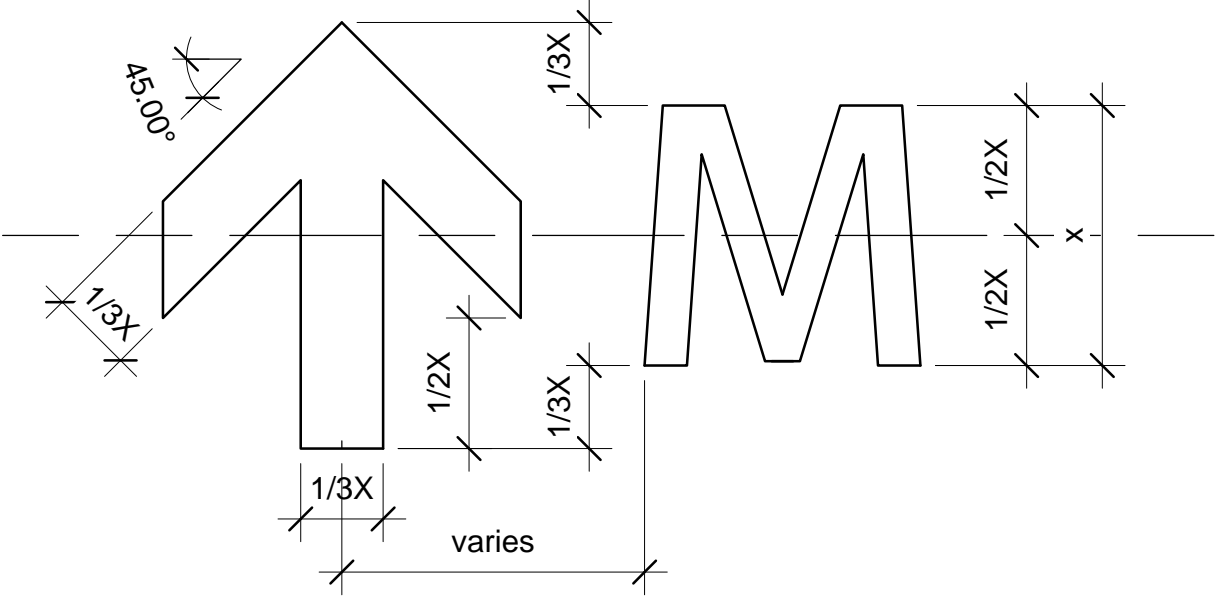


University of Victoria Logo, horizontal standard



University
of Victoria



University
of Victoria




University
of Victoria

full colour


opaque monochromatic

opaque monochromatic reversed




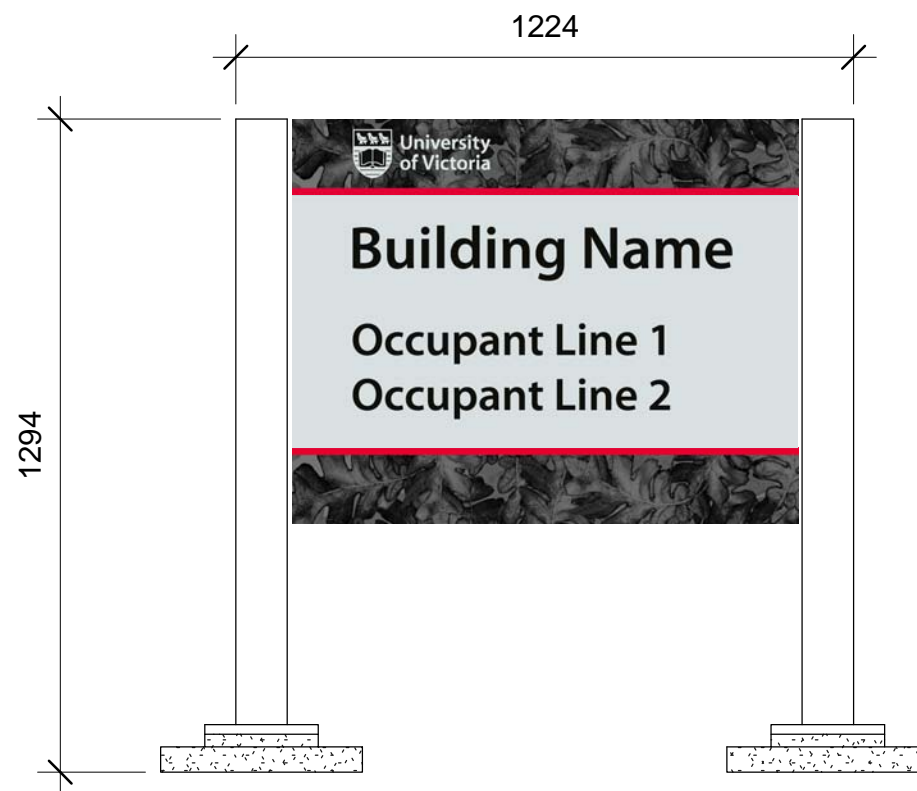


building name with occupant names
scale 1:15

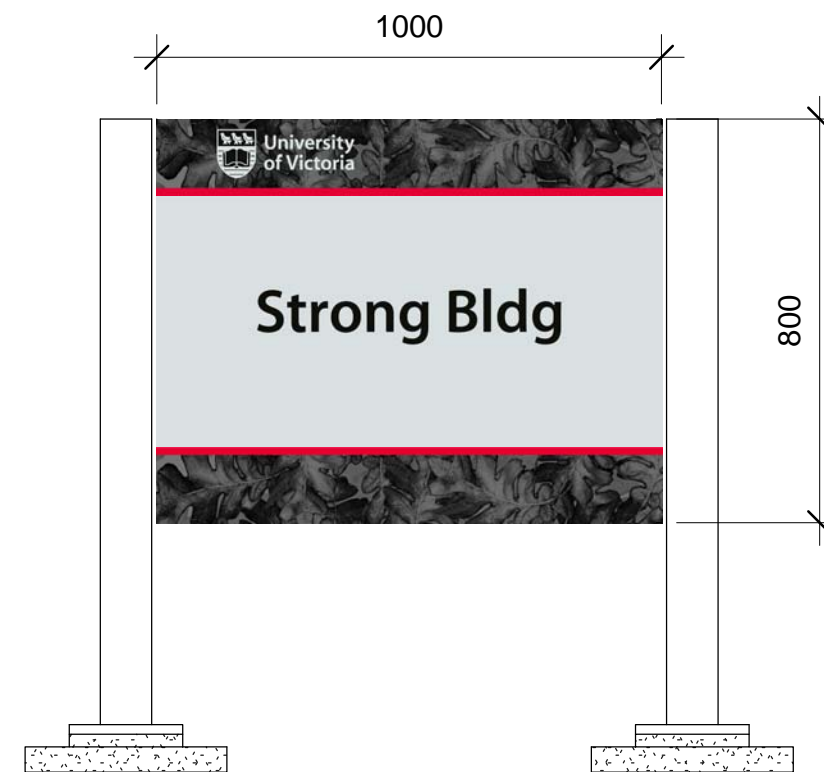


building name, text in one line
scale 1:15

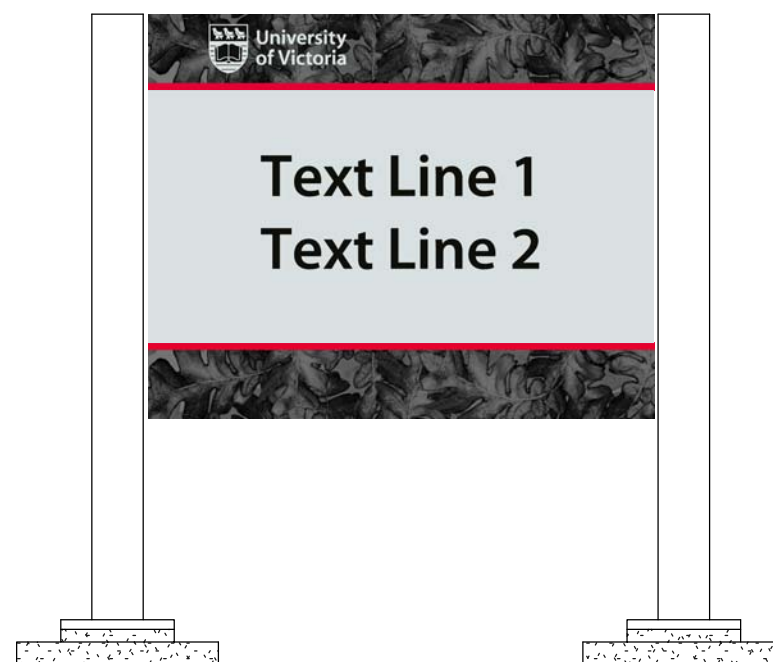

building name, text in two lines
scale 1:15

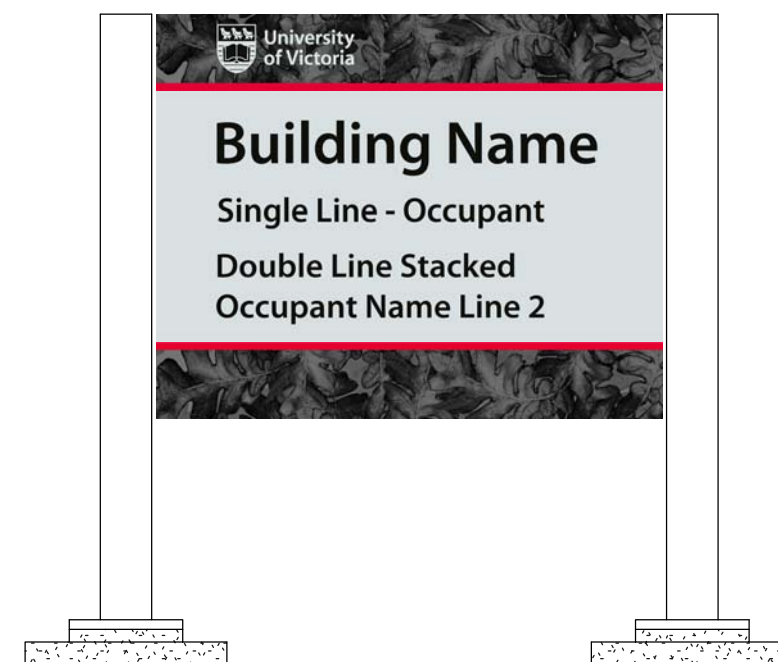

building name, text in two lines (double line stacked)
scale 1:15

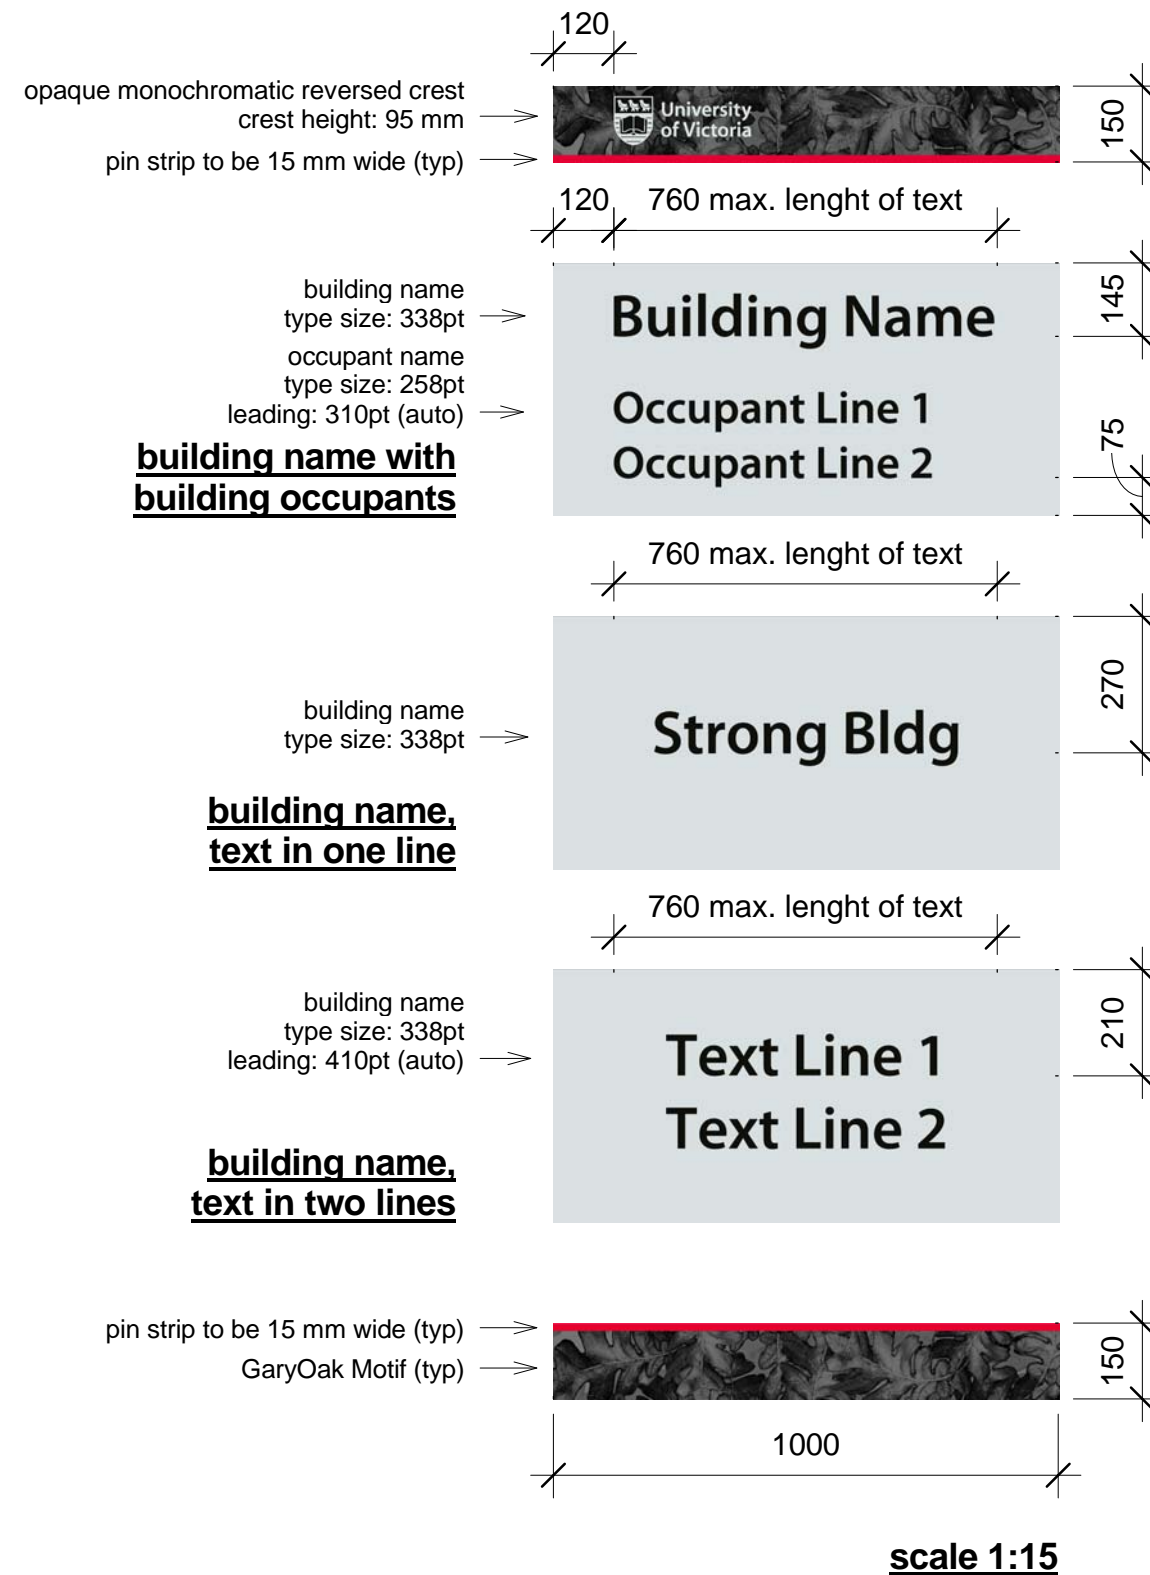


Description
Digitally printed vinyl protected with anti-graffiti, optically clear overlamine
Aluminum panel size (one piece): 1000 mm x 800 mm x 6.4 mm
See sheet 05 for details.

Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and overlaminate over the edges of the aluminum panel.
- 4) If single sided sign then back panel to receive vinyl printed with PANTEONE 7541 C

Refer to Adobe Photoshop files for detailed sample layout

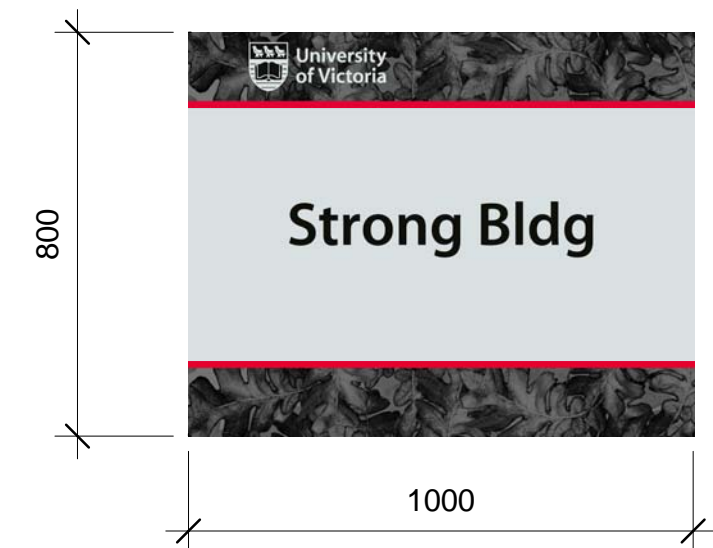


project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 3B - Building Identification
sheet name: sign design - graphic design details
scale: as noted

sheet number:


04

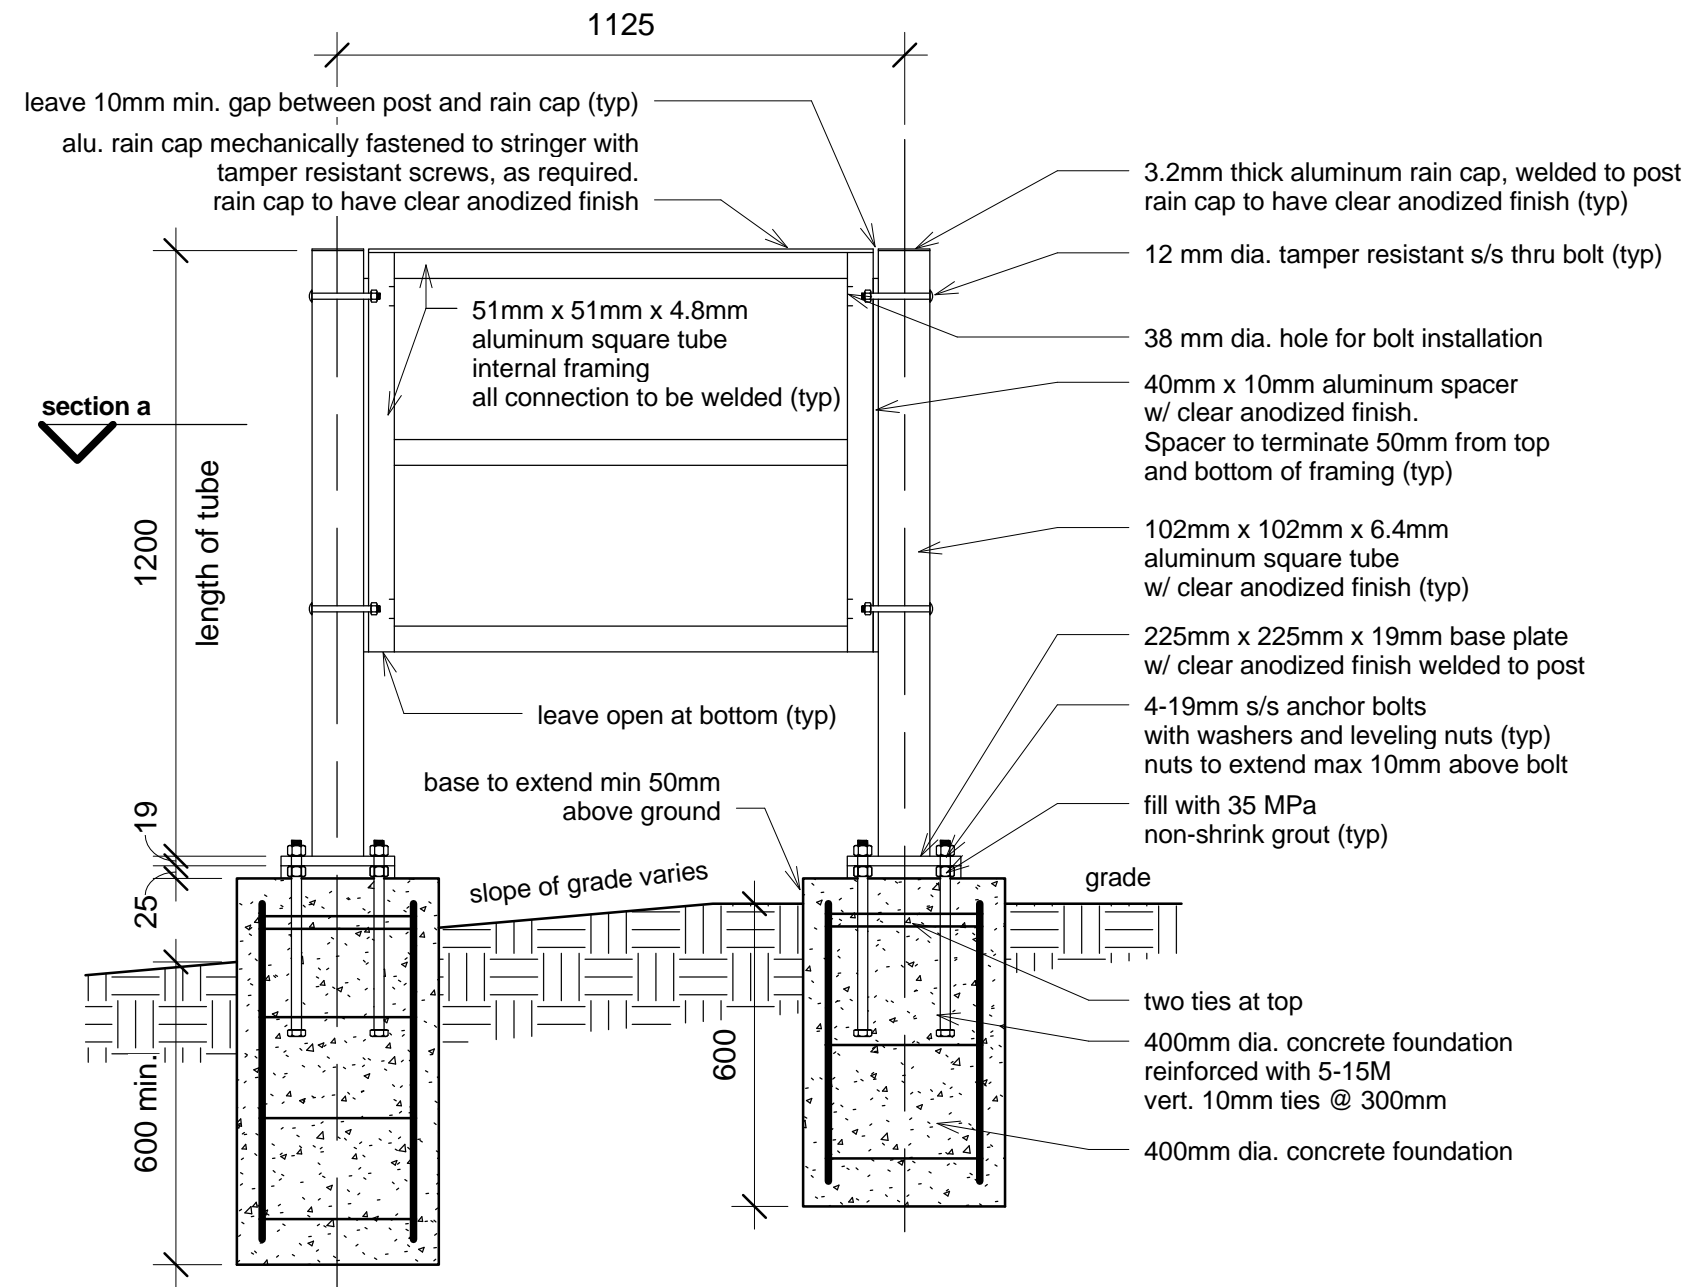

front view/section scale 1:15

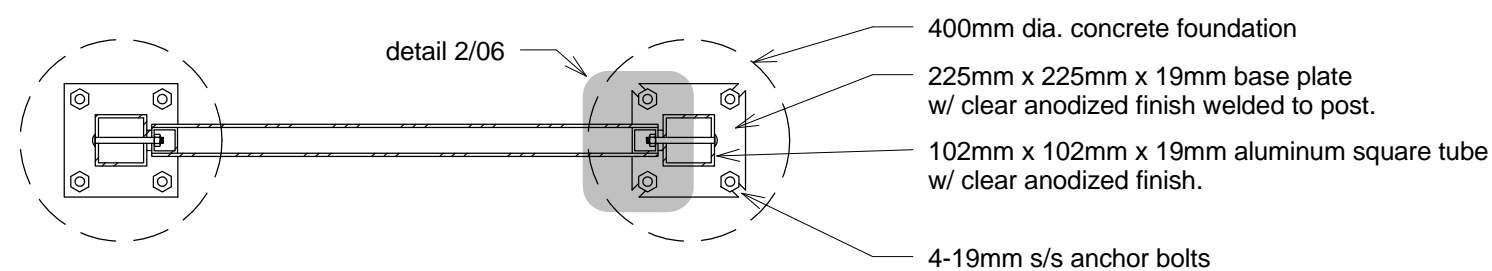


section a scale 1:15

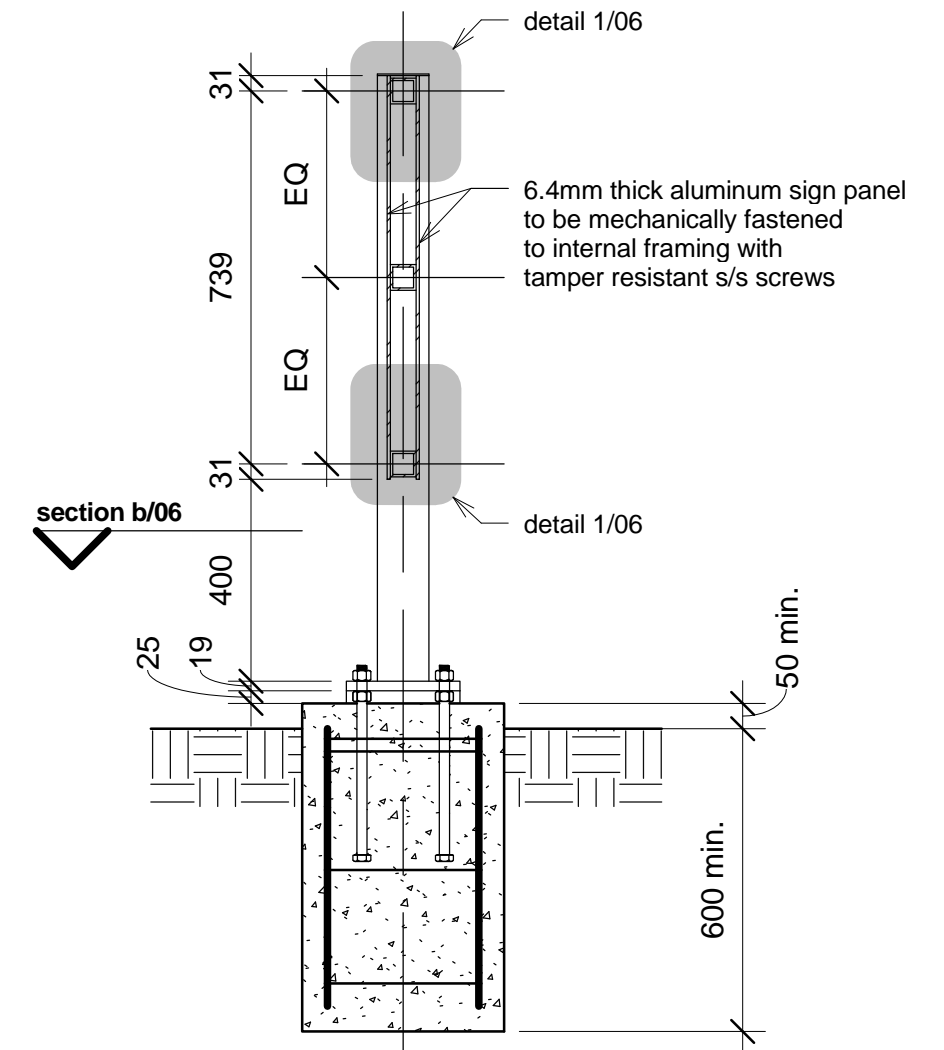


side view/section scale 1:15

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

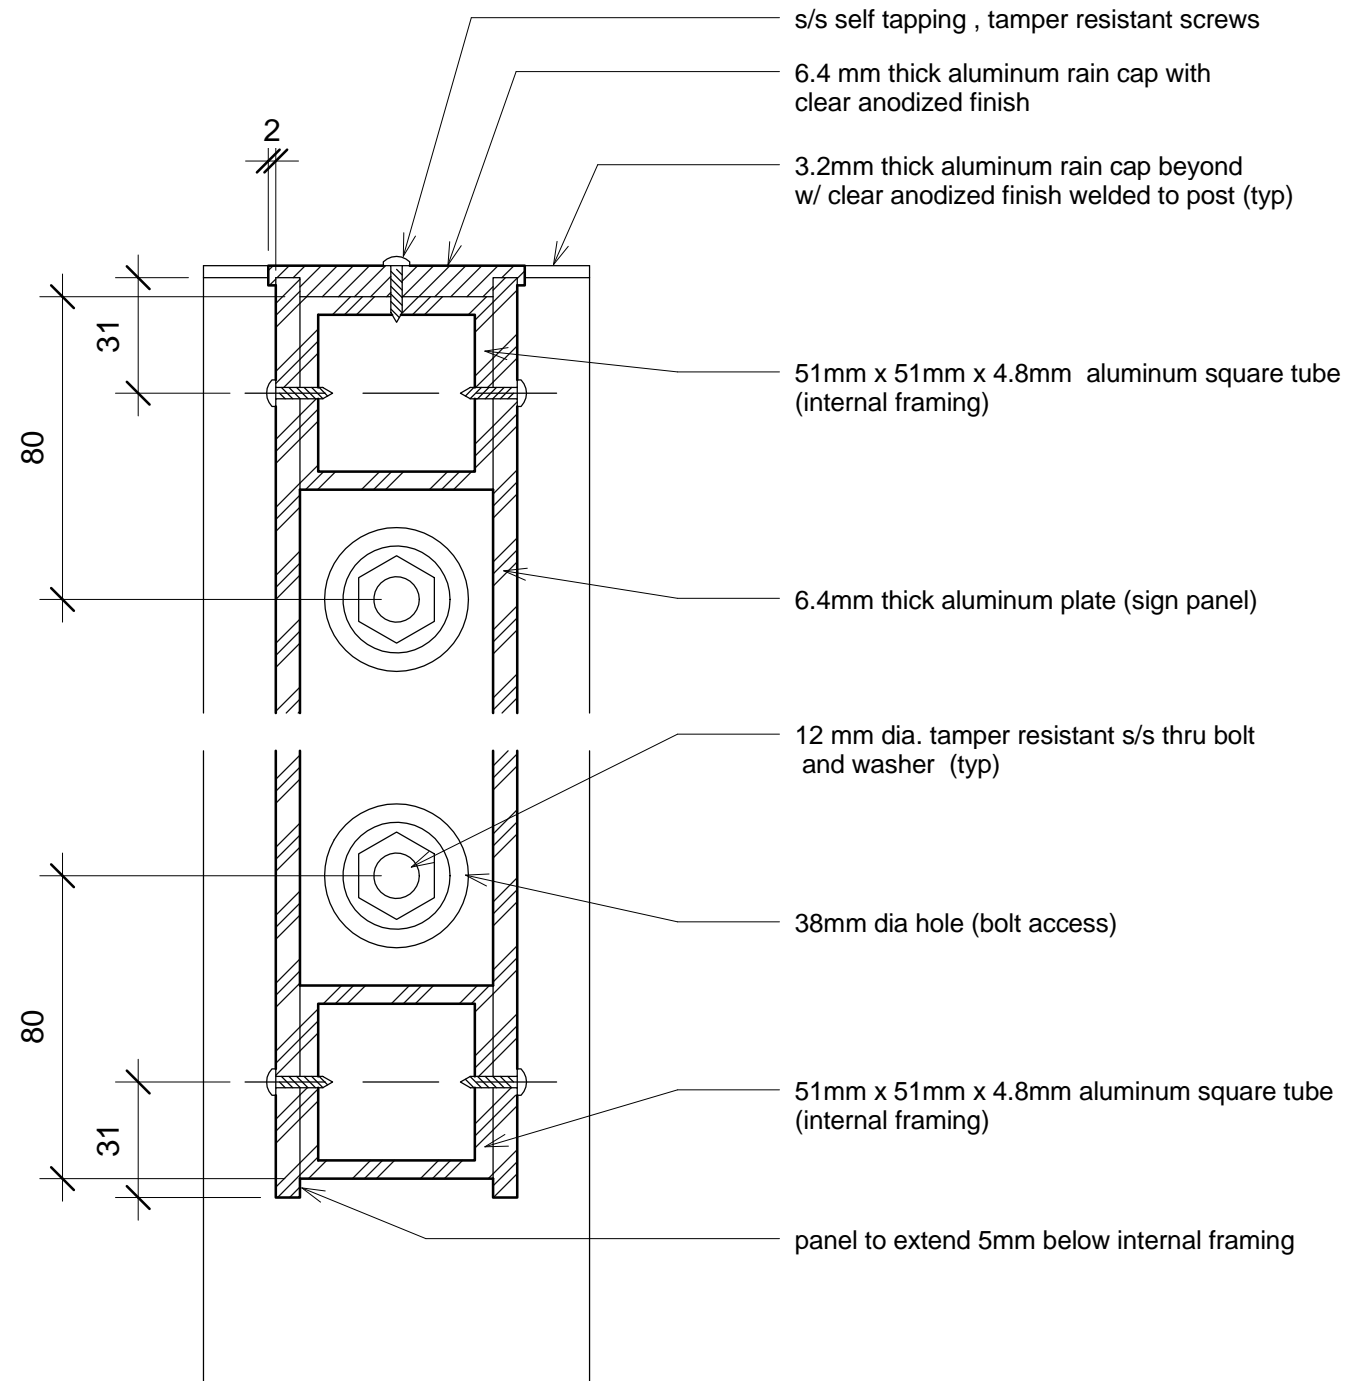


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section detail 1 scale 1:2

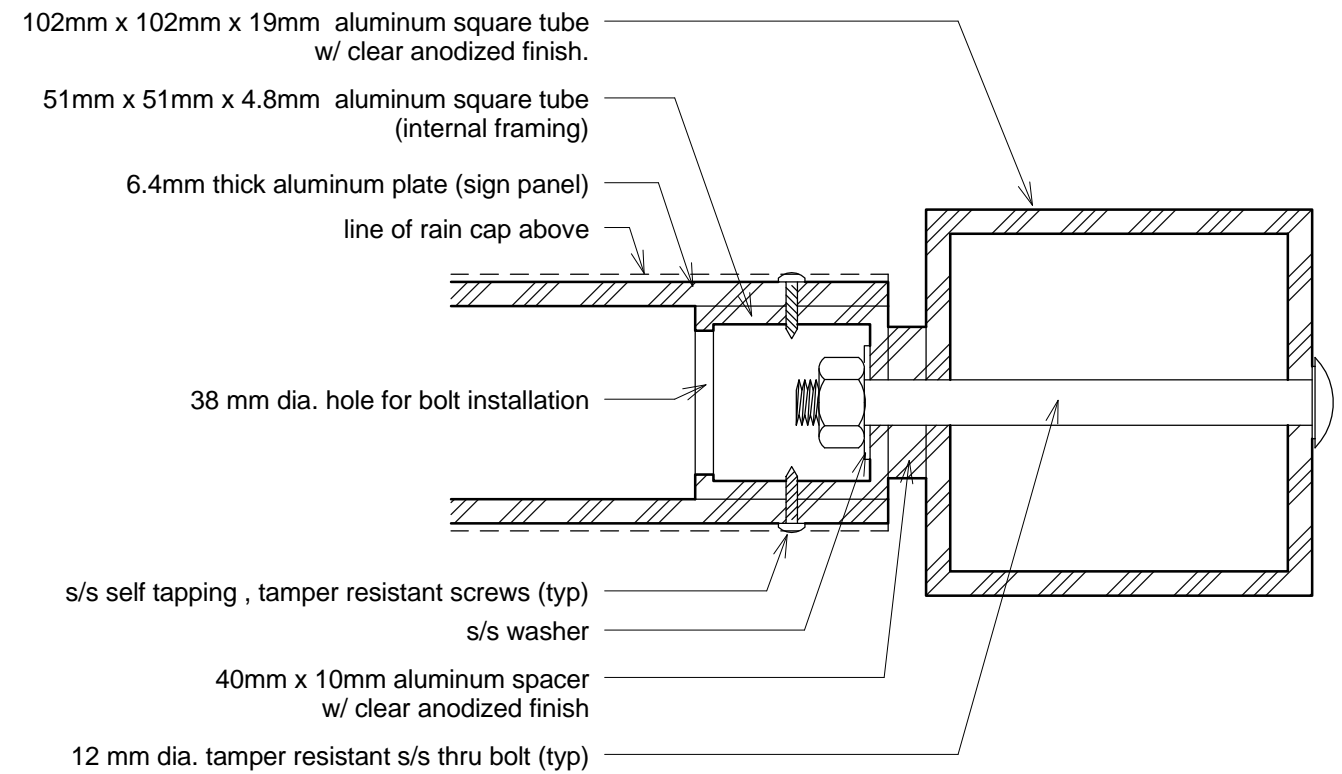

section detail 2 scale 1:2

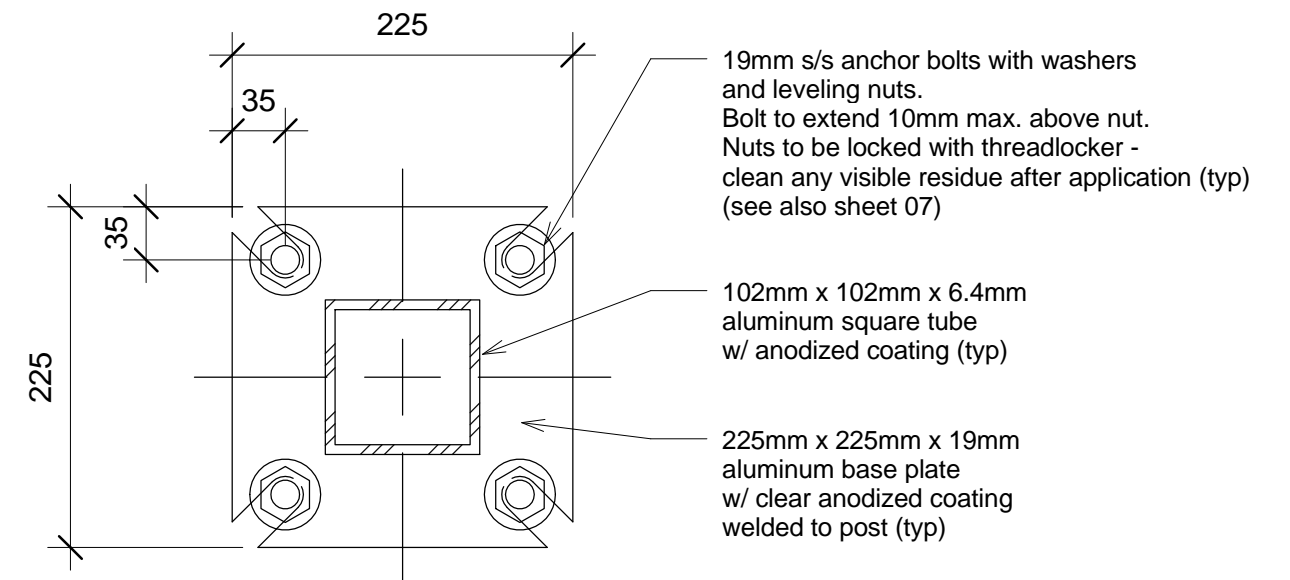

section b (slip base) scale 1:5

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 3B - Building Identification
sheet name: sign construction - details
scale: as noted

sheet
number:

06



**University
of Victoria**

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #174786 (1/2" s/s x 5" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
 - rain cap attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM


- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - overview - cont.
05	sign design - graphic design details
06	sign construction - cross section
07	sign construction - sections
08	sign construction - canopy plan and details (anodized)
09	sign construction - canopy plan and details (painted)
10	sign construction - details
11	general notes - structural and electrical

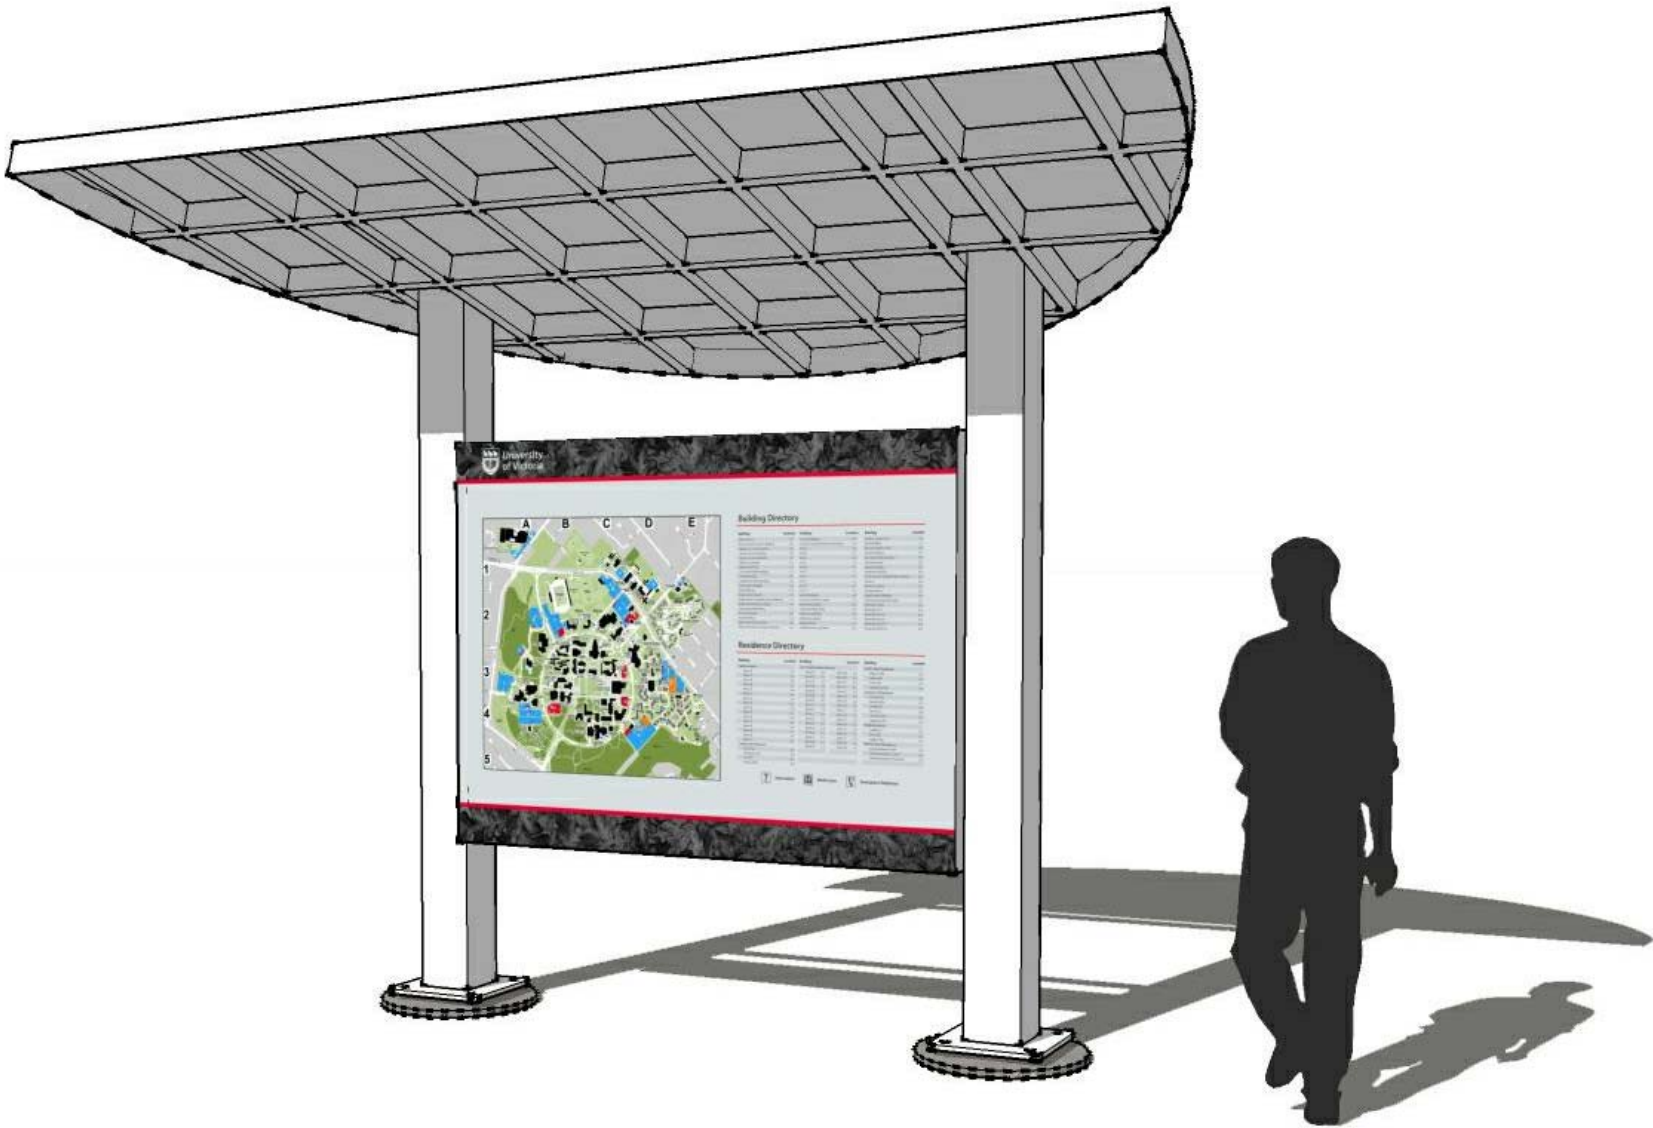


Sign No. 4 Vehicular - Map Directory Kiosk

core colours




clear anodized coating



PANTONE 185 C
pinstrip, arrows



PANTONE 426 C
text



PANTONE 7541 C
background, UVic Logo




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

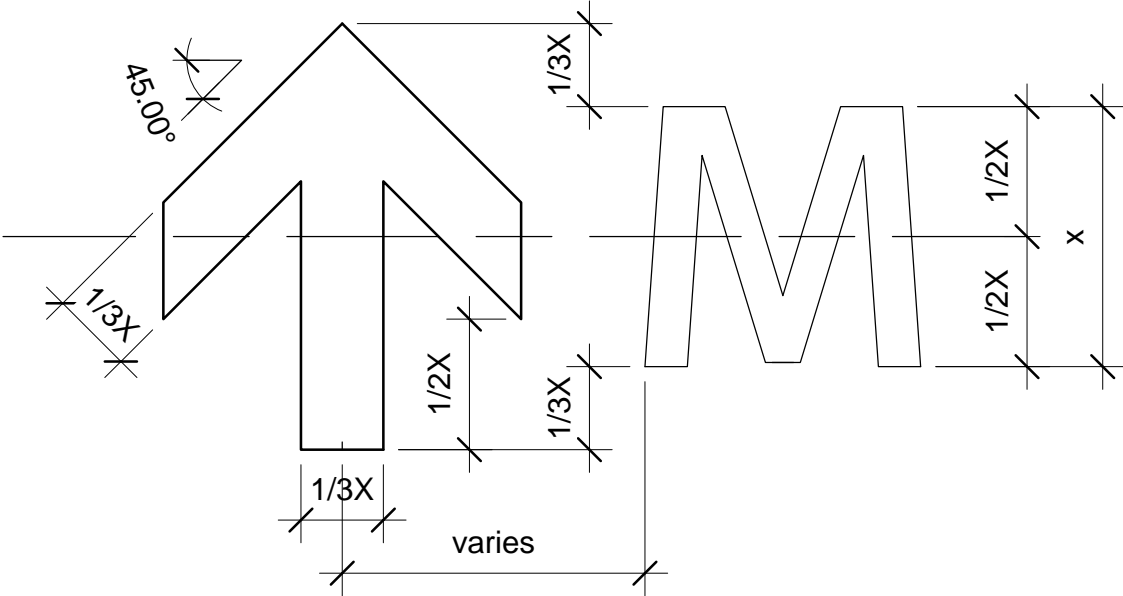


University of Victoria Logo, horizontal standard





University
of Victoria



University
of Victoria




University
of Victoria

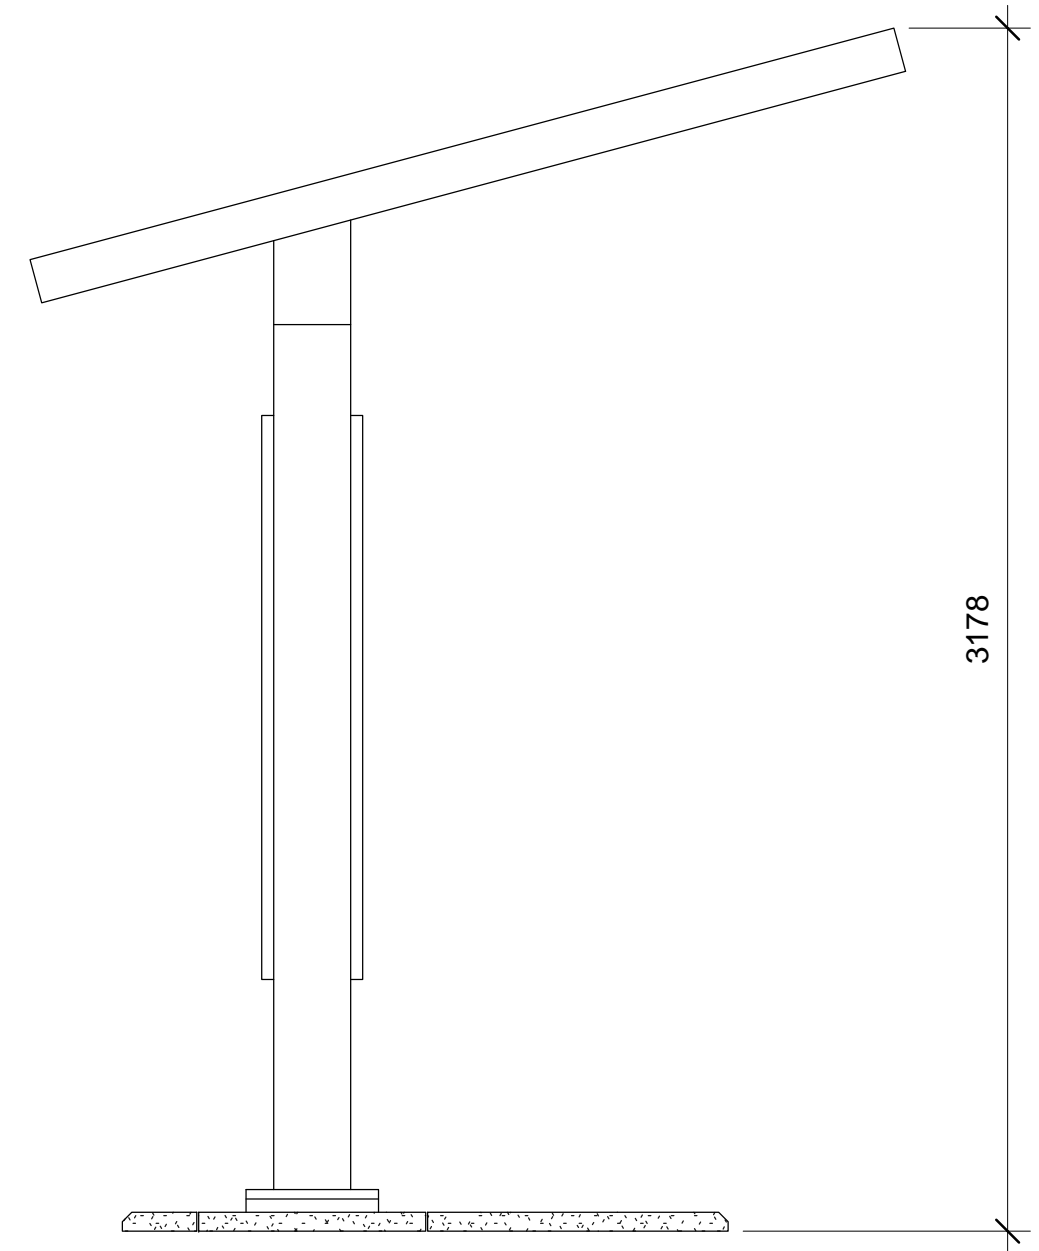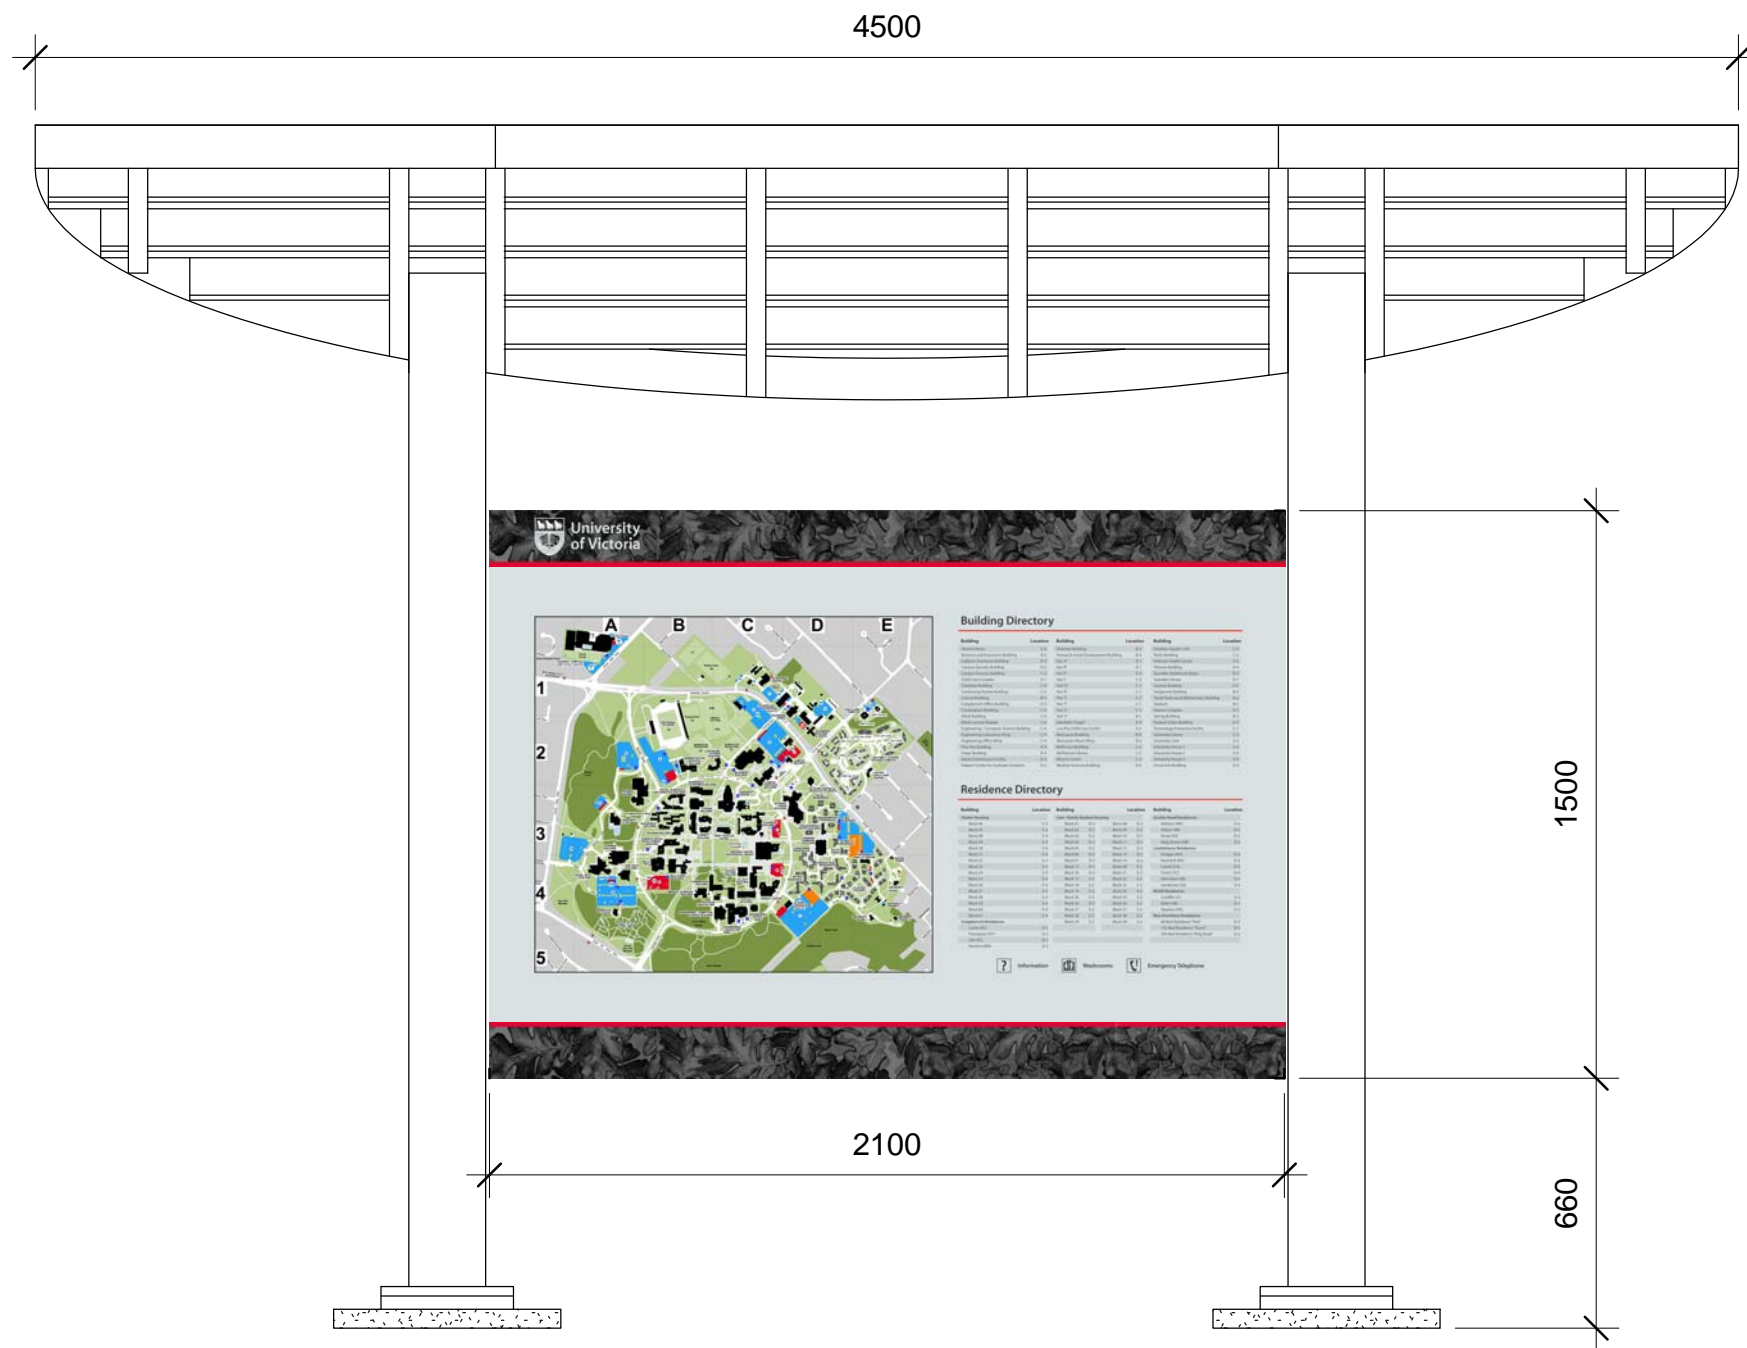




back elevation scale 1:20

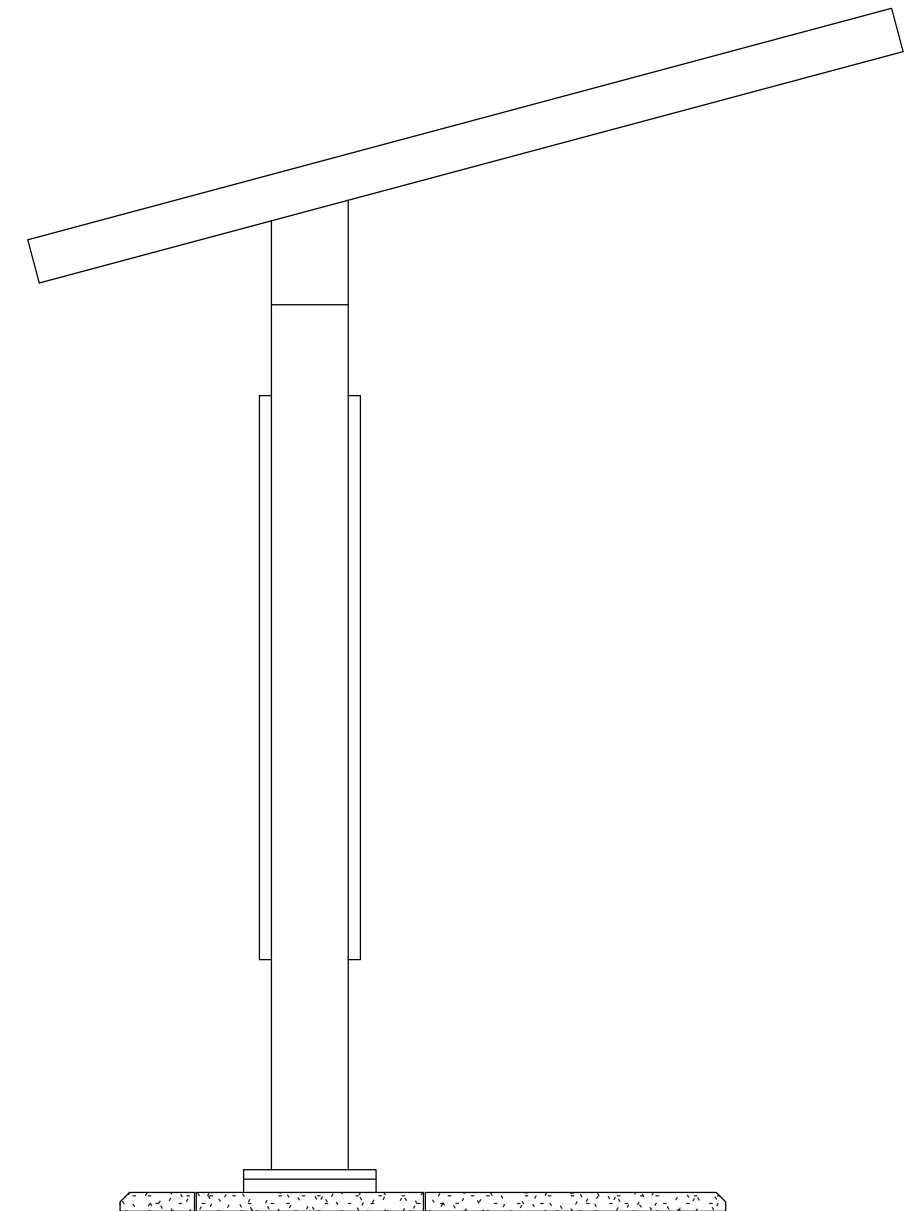


side elevation scale 1:20

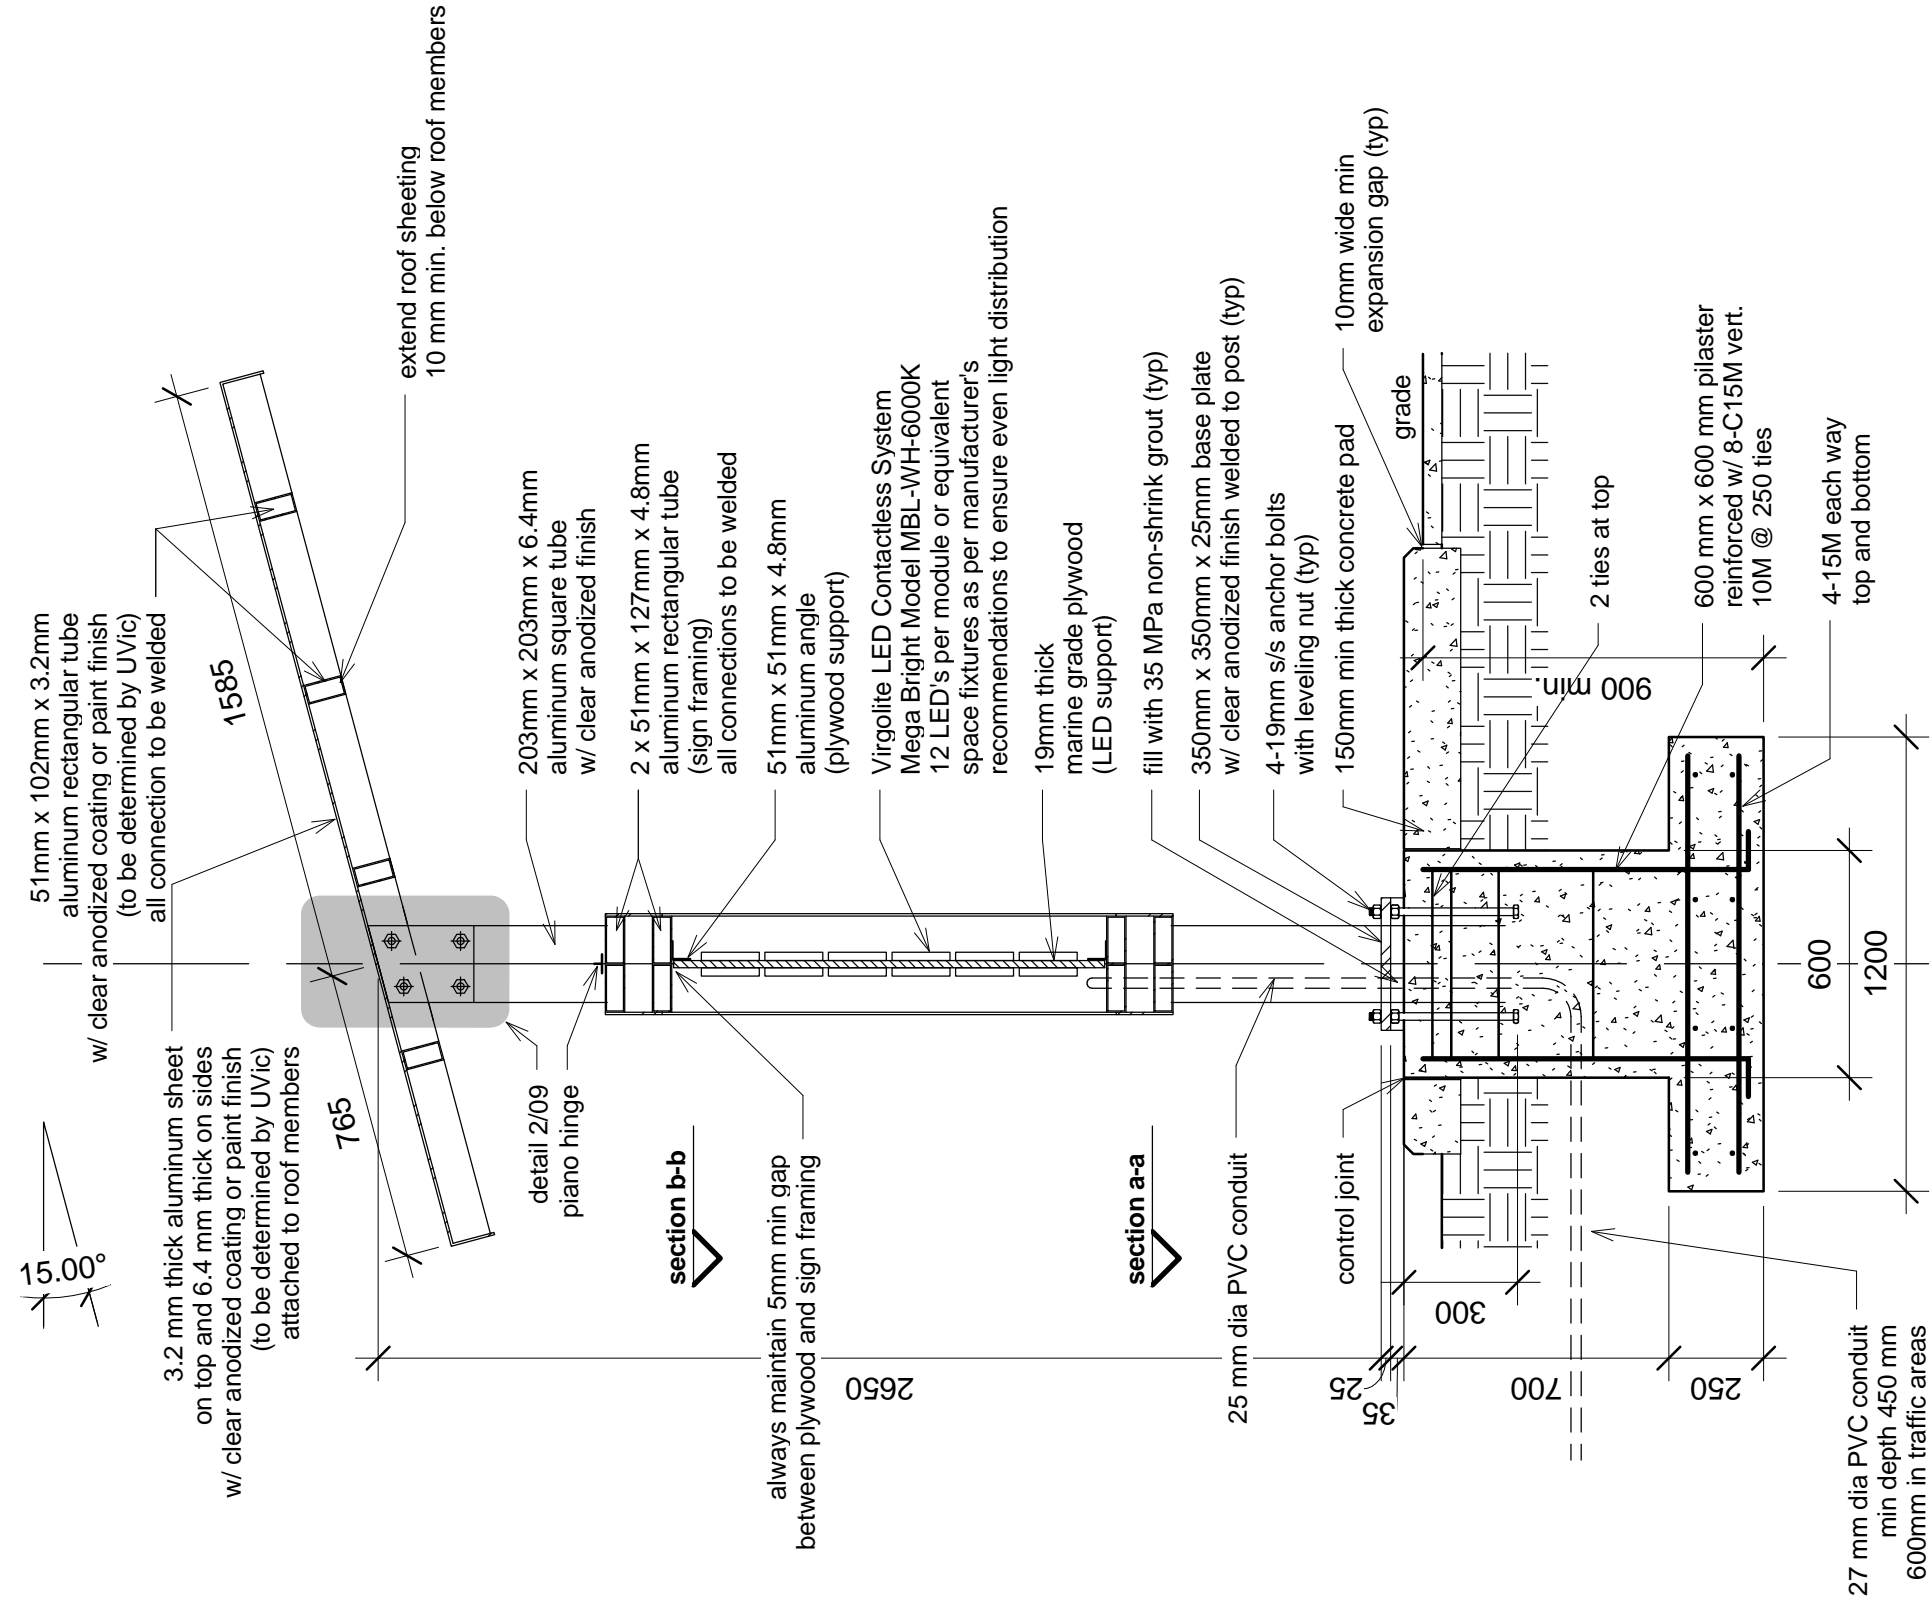


- 1) provide ventilation holes as required
- 2) Leltek Virgolite LMPS -750 power supply to provide source of power to a maximum of 50 MegaBright 12 LED Modules
- 3) Sign must have a CSA label as an assembly

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

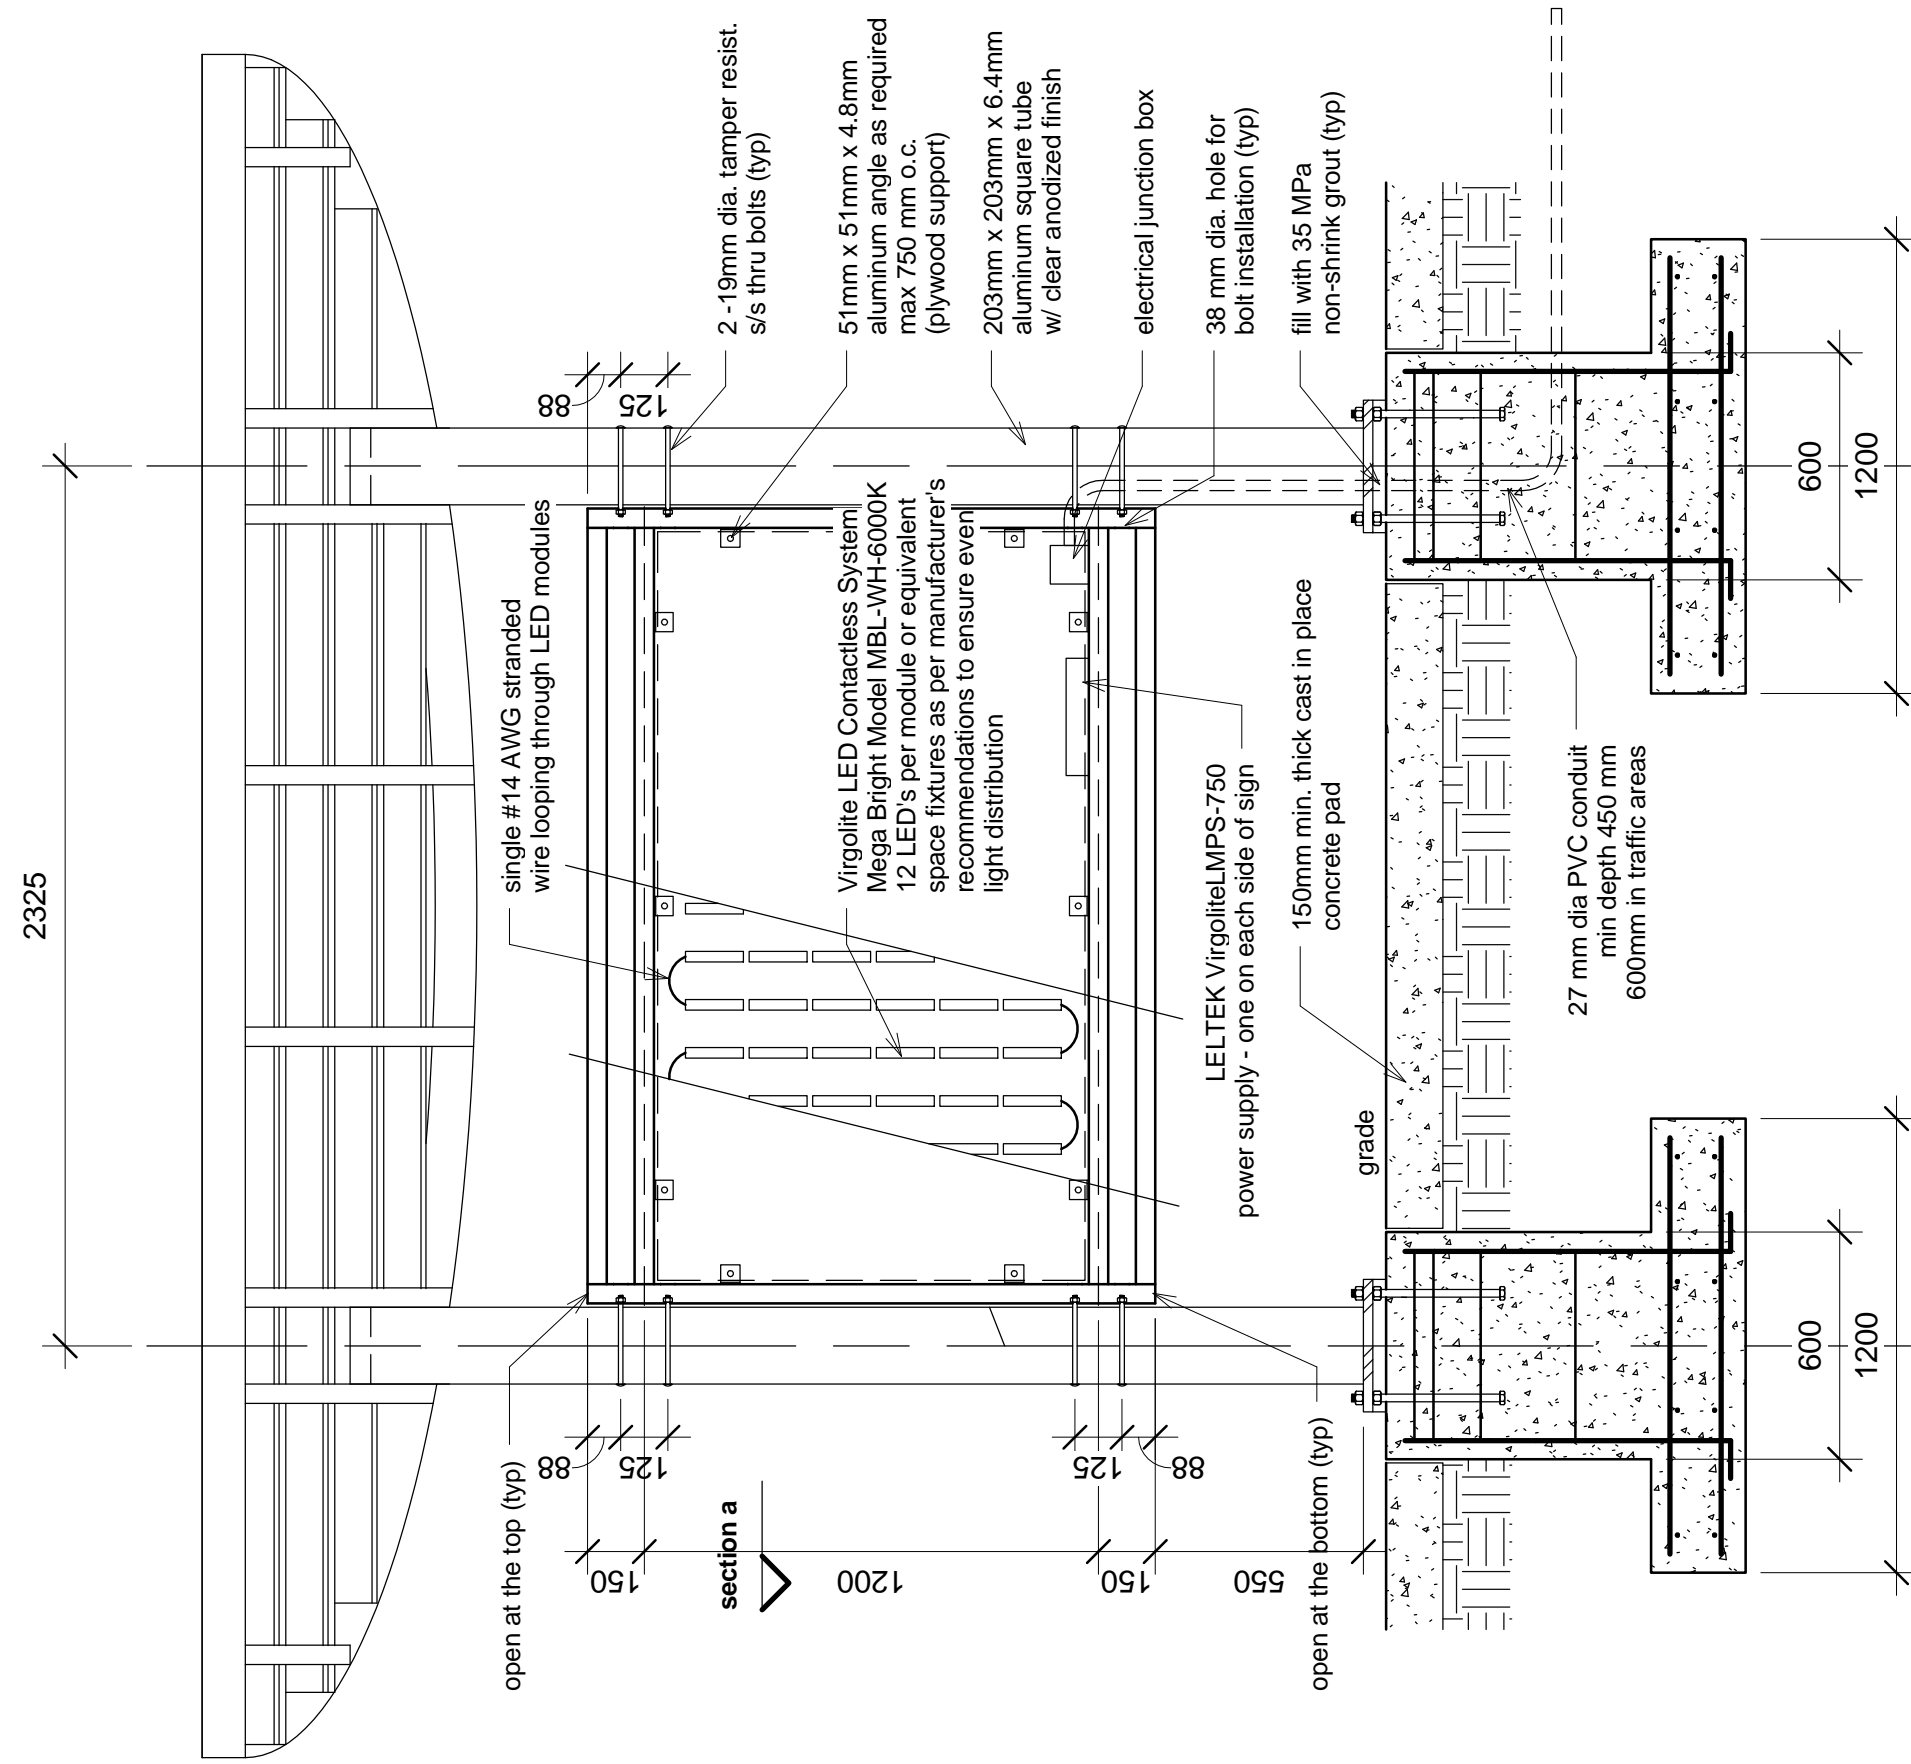


long section scale 1:20

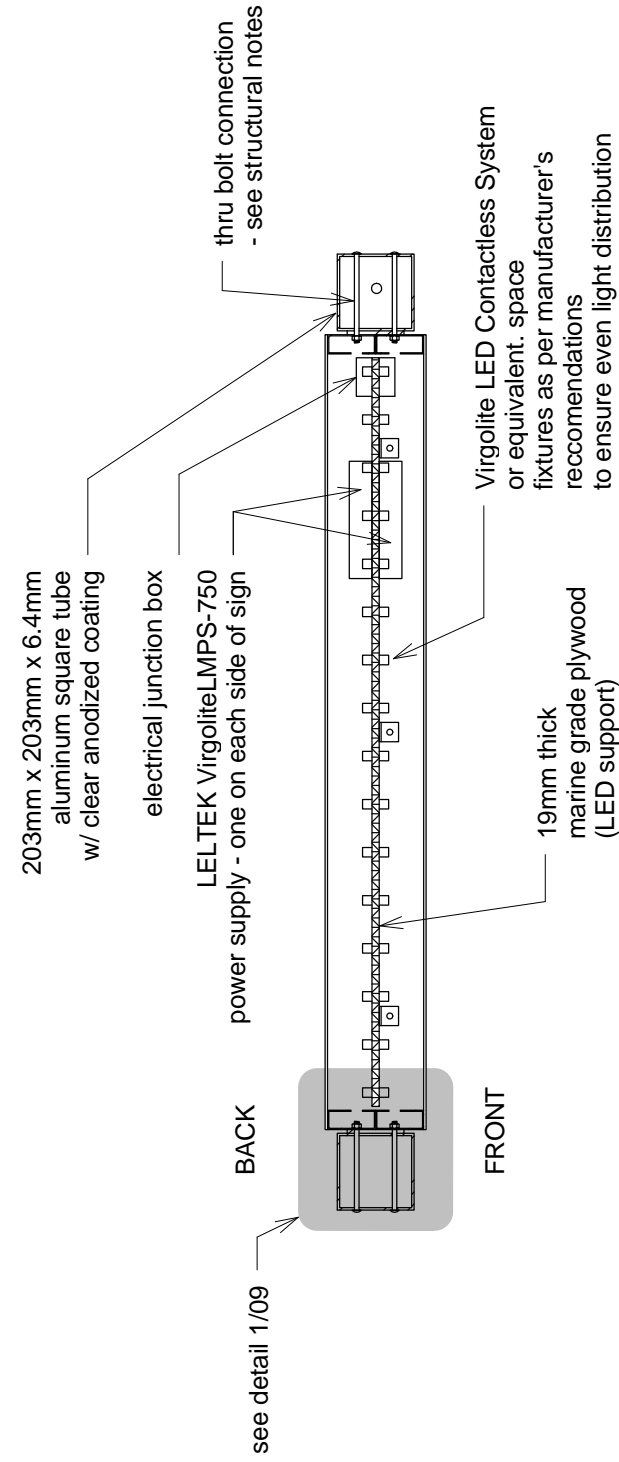


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section a scale 1:20

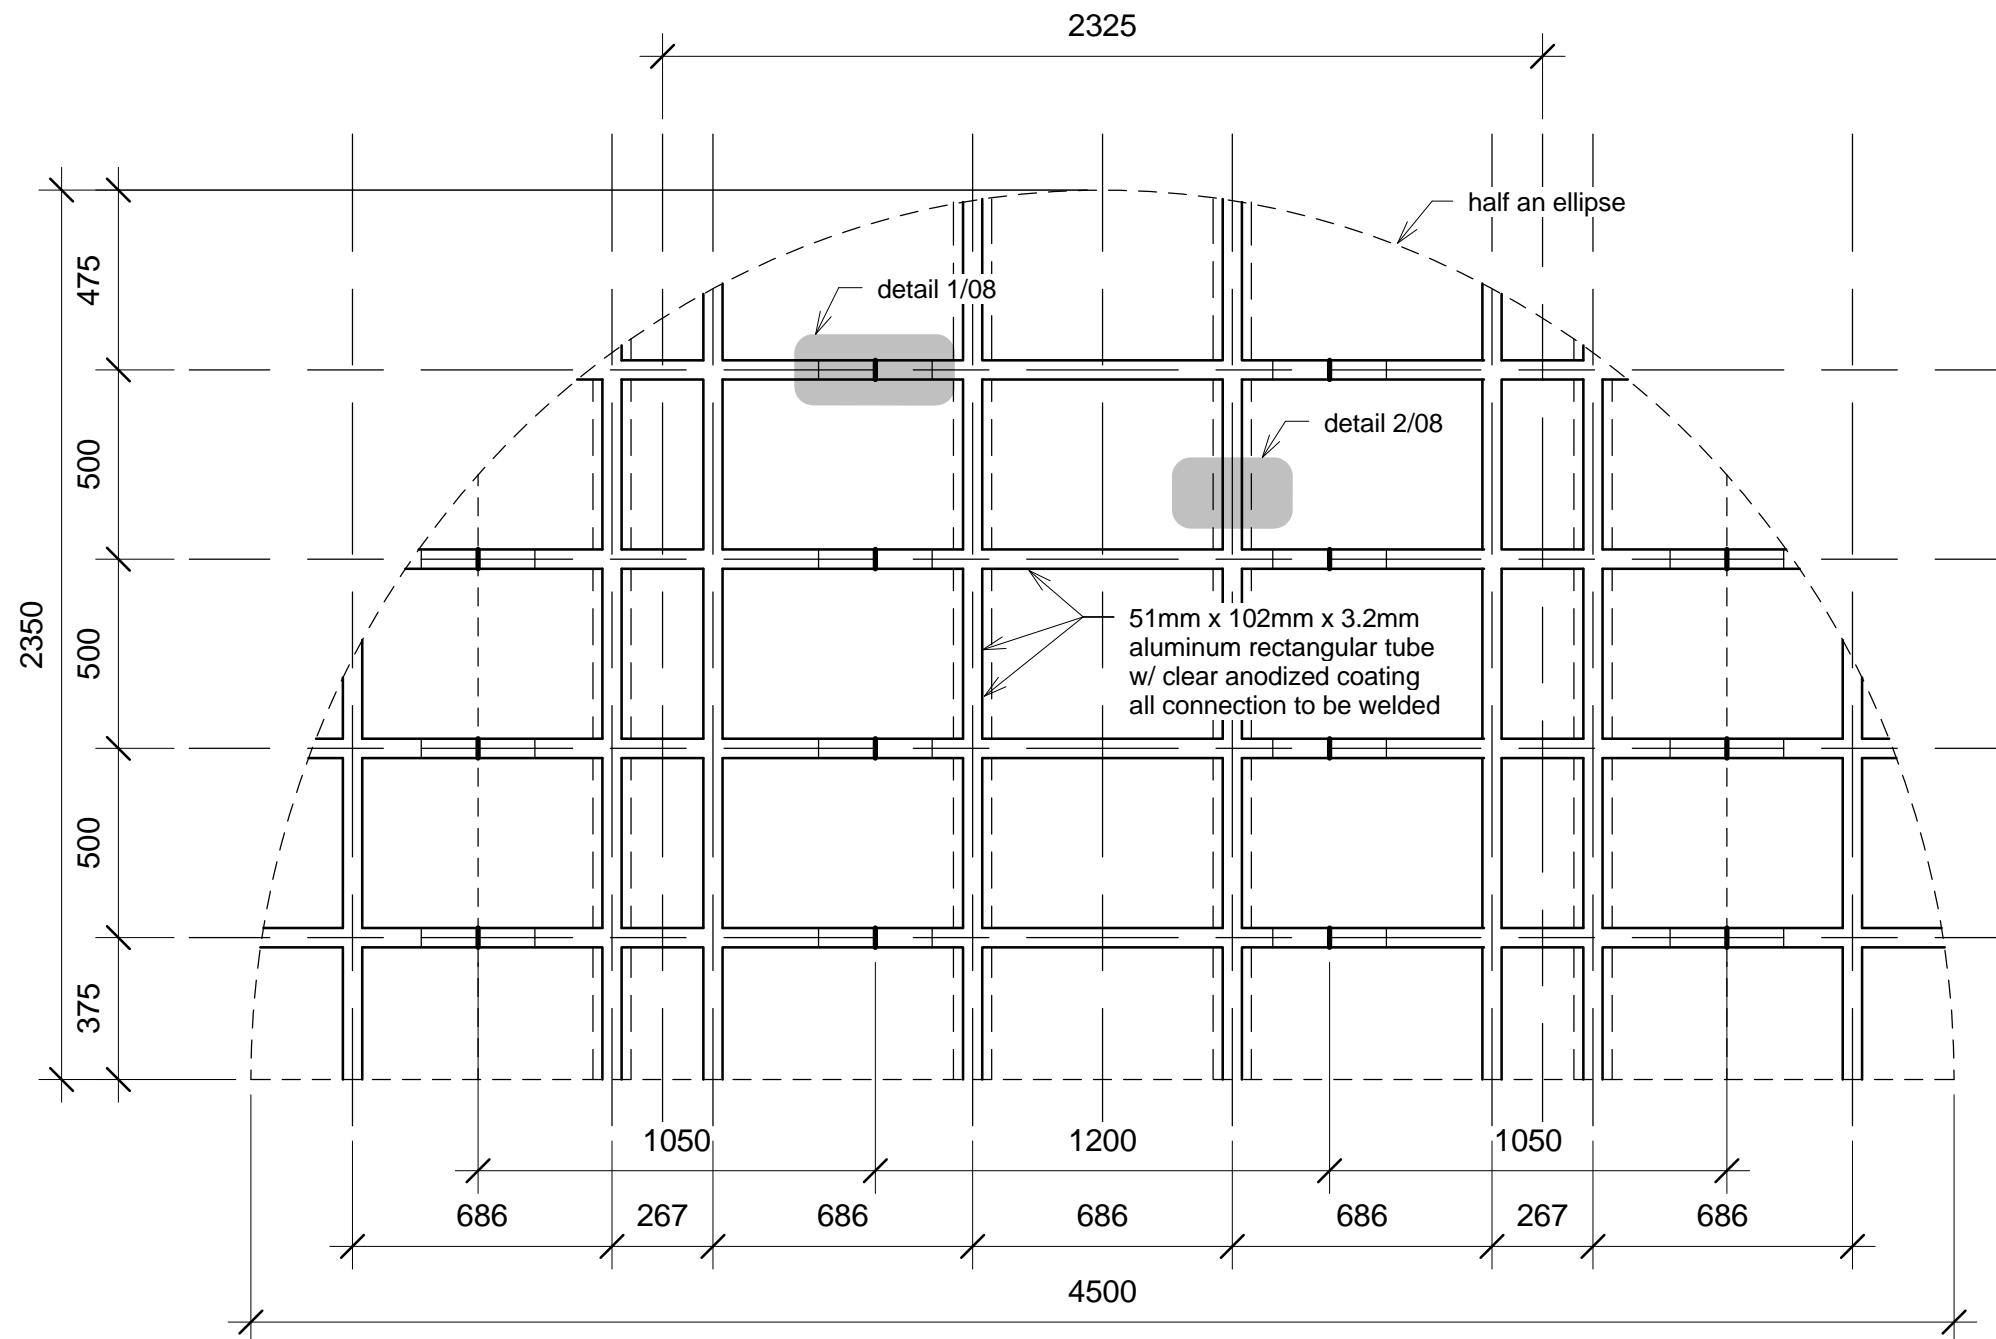


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

canopy (anodized finish option)
plan scale 1:20

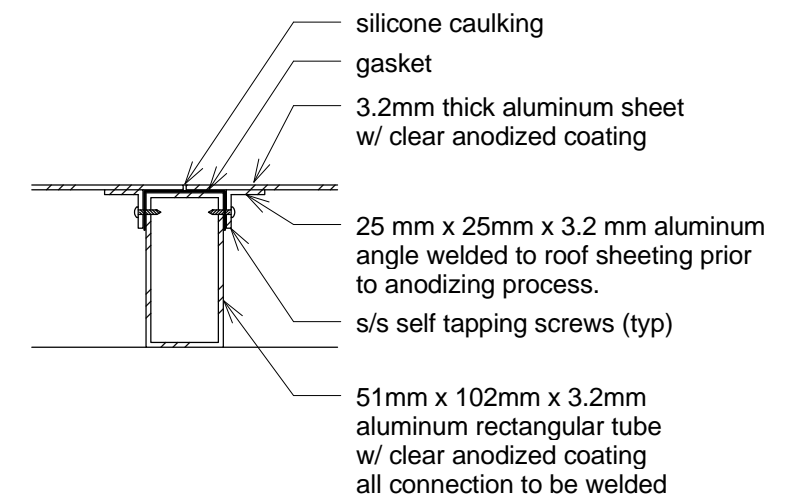

detail 2 scale 1:5

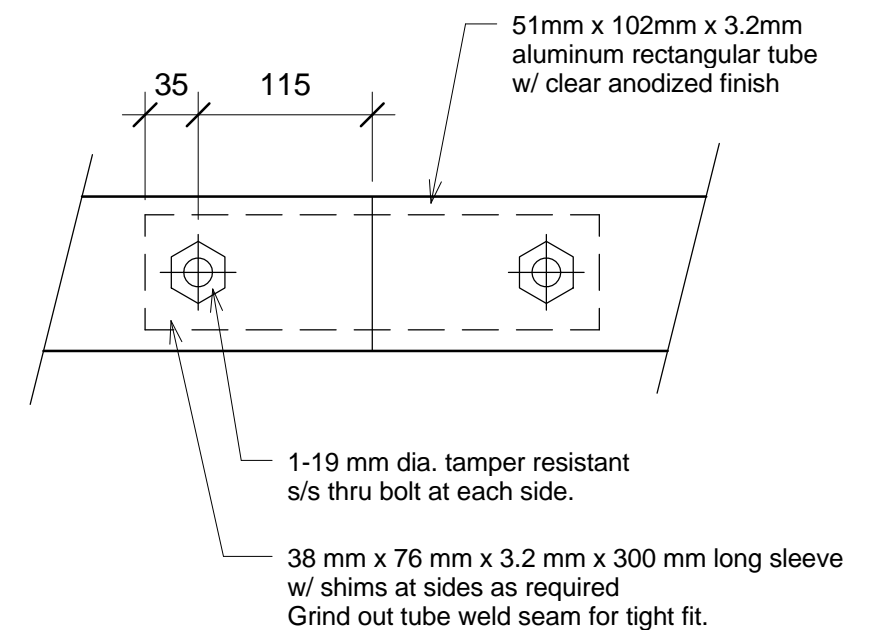

detail 1 (side view) scale 1:5

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 4 -Vehicular Map Directory Kiosk
sheet name: sign construction - canopy plan and details (anodized)
scale: as noted

sheet
number:

08



University
of Victoria

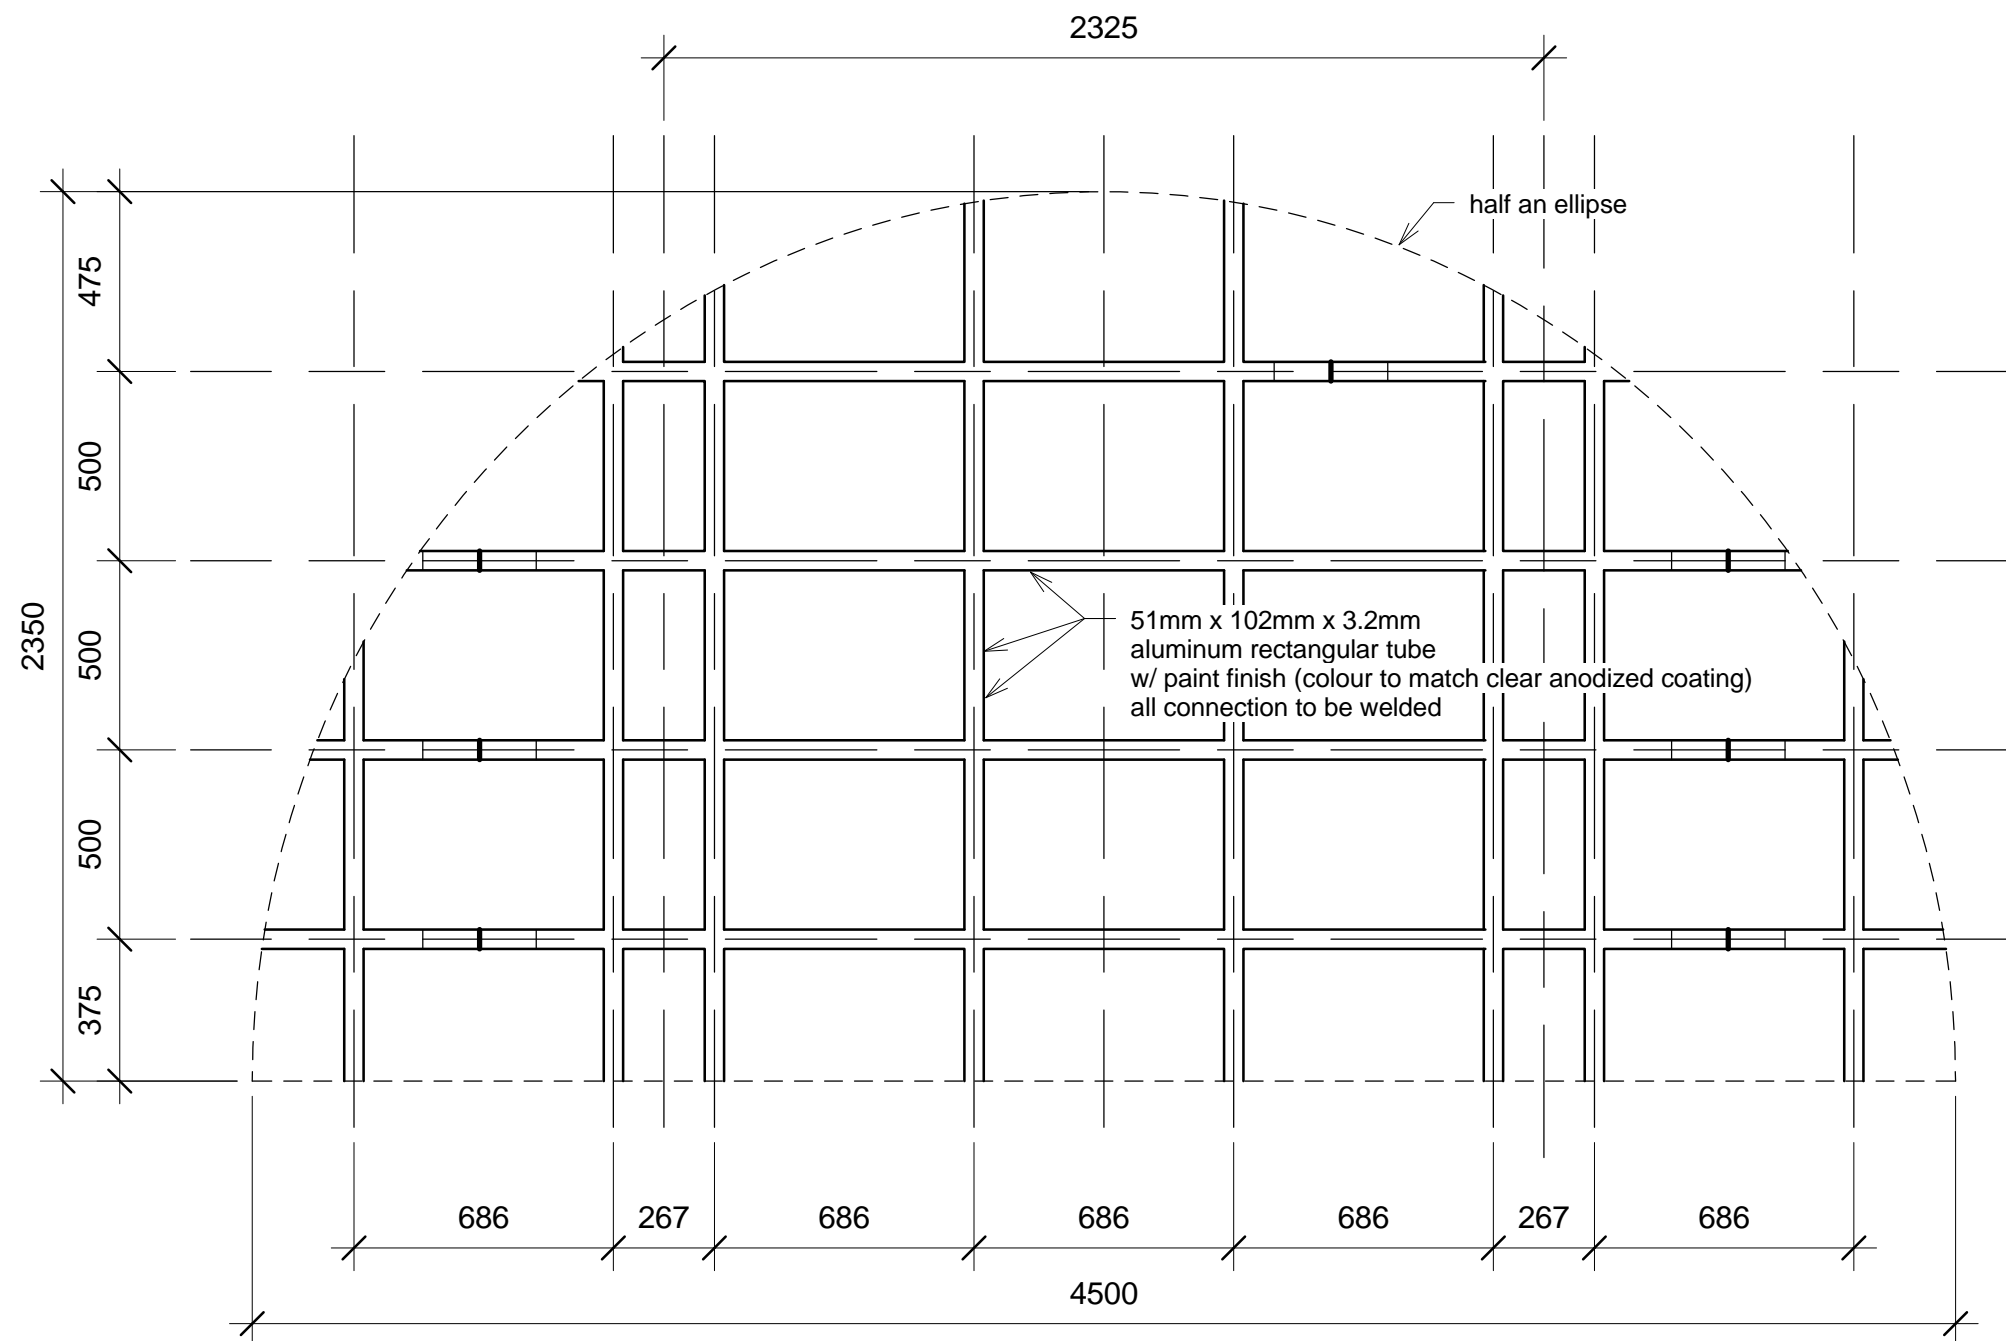

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

canopy (paint finish option)
plan scale 1:20

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 4 -Vehicular Map Directory Kiosk
sheet name: sign construction - canopy plan and details (painted)
scale: as noted

sheet
number:


09



**University
of Victoria**

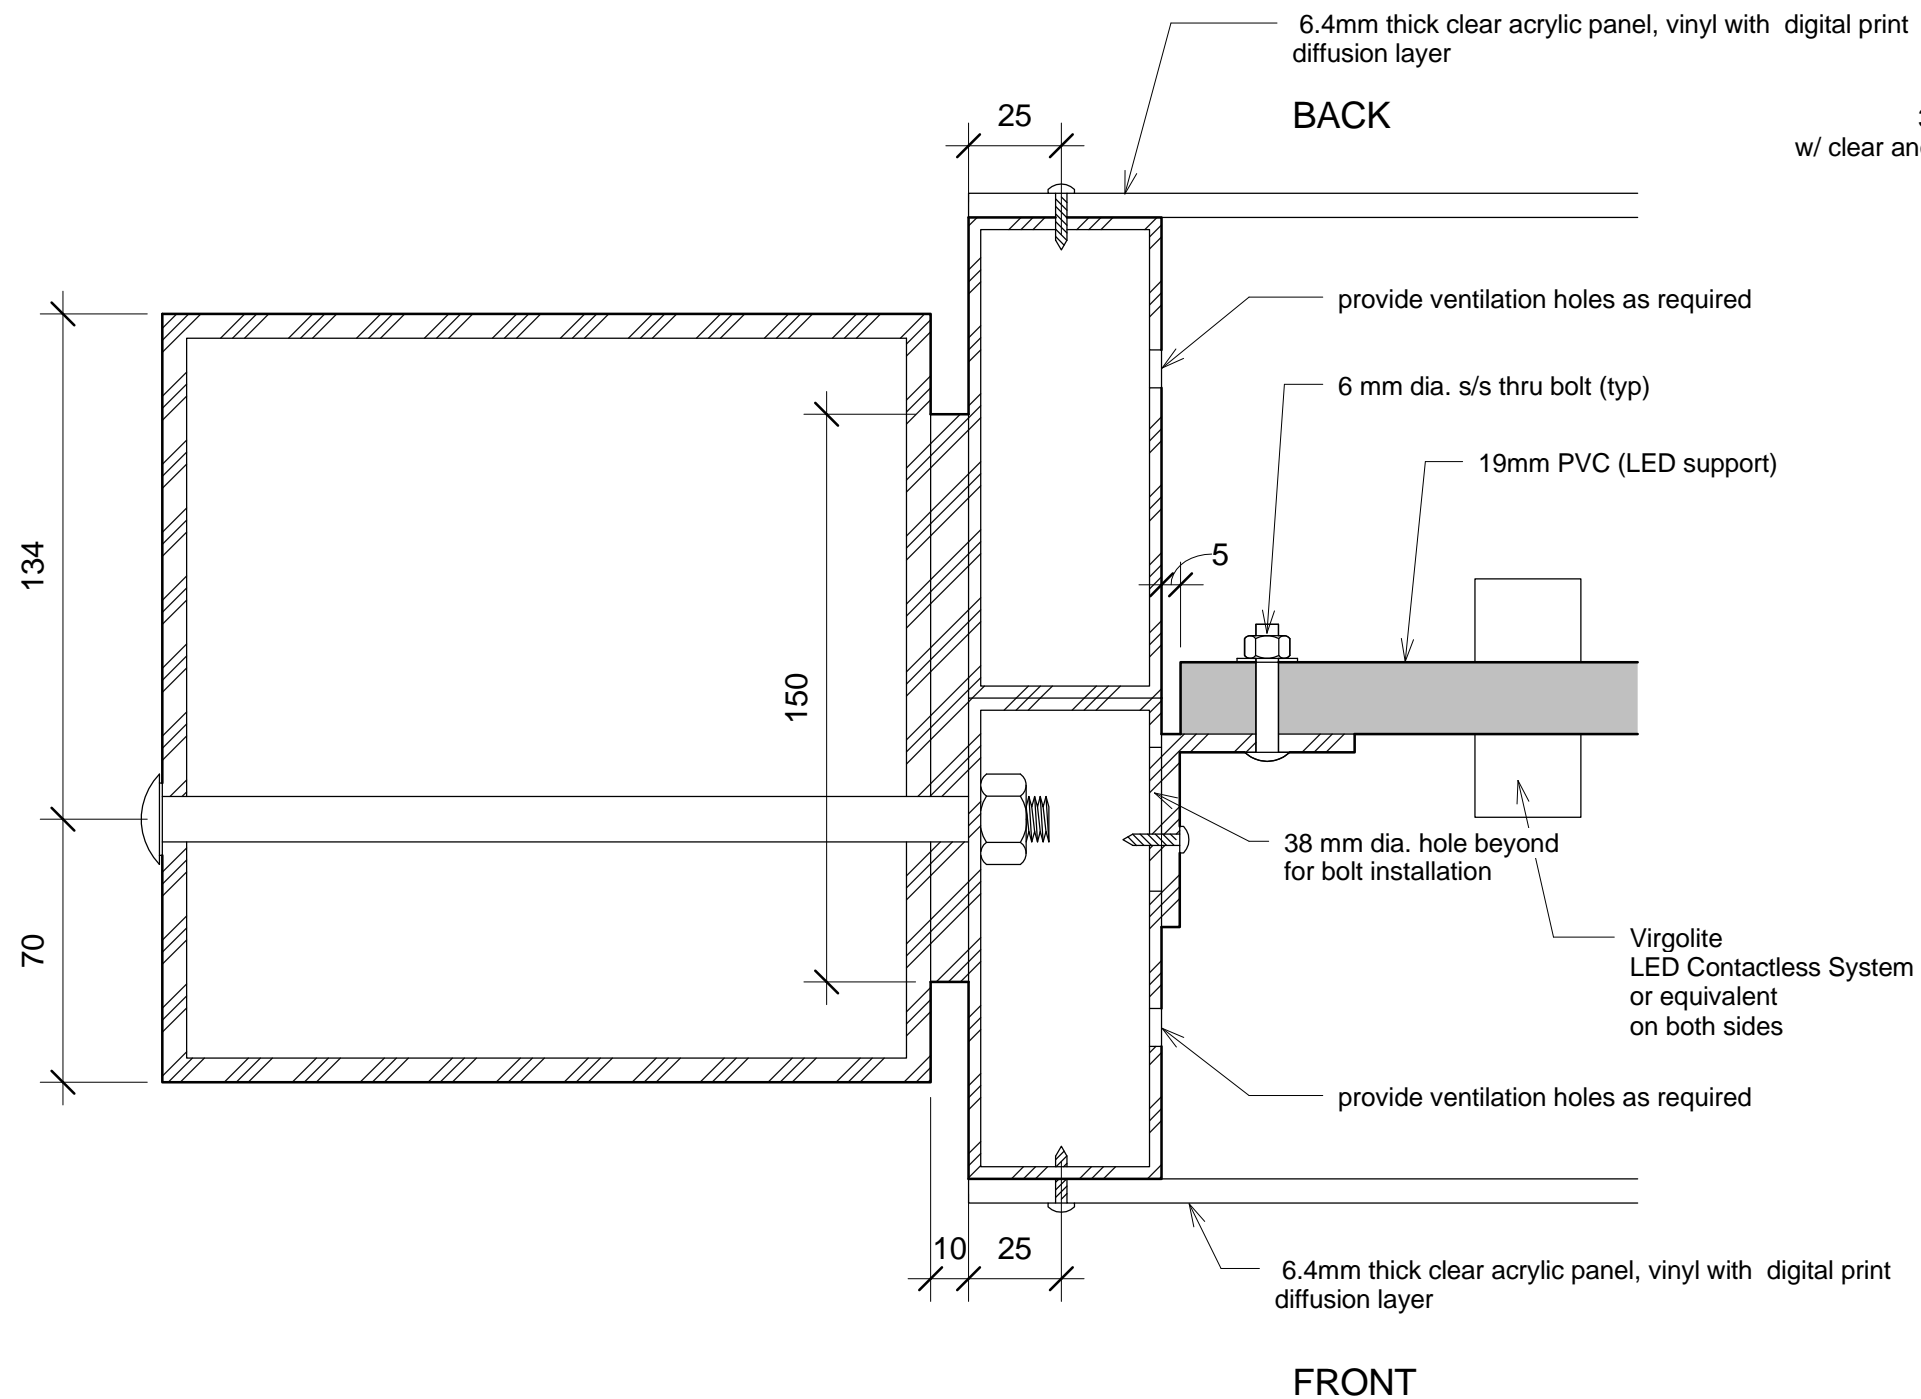

plan detail 1 scale 1:2

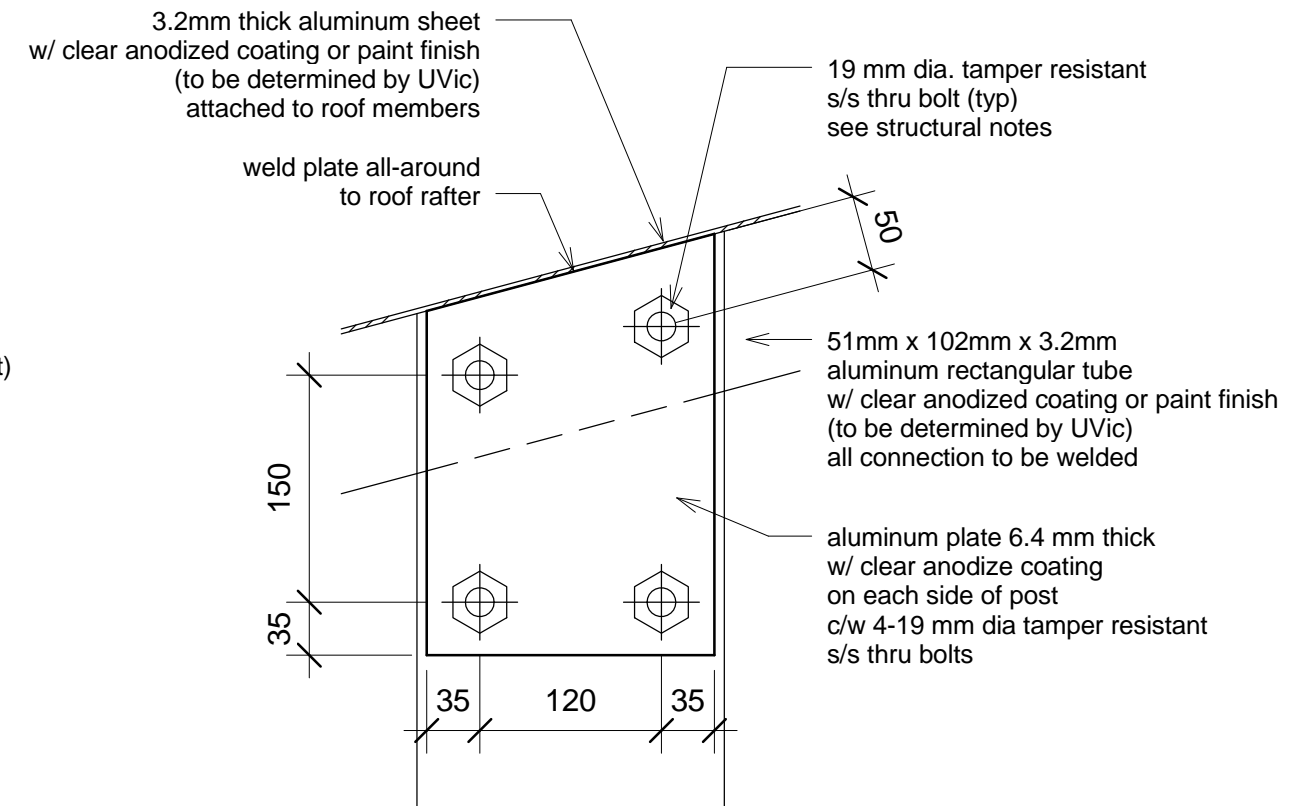

detail 2 scale 1:5

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: $q_{50}=0.63\text{kPa}$, $I_w=1.0\text{-ULS}$, 0.75-SLS .

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of $23\pm1\text{ kn/m}^3$ ($145\pm5\text{ pcf}$) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL NOTES (cont)

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant "Torx-Pin" screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be "Pentagon" tamper resistant bolts, with "Pentagon" nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with "Pentagon" security nuts.

ELECTRICAL NOTES

- 1. Signs must be provided with CSA label
- 2. LED modules, power supplies, cable, wire and junction box must be integral with signs
- 3. All electrical installations to be done in accordance with the Canadian Electrical Code and as recommended by the LED lighting manufacturer.
- 4. Run 2#8 +GND conductors in 27mm PVC conduit from sign to existing campus exterior lighting pole standard. Intercept existing underground conduit, install an H20 rated flush junction box with bolt-on cover and splice into exterior lighting circuit.
- 4. The sign manufacturer shall provide an electrical shop drawings indicating input power requirements and a schematic wiring diagram for the sign.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - general information
06	structural an electrical general notes

project:

Campus Wayfinding

number:

FM 09-8567

issue date:

Jan 31, 2012

sign:

Sign No. 5 - Digital Message Board

sheet name:

title sheet and drawing list


scale:

as noted

sheet

number:

01

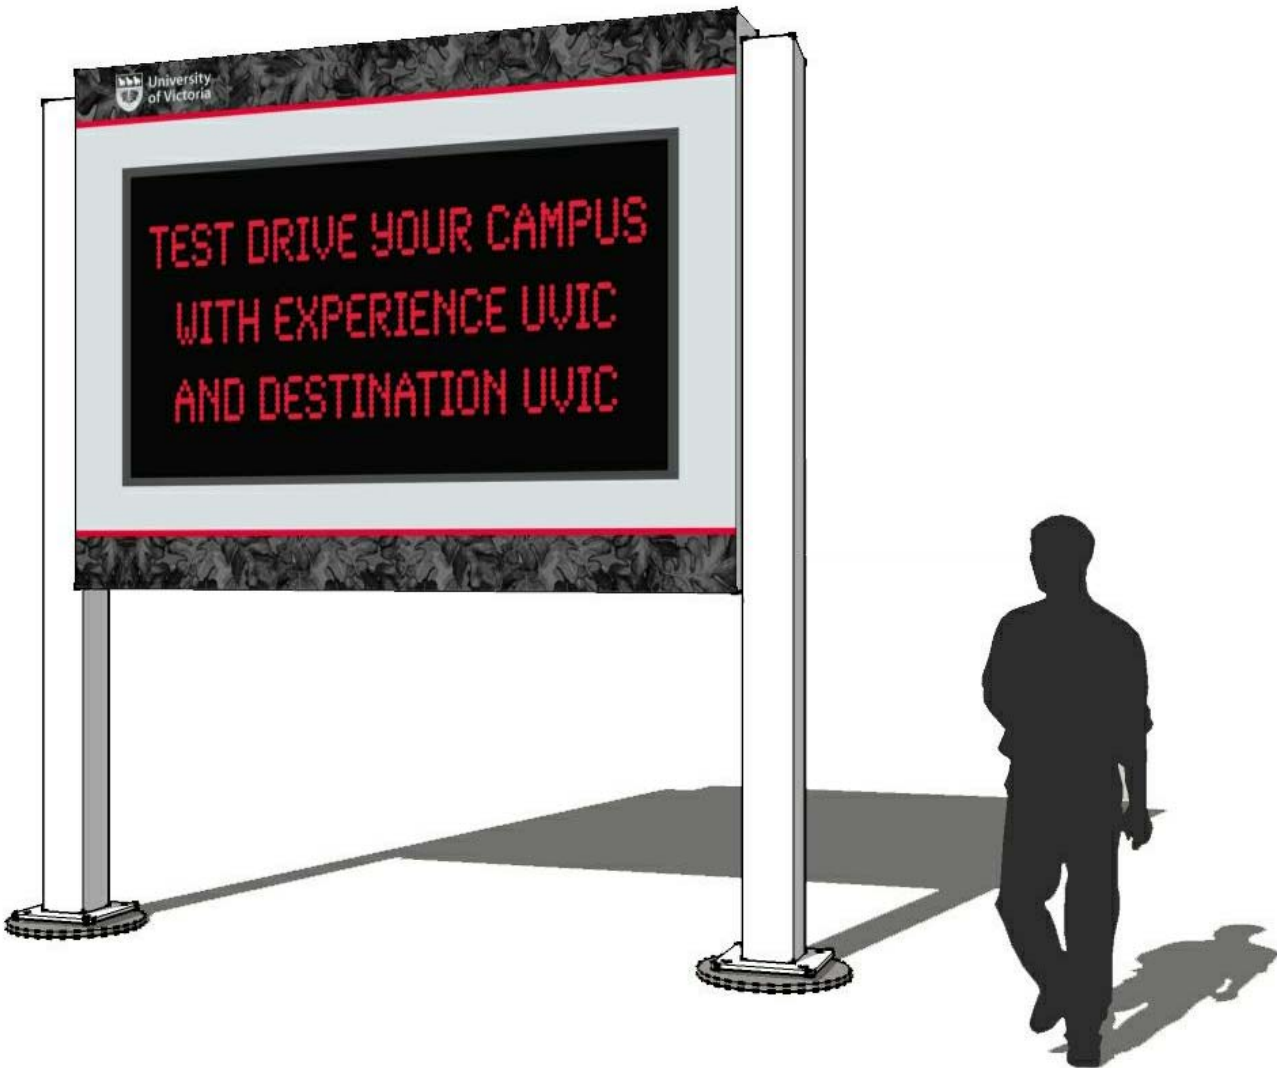


Sign No. 5

Digital Message Board


core colours




clear anodized coating



PANTONE 185 C
pinstrip, arrows



PANTONE 426 C
text



PANTONE 7541 C
background, UVic Logo




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

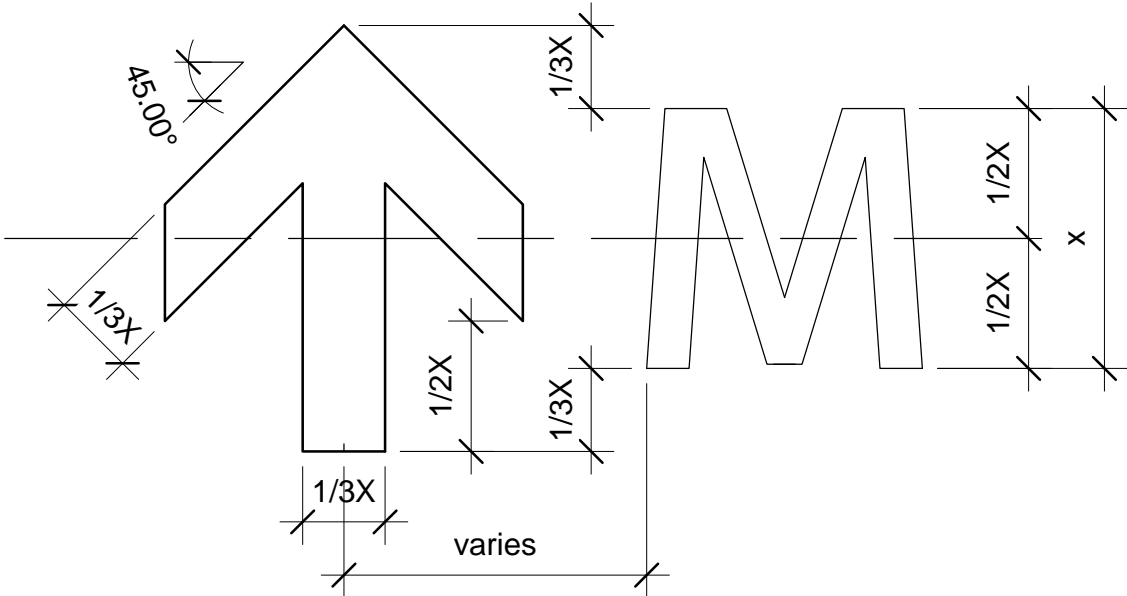


University of Victoria Logo, horizontal standard



University
of Victoria




University
of Victoria



University
of Victoria



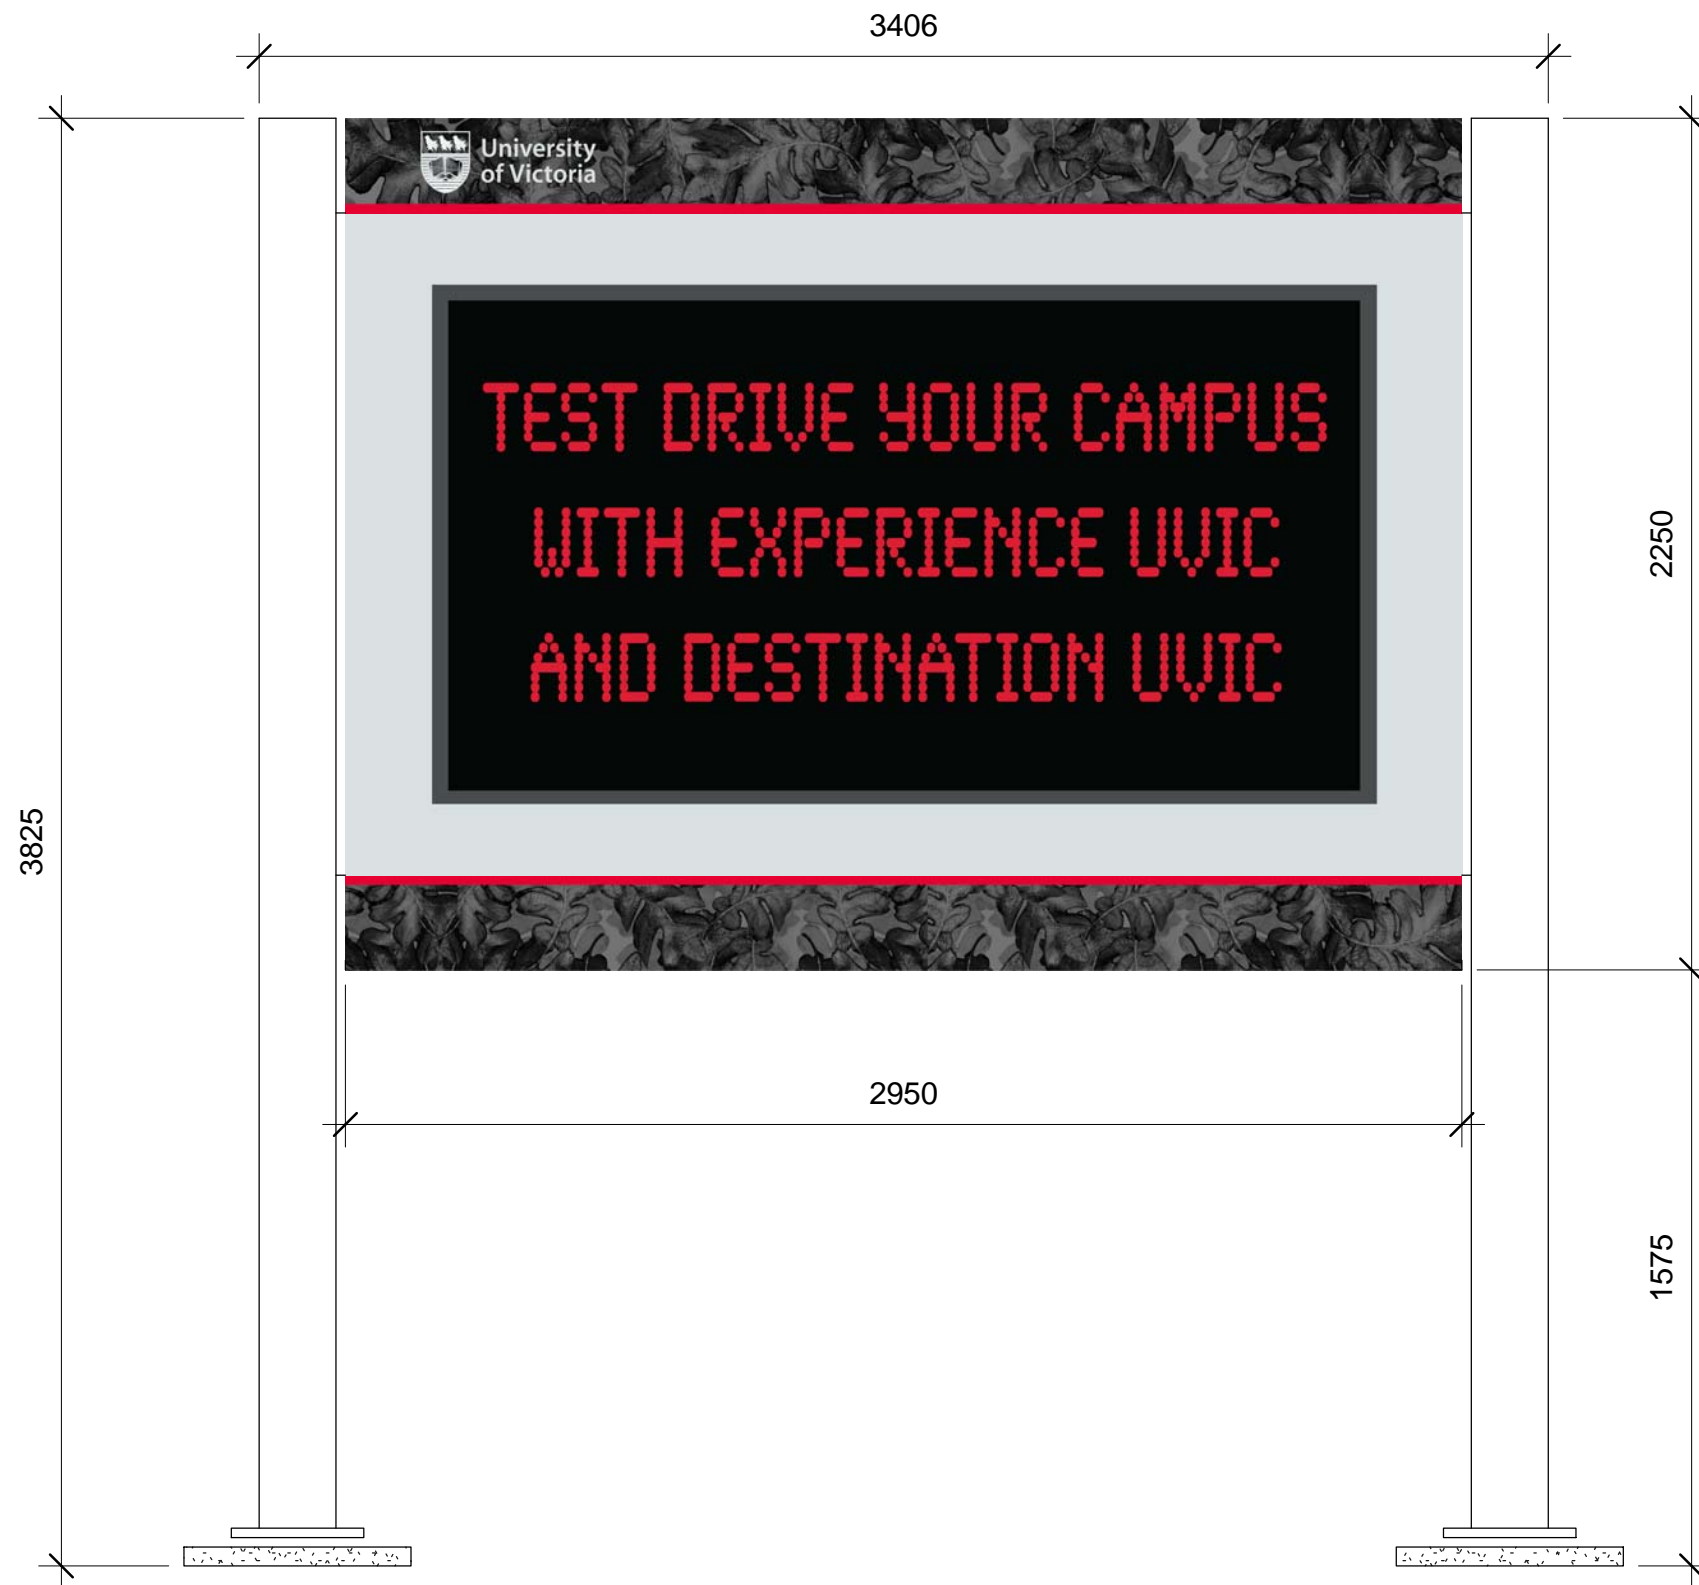

double sided/single sided sign
scale 1:20

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 5 - Digital Message Board
sheet name: sign design - overview
scale: as noted

sheet
number:

03



**University
of Victoria**

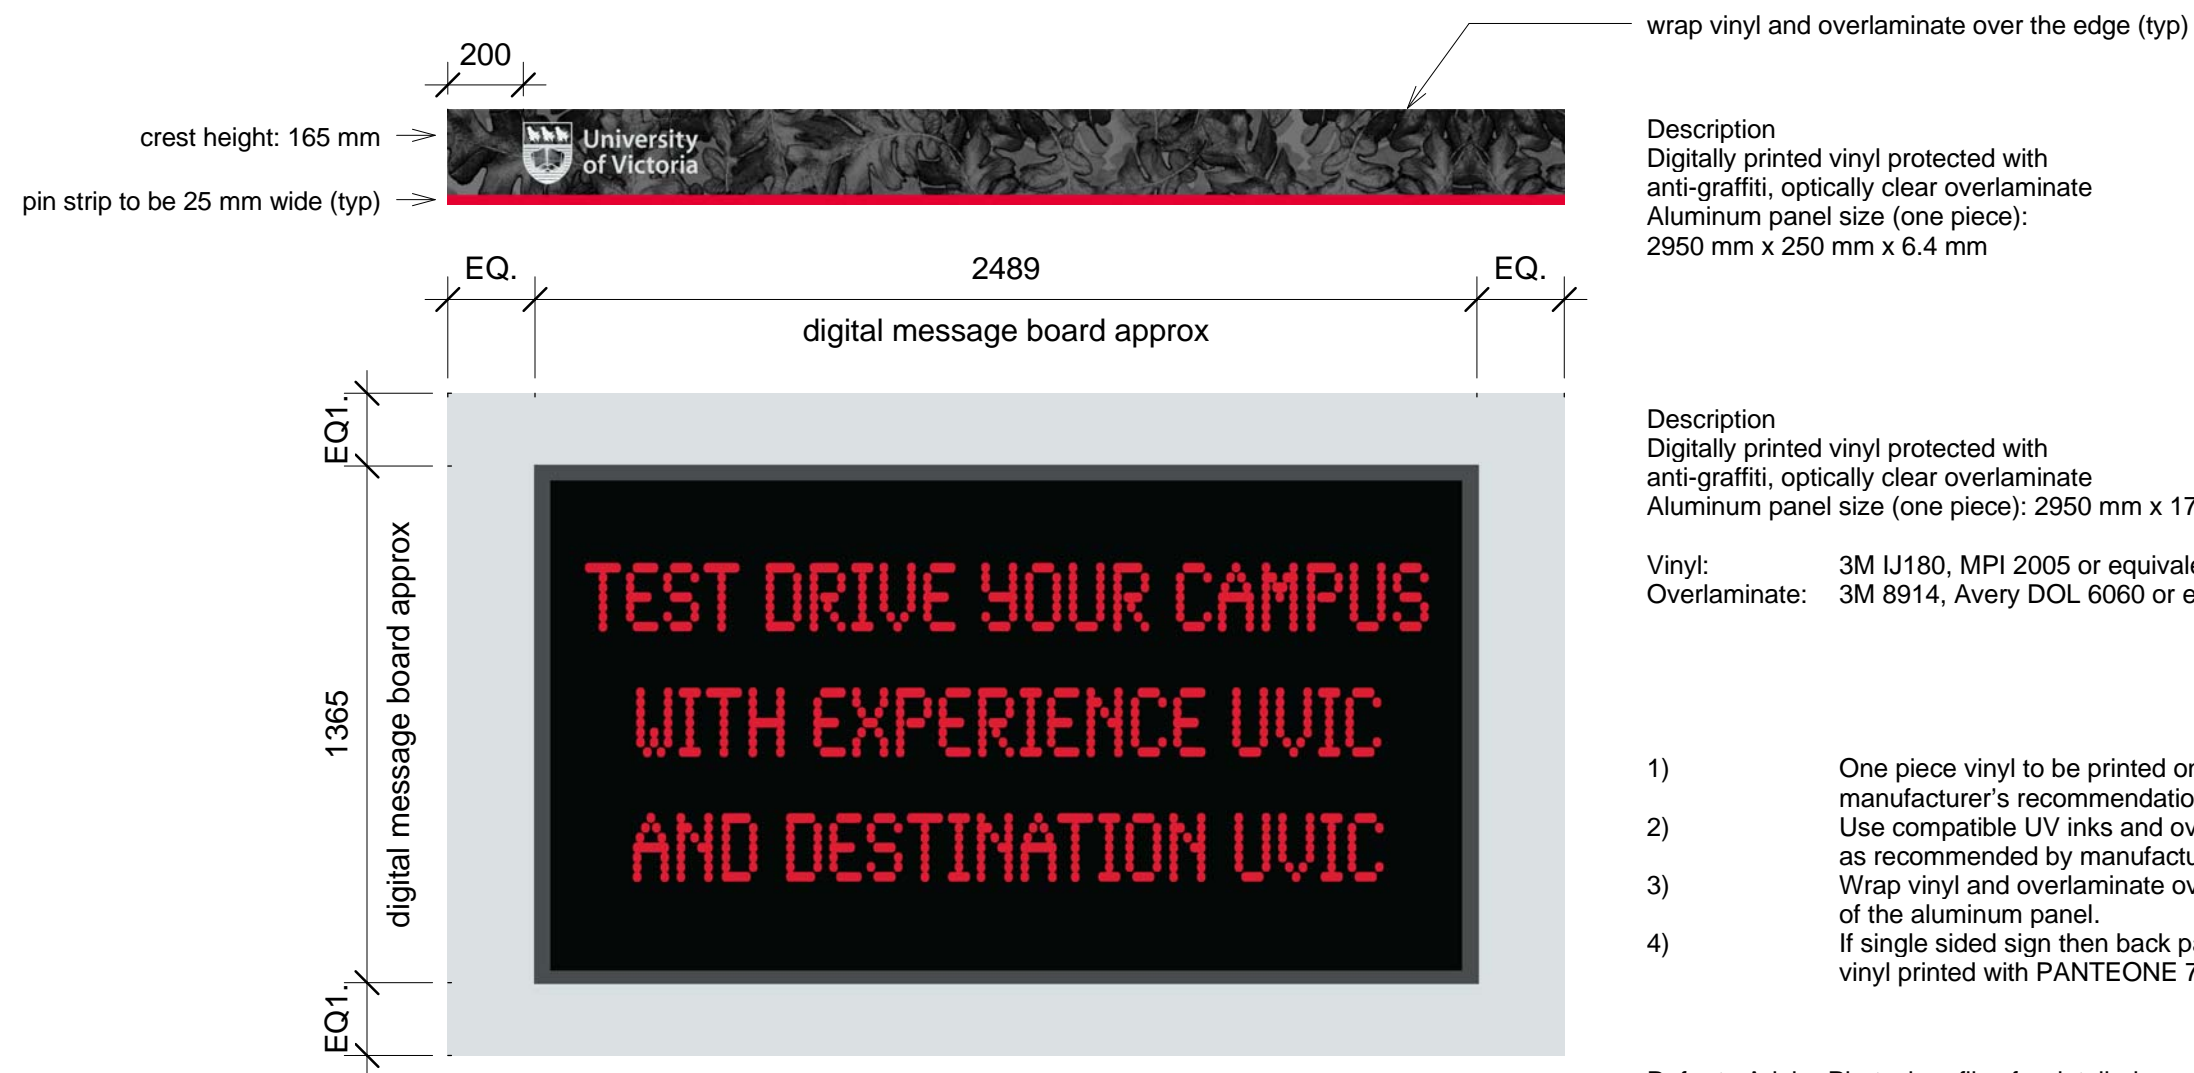

Description
Digitally printed vinyl protected with anti-graffiti, optically clear overlaminate
Aluminum panel size (one piece):
2950 mm x 250 mm x 6.4 mm

Description
Digitally printed vinyl protected with anti-graffiti, optically clear overlaminate
Aluminum panel size (one piece): 2950 mm x 1750 mm x 6.4 mm

Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.


- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and overlamine over the edges of the aluminum panel.
- 4) If single sided sign then back panel to receive vinyl printed with PANTEONE 7541 C

Refer to Adobe Photoshop files for detailed sample layout



Description
Digitally printed vinyl protected with anti-graffiti, optically clear overlaminate
Aluminum panel size (one piece):
2950 mm x 250 mm x 6.4 mm

double sided/single sided unit scale 1:20

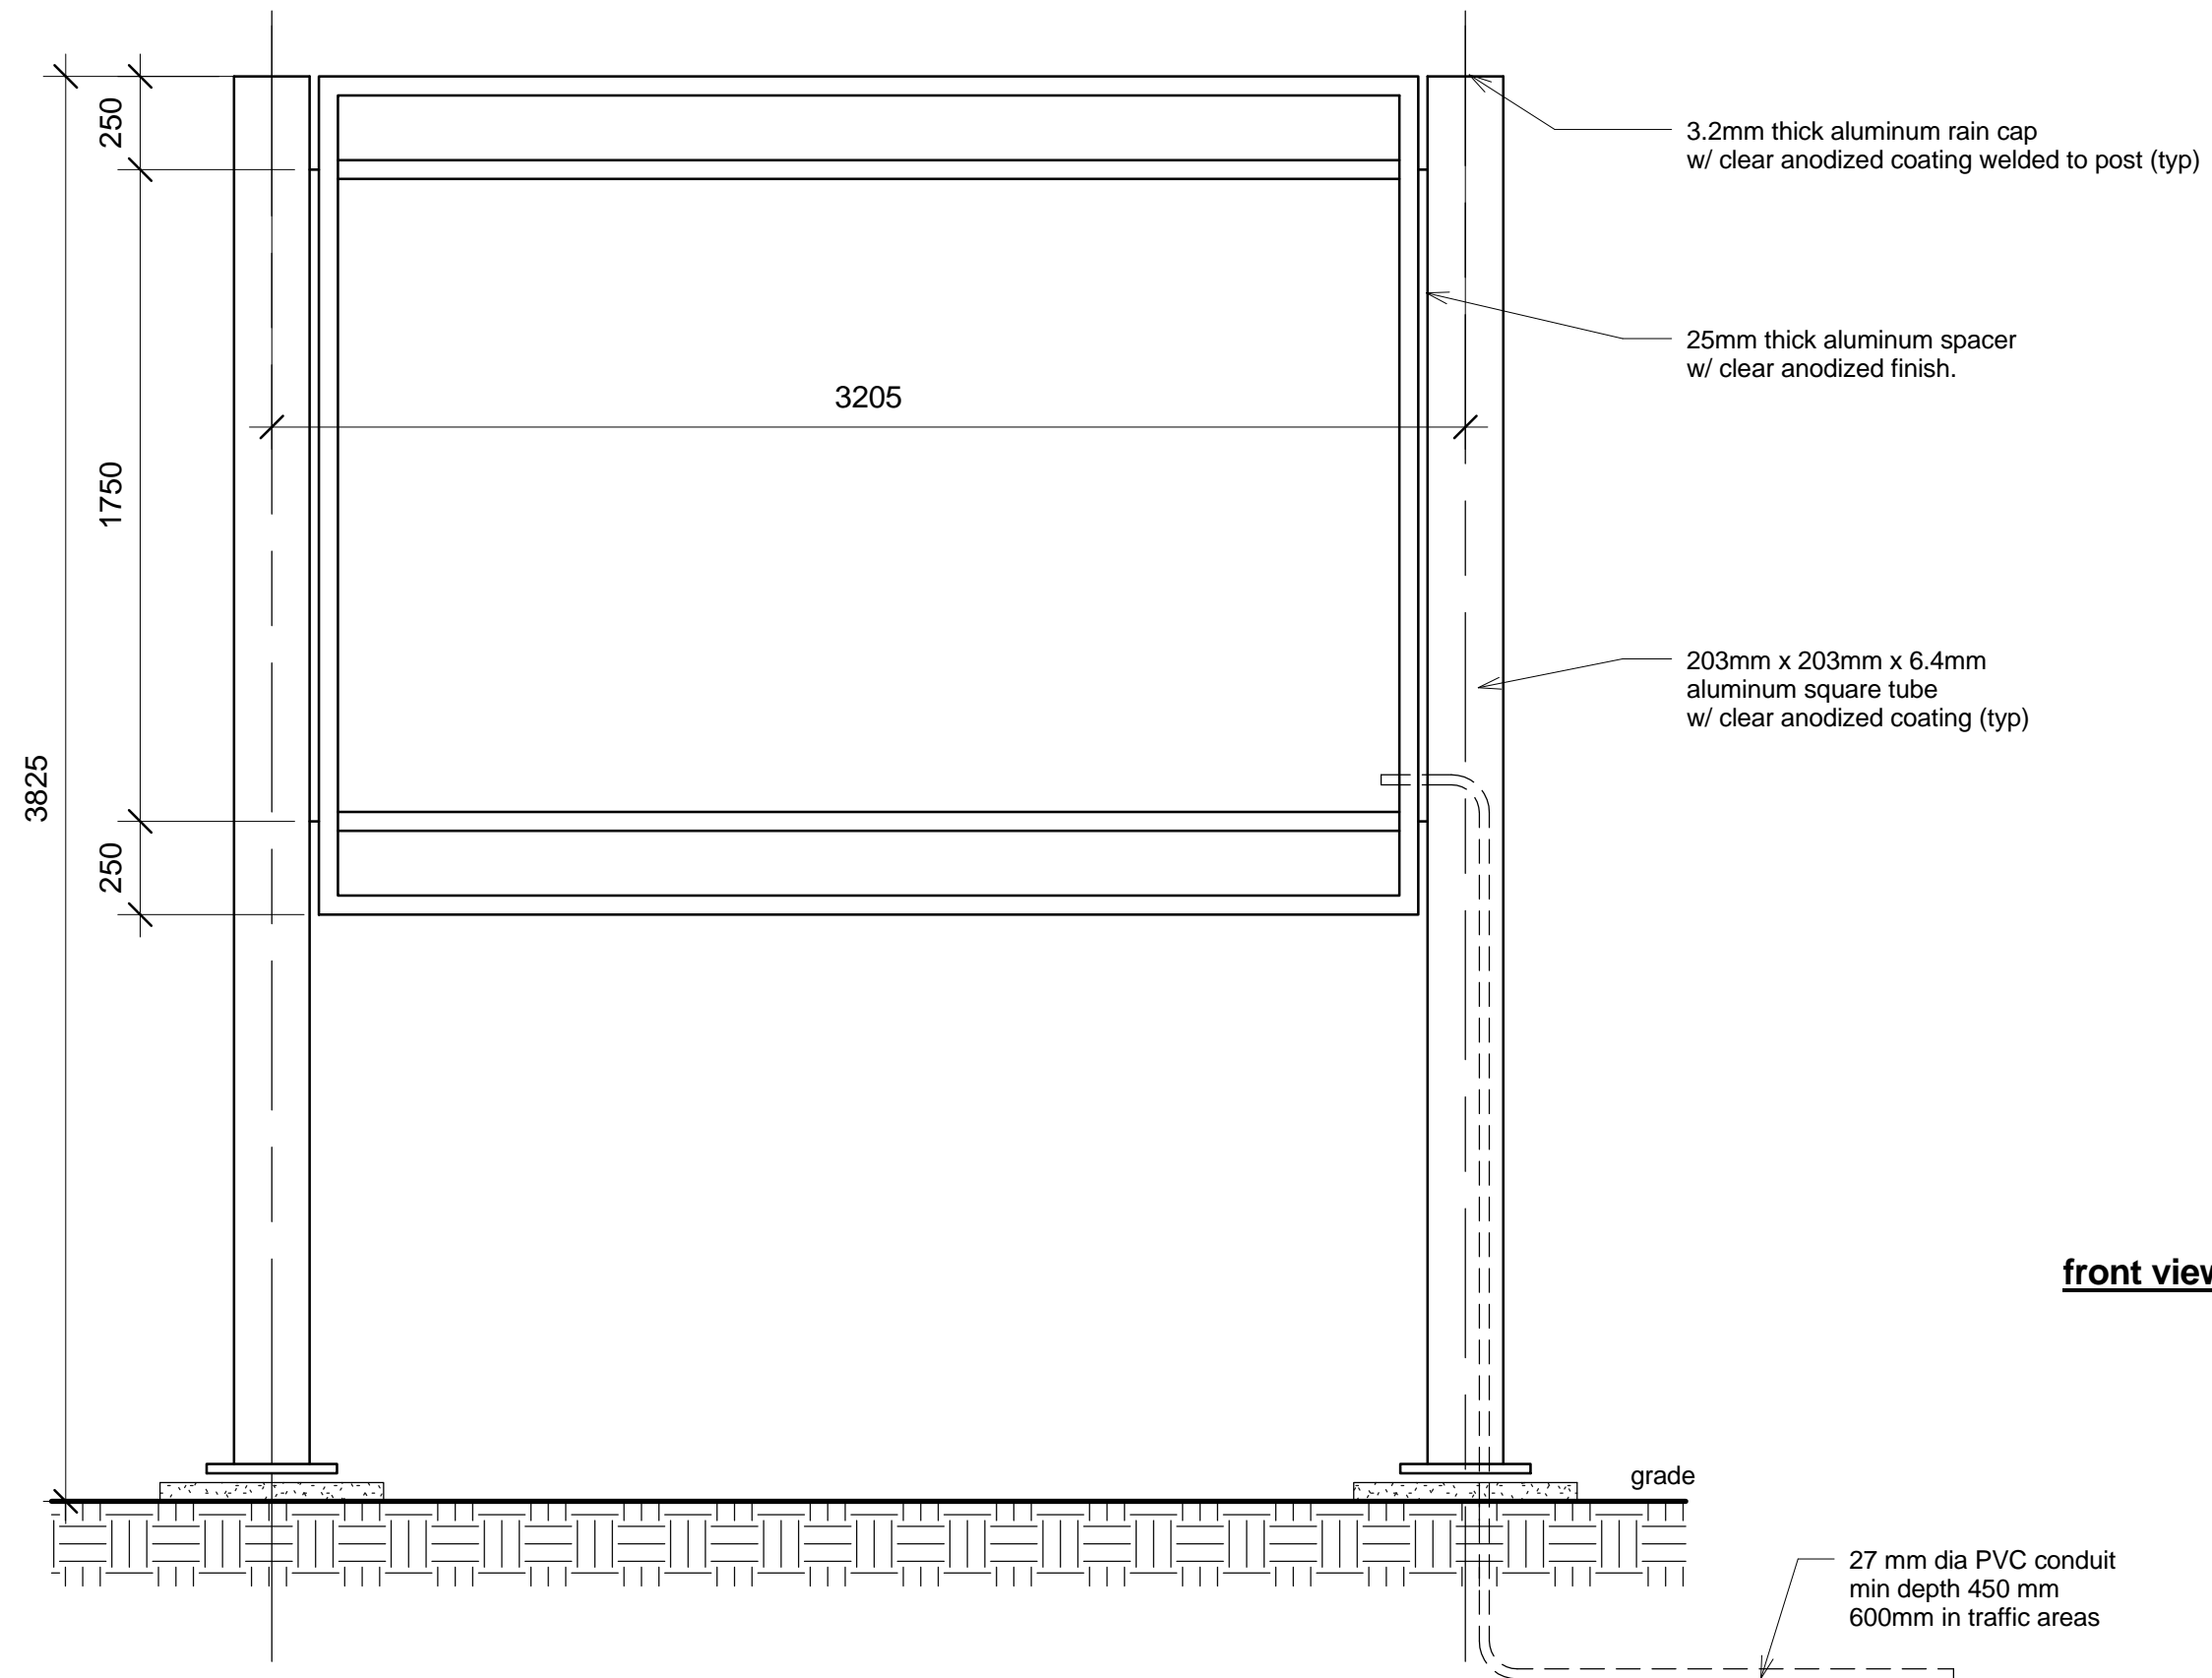

project: Campus Wayfinding
 number: FM 09-8567
 issue date: Jan 31, 2012

sign: Sign No. 5 - Digital Message Board
 sheet name: sign construction - general information
 scale: as noted

sheet
 number:

05



**University
 of Victoria**

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: $q_{50}=0.63\text{kPa}$, $I_w=1.0\text{-ULS}$, 0.75-SLS .

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer. Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of $23\pm1\text{ kn/m}^3$ ($145\pm5\text{ pcf}$) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL NOTES (cont)

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant "Torx-Pin" screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be "Pentagon" tamper resistant bolts, with "Pentagon" nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with "Pentagon" security nuts.

ELECTRICAL NOTES

- 1. Signs must be provided with CSA label
- 2. LED modules, power supplies, cable, wire and junction box must be integral with signs
- 3. All electrical installations to be done in accordance with the Canadian Electrical Code and as recommended by the LED lighting manufacturer.
- 4. Run 2#8 +GND conductors in 27mm PVC conduit from sign to existing campus exterior lighting pole standard. Intercept existing underground conduit, install an H20 rated flush junction box with bolt-on cover and splice into exterior lighting circuit.
- 4. The sign manufacturer shall provide an electrical shop drawings indicating input power requirements and a schematic wiring diagram for the sign.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes




Sign No. 6
Vehicular - Directional

core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
back panel (single sided sign)
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family


Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890


arrow style and arrow size in relation to text height

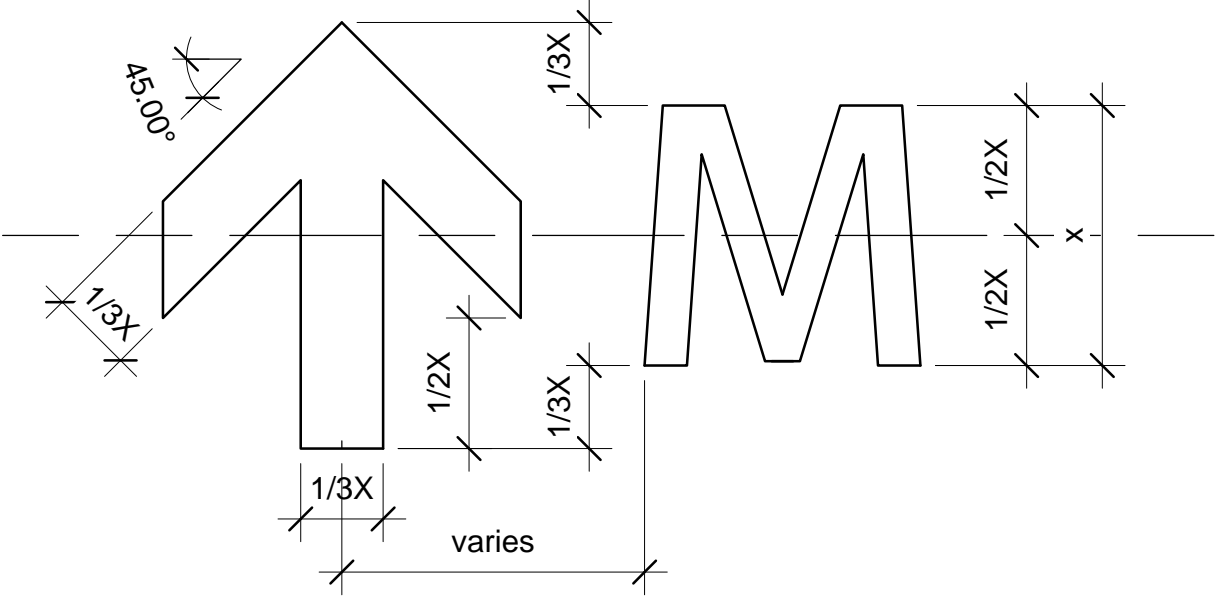


University of Victoria Logo, horizontal standard



University
of Victoria



University
of Victoria




University
of Victoria

full colour


opaque monochromatic

opaque monochromatic reversed




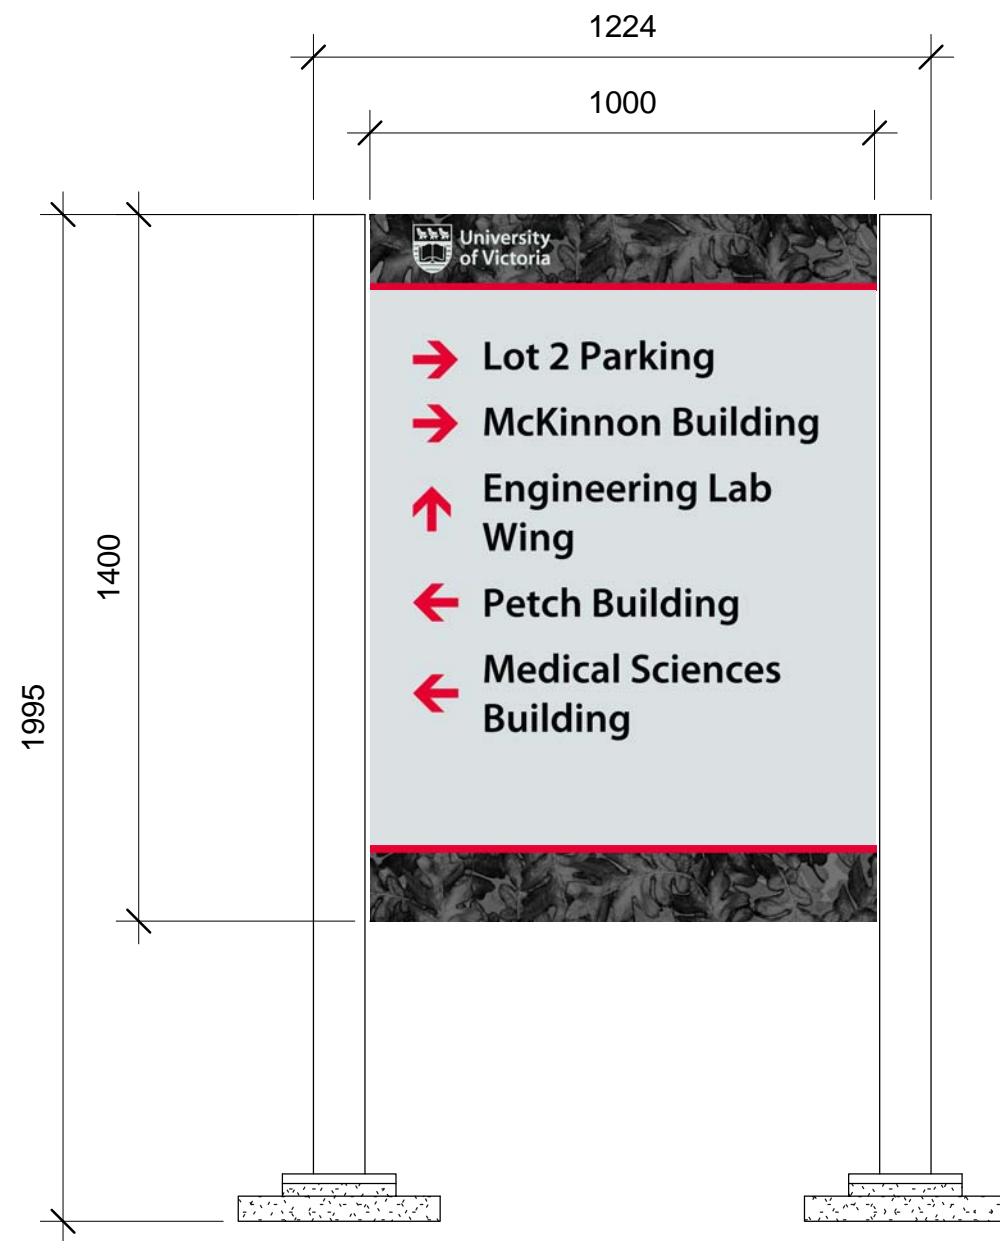


Directional version 1
scale 1:15

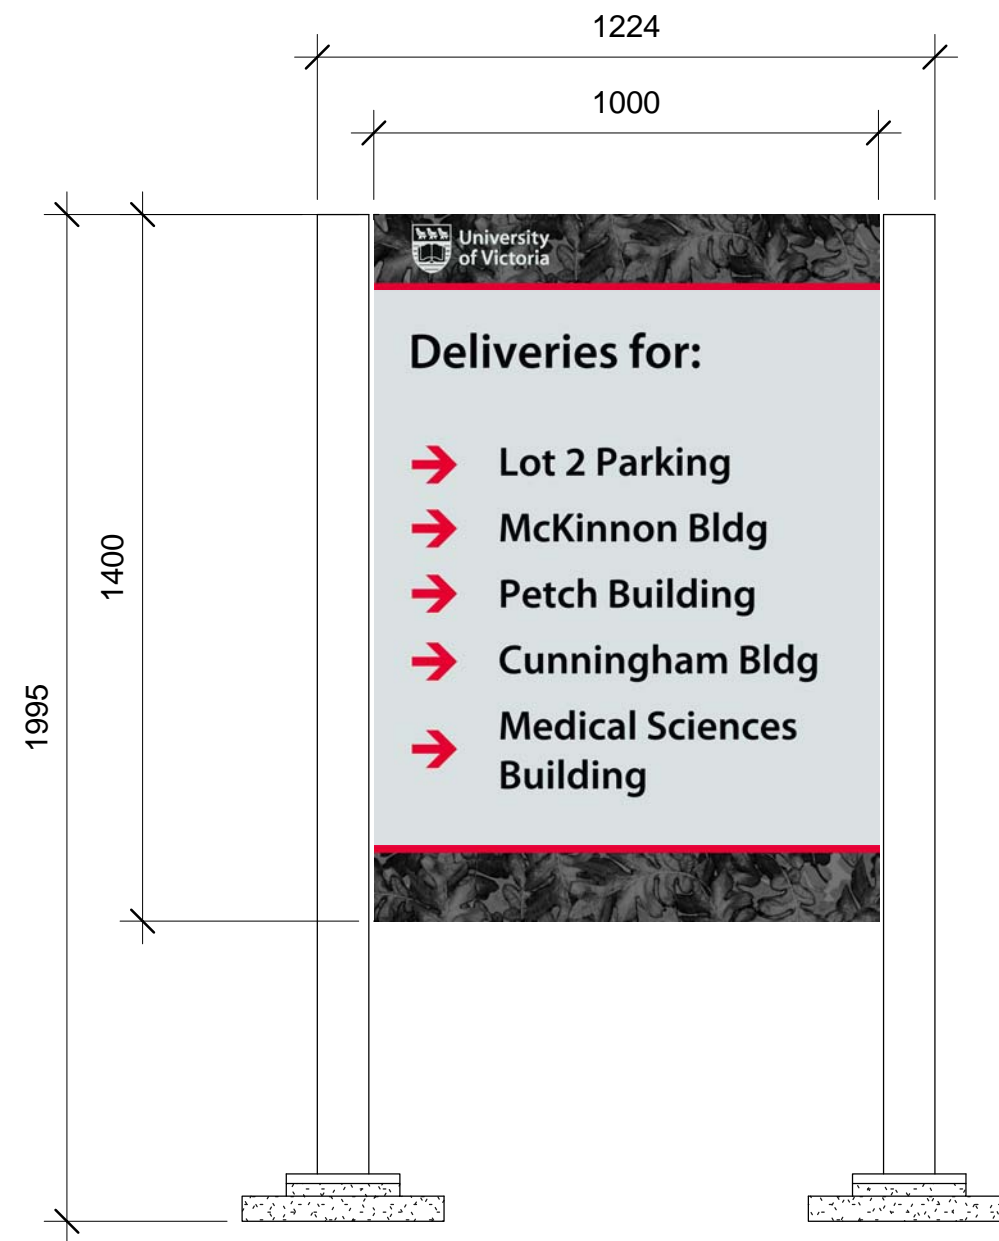

Directional version 2
scale 1:15



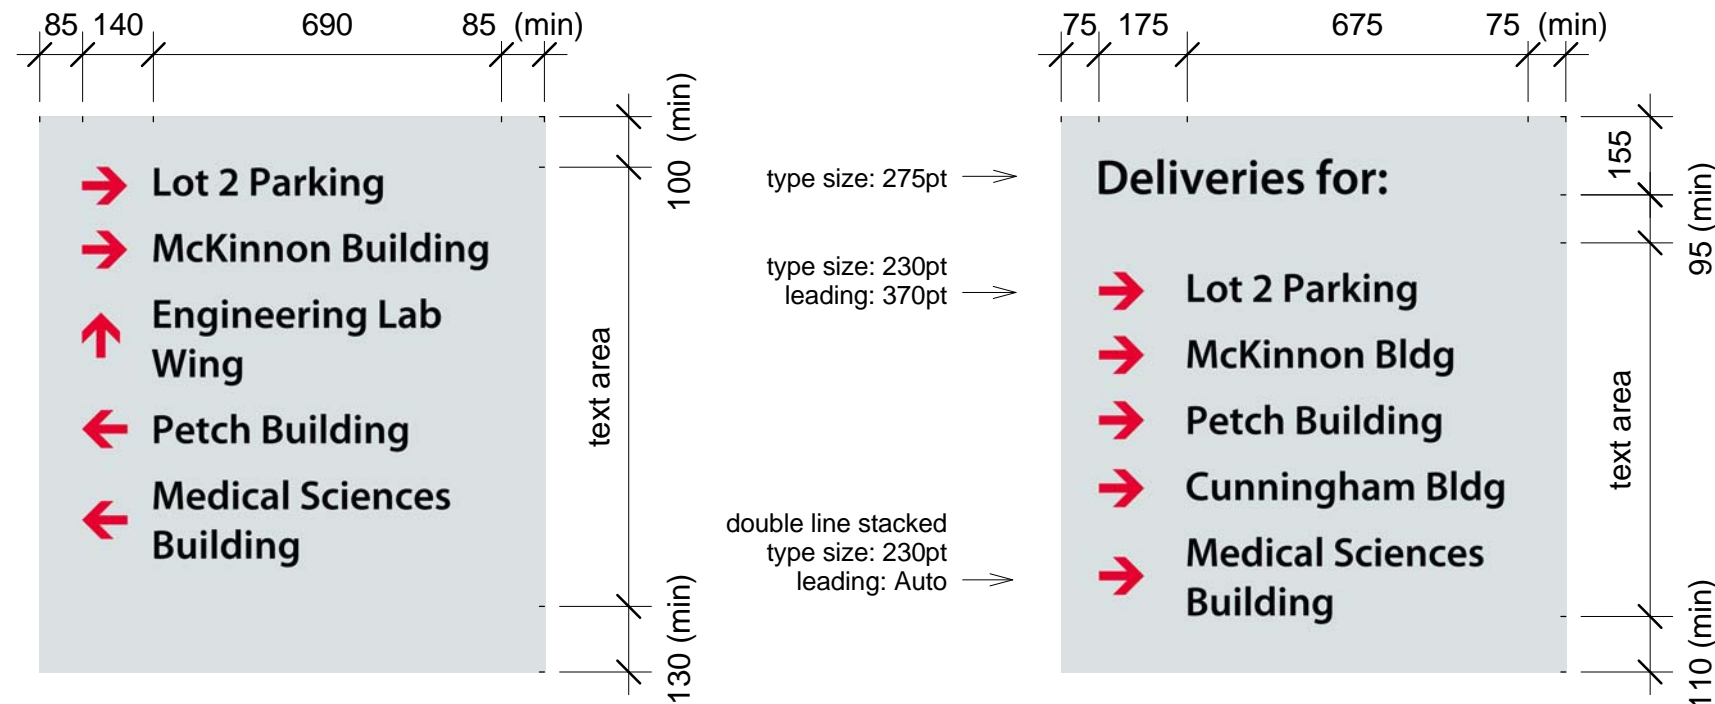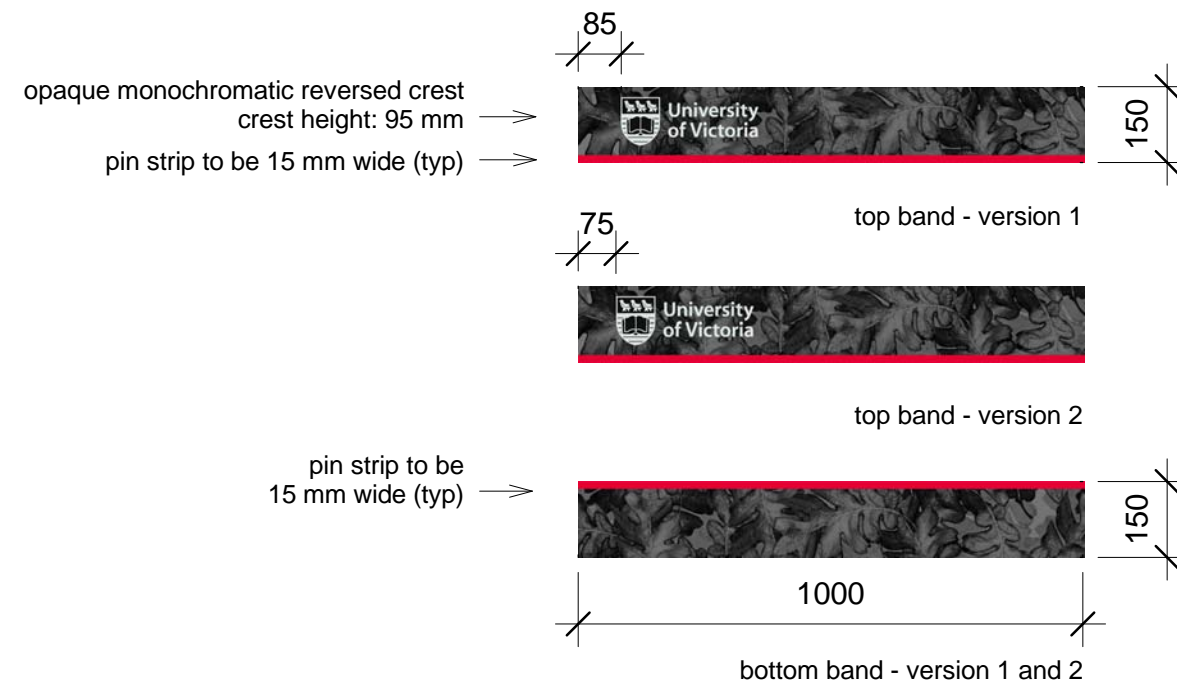

version 1

version 2


scale 1:15

Description
Digitally printed vinyl protected with
anti-graffiti, optically clear overlaminate
Aluminum panel size (one piece): 1000 mm x 1400 mm x 6.4 mm
See sheet 05 for details.

Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlaminate: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and overlaminate over the edges of the aluminum panel.
- 4) If single sided sign then back panel to receive vinyl printed with PANTEONE 7541 C

Refer to Adobe Photoshop files for detailed sample layout

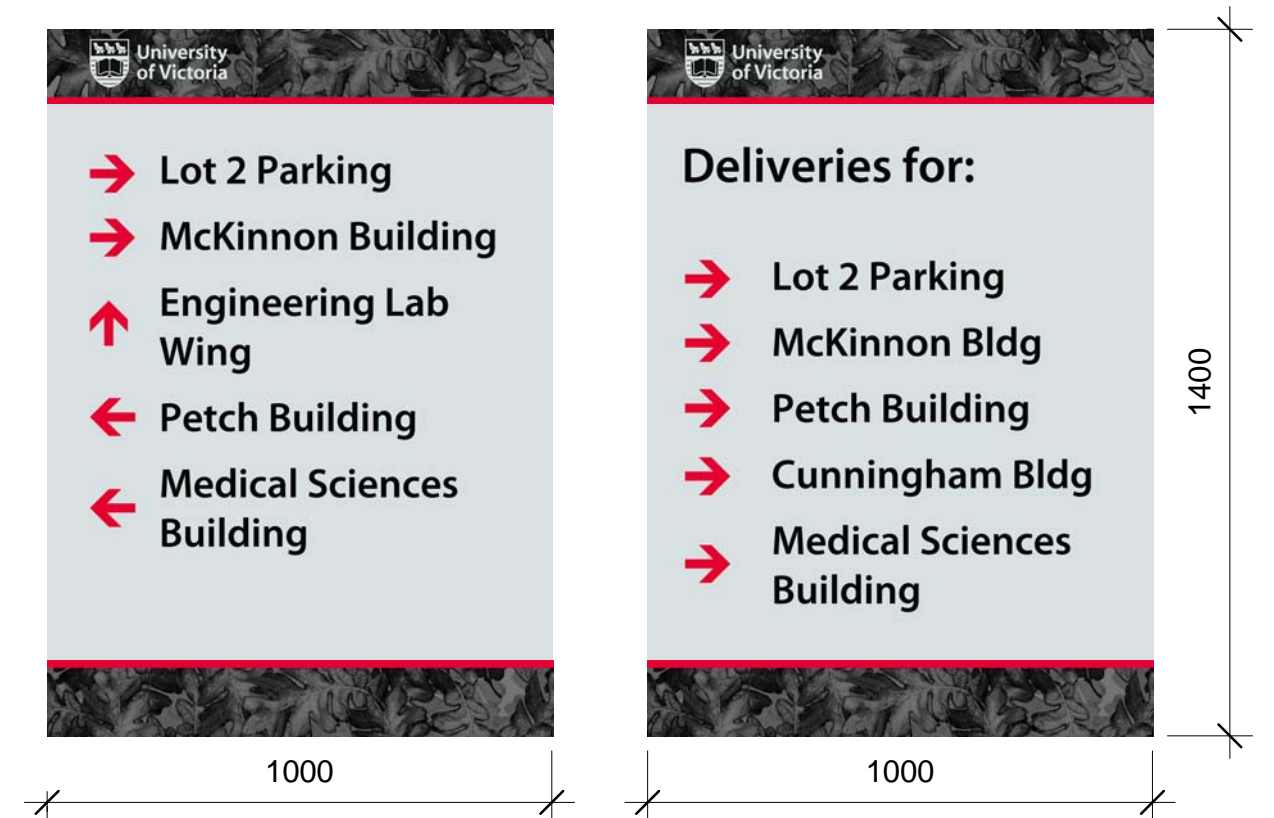

version 1

version 2

scale 1:15

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 6 - Directional
sheet name: sign design - graphic design details
scale: as noted

sheet
number:


04



University
of Victoria

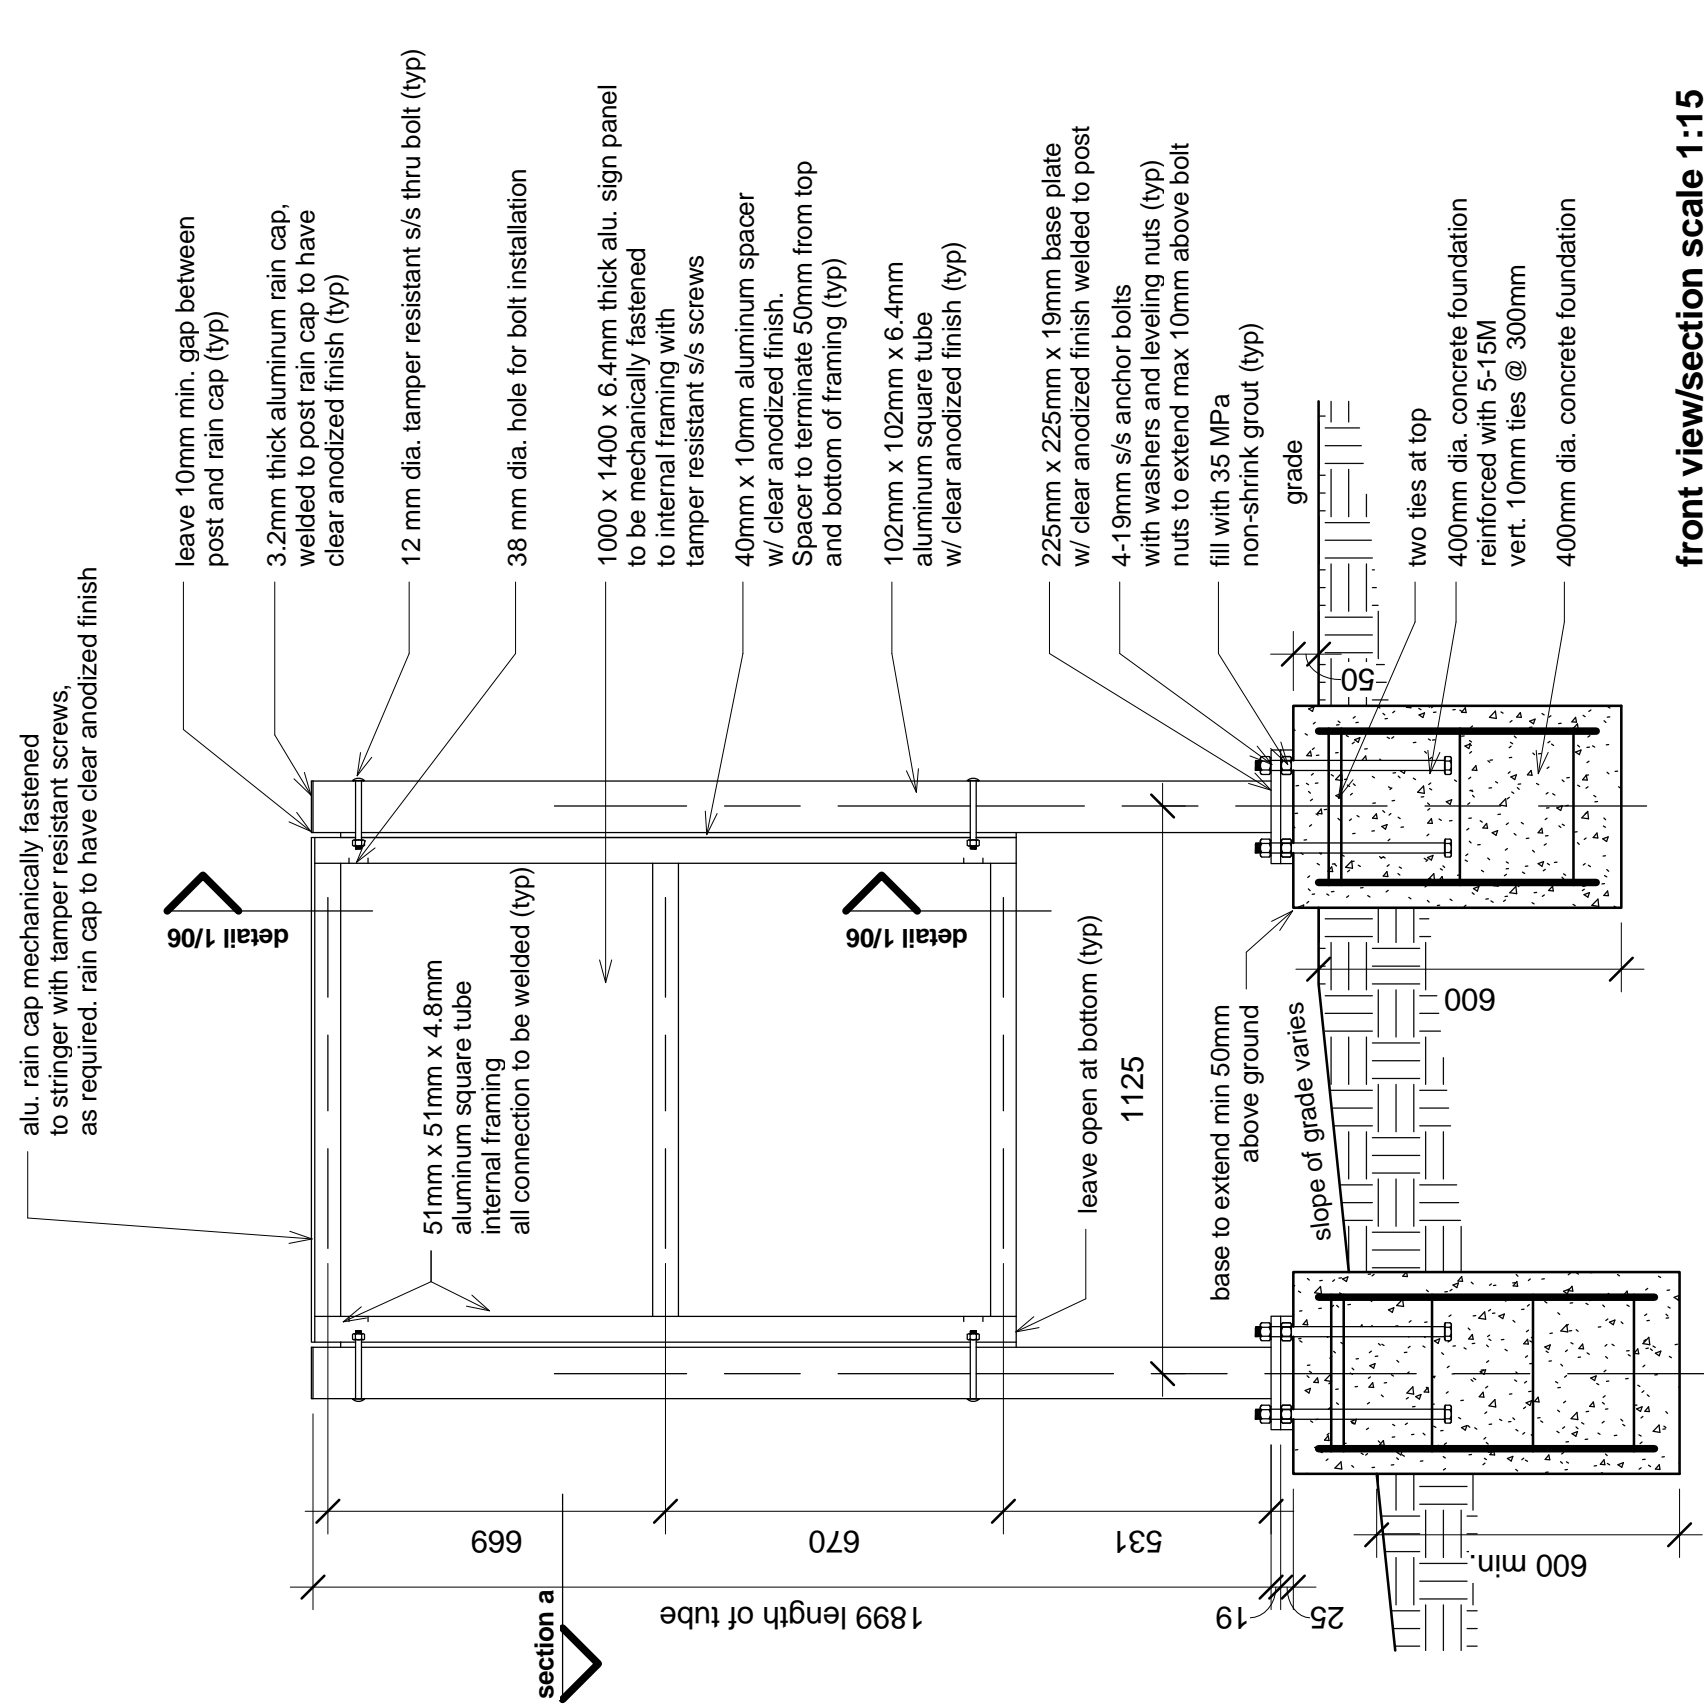


front view/section scale 1:15

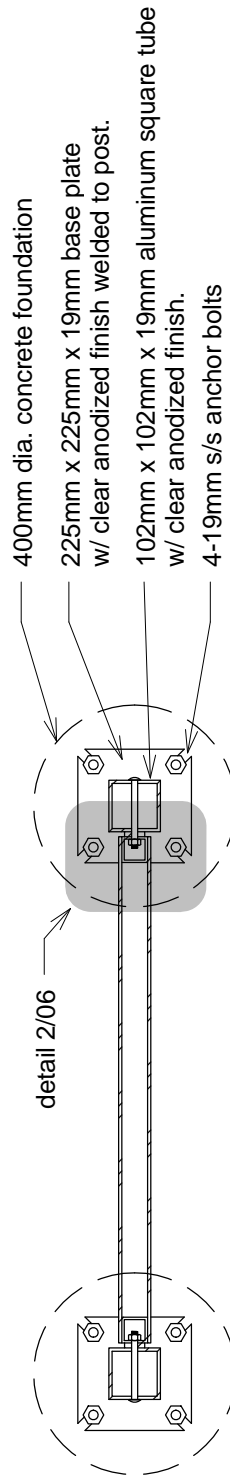


section a scale 1:15

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

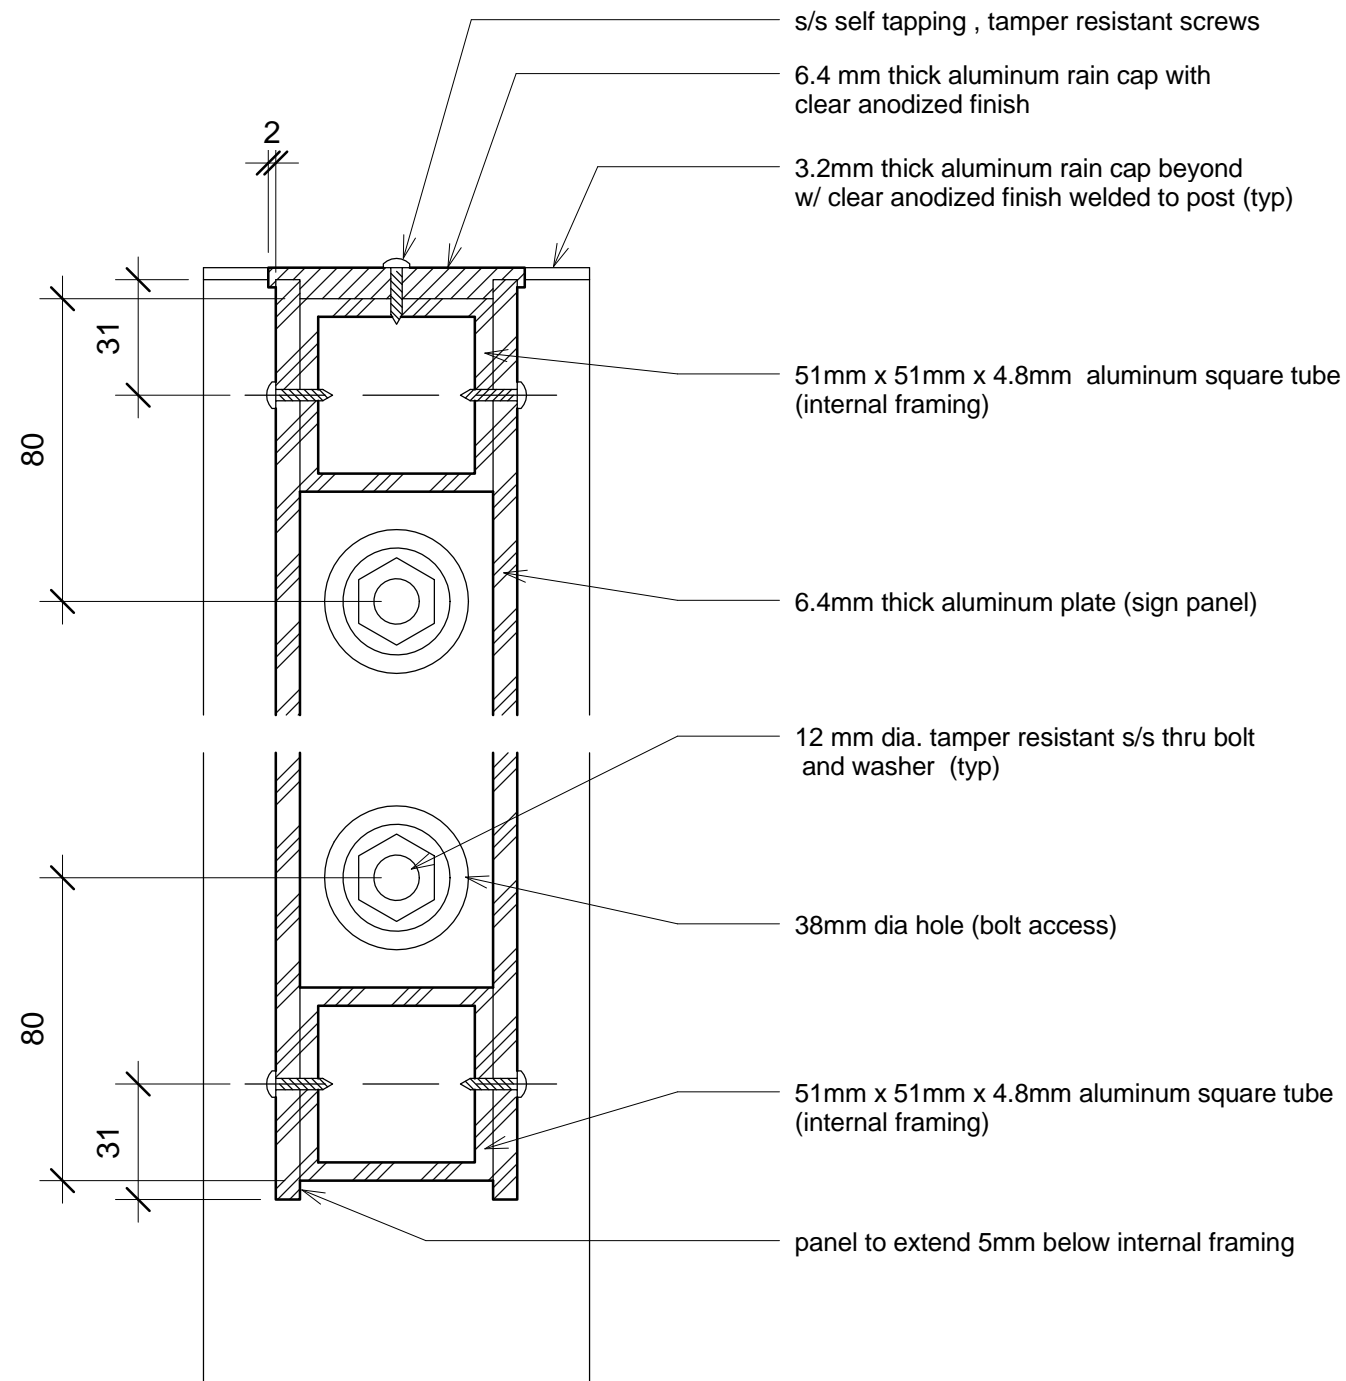


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section detail 1 scale 1:2

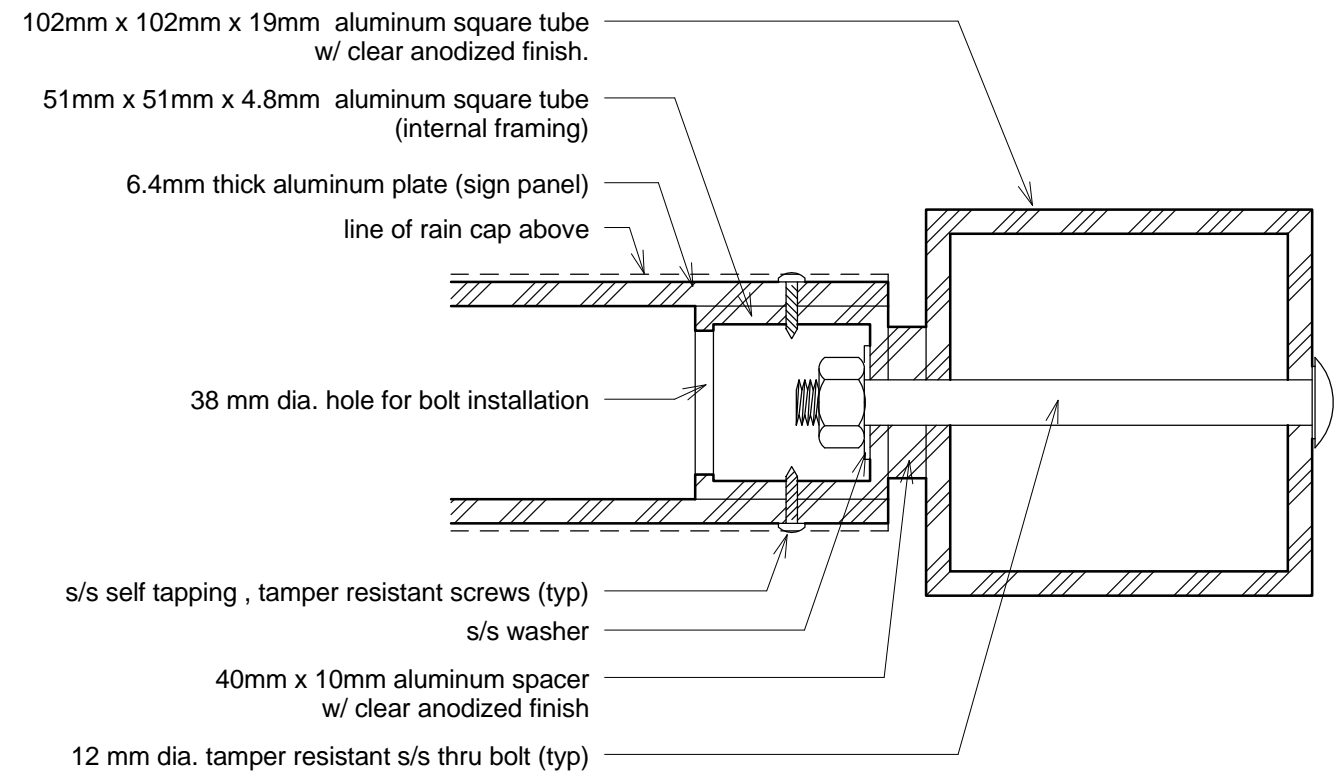

section detail 2 scale 1:2

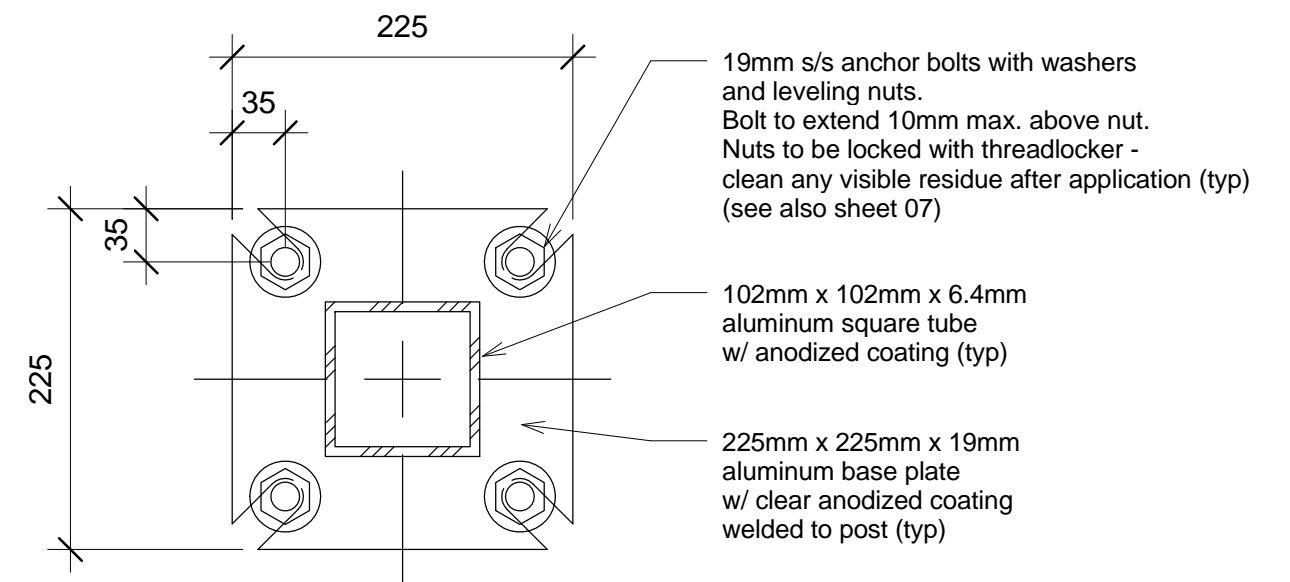

section b (slip base) scale 1:5

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 6 - Directional
sheet name: sign construction - details
scale: as noted

sheet
number:

06



**University
of Victoria**

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
- Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #174786 (1/2" s/s x 5" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
 - rain cap attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes



Sign No. 6

Vehicular - Directional

University House 1


core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTEONE 7541 C
application: background,
back panel (single sided sign)
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

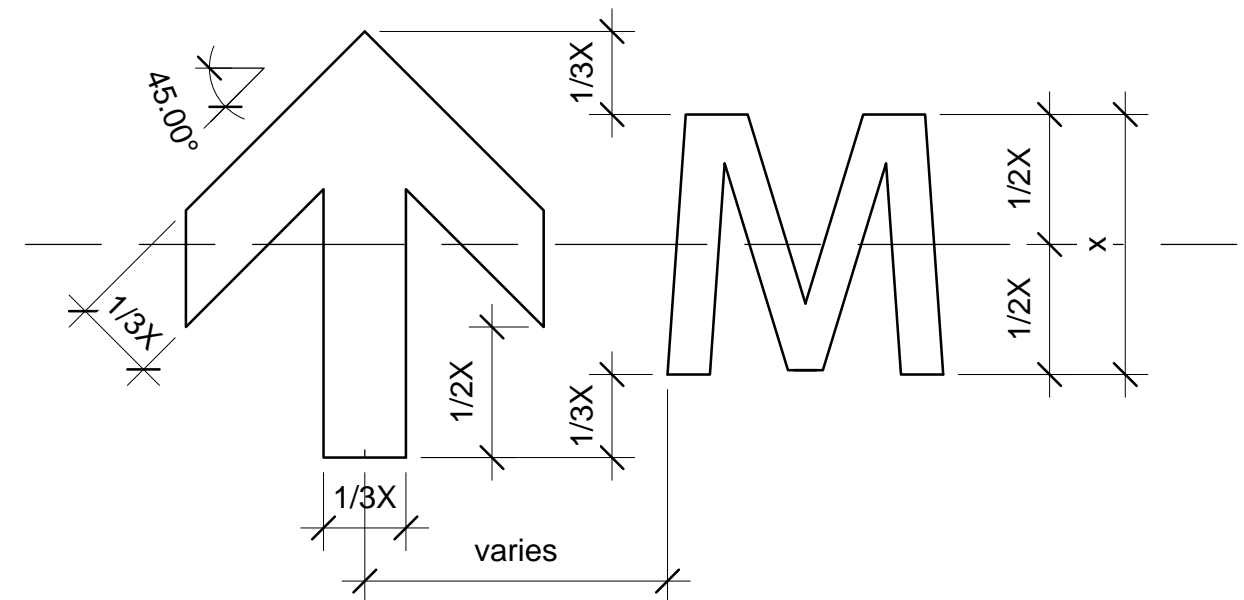


University of Victoria Logo, horizontal standard



University of Victoria



University of Victoria



full colour

opaque monochromatic

opaque monochromatic reversed

project: Campus Wayfinding - Phase 1
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 6 - University House 1
sheet name: typography, colours and pictograms
scale: as noted

sheet
number:


02




**University
of Victoria**

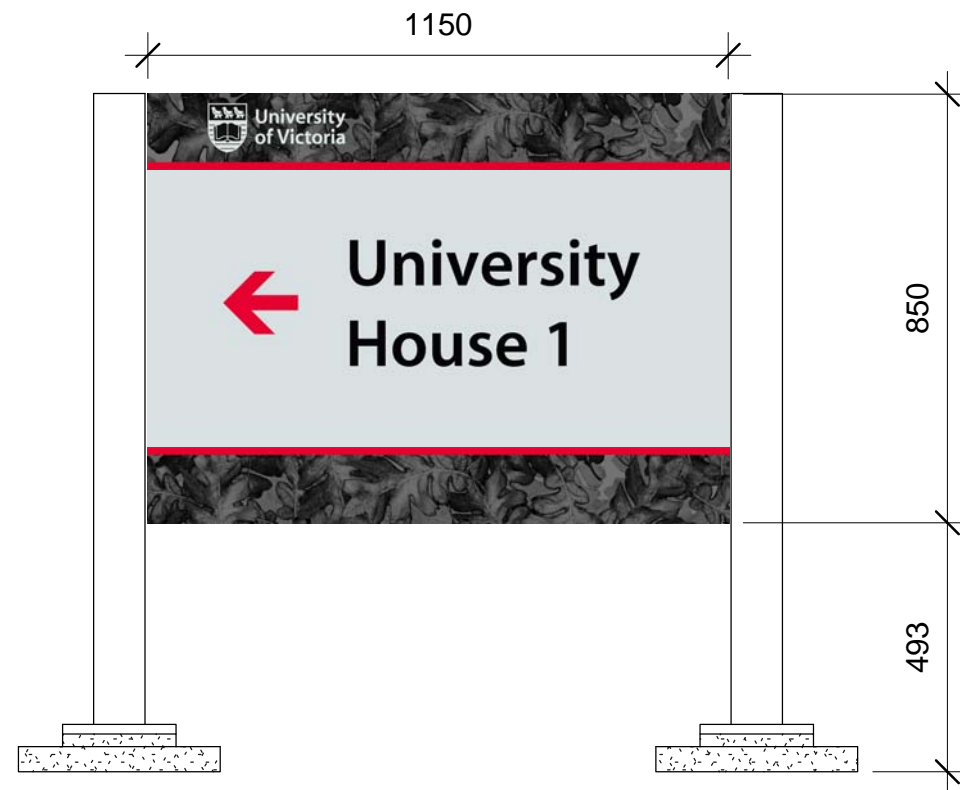

north elevation scale 1:15

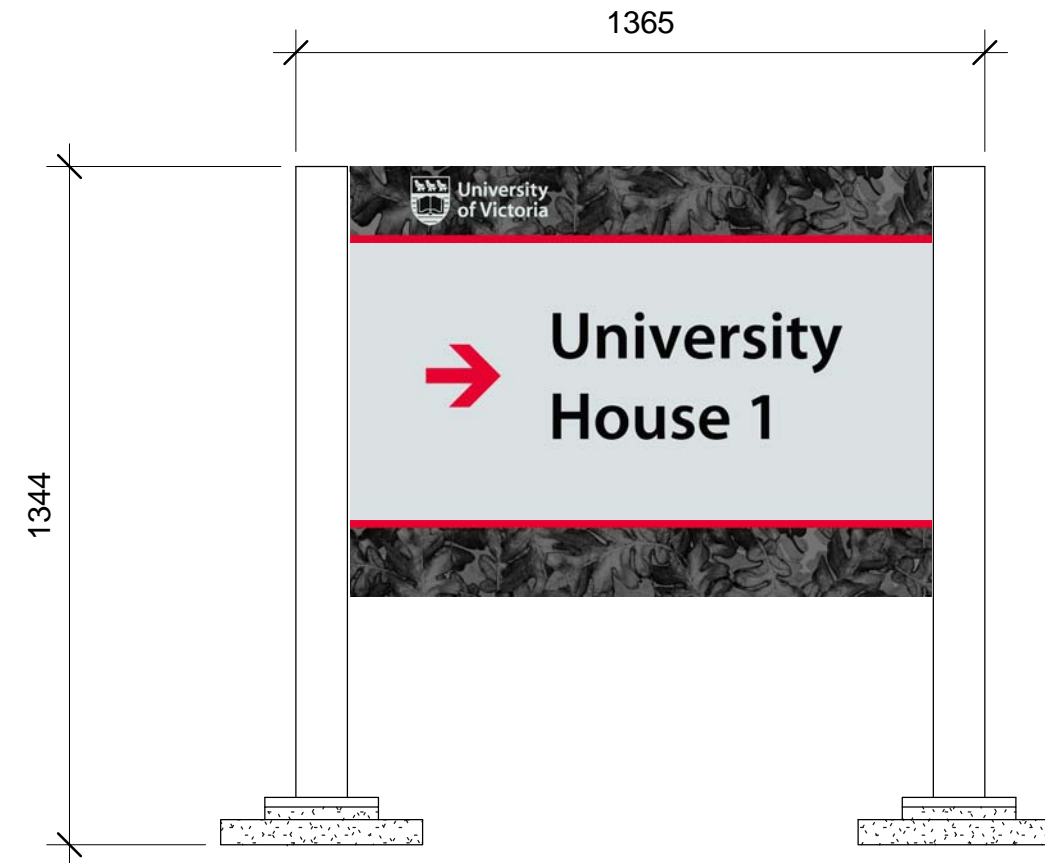

south elevation scale 1:15

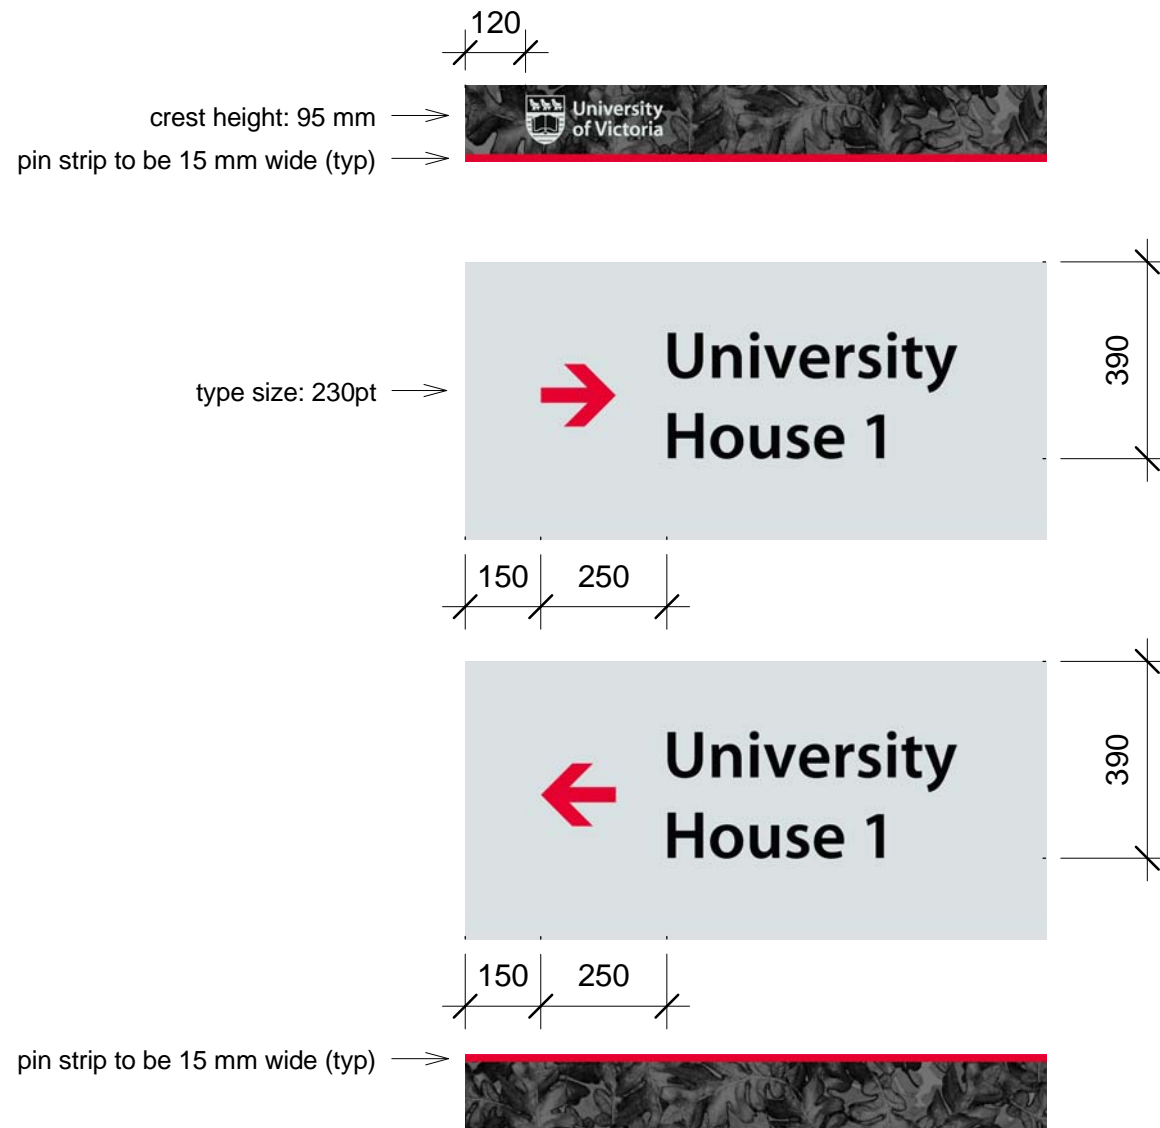

scale 1:15



Description


Digitally printed vinyl protected with anti-graffiti, optically clear overlaminate
Aluminum panel size (one piece): 1150 mm x 850 mm x 6.4 mm

Reflective vinyl: SRV (white reflective)


Overlaminate: DOL 6060

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and overlaminate over the edges of the aluminum panel.


Refer to Adobe Photoshop files for detailed sample layout

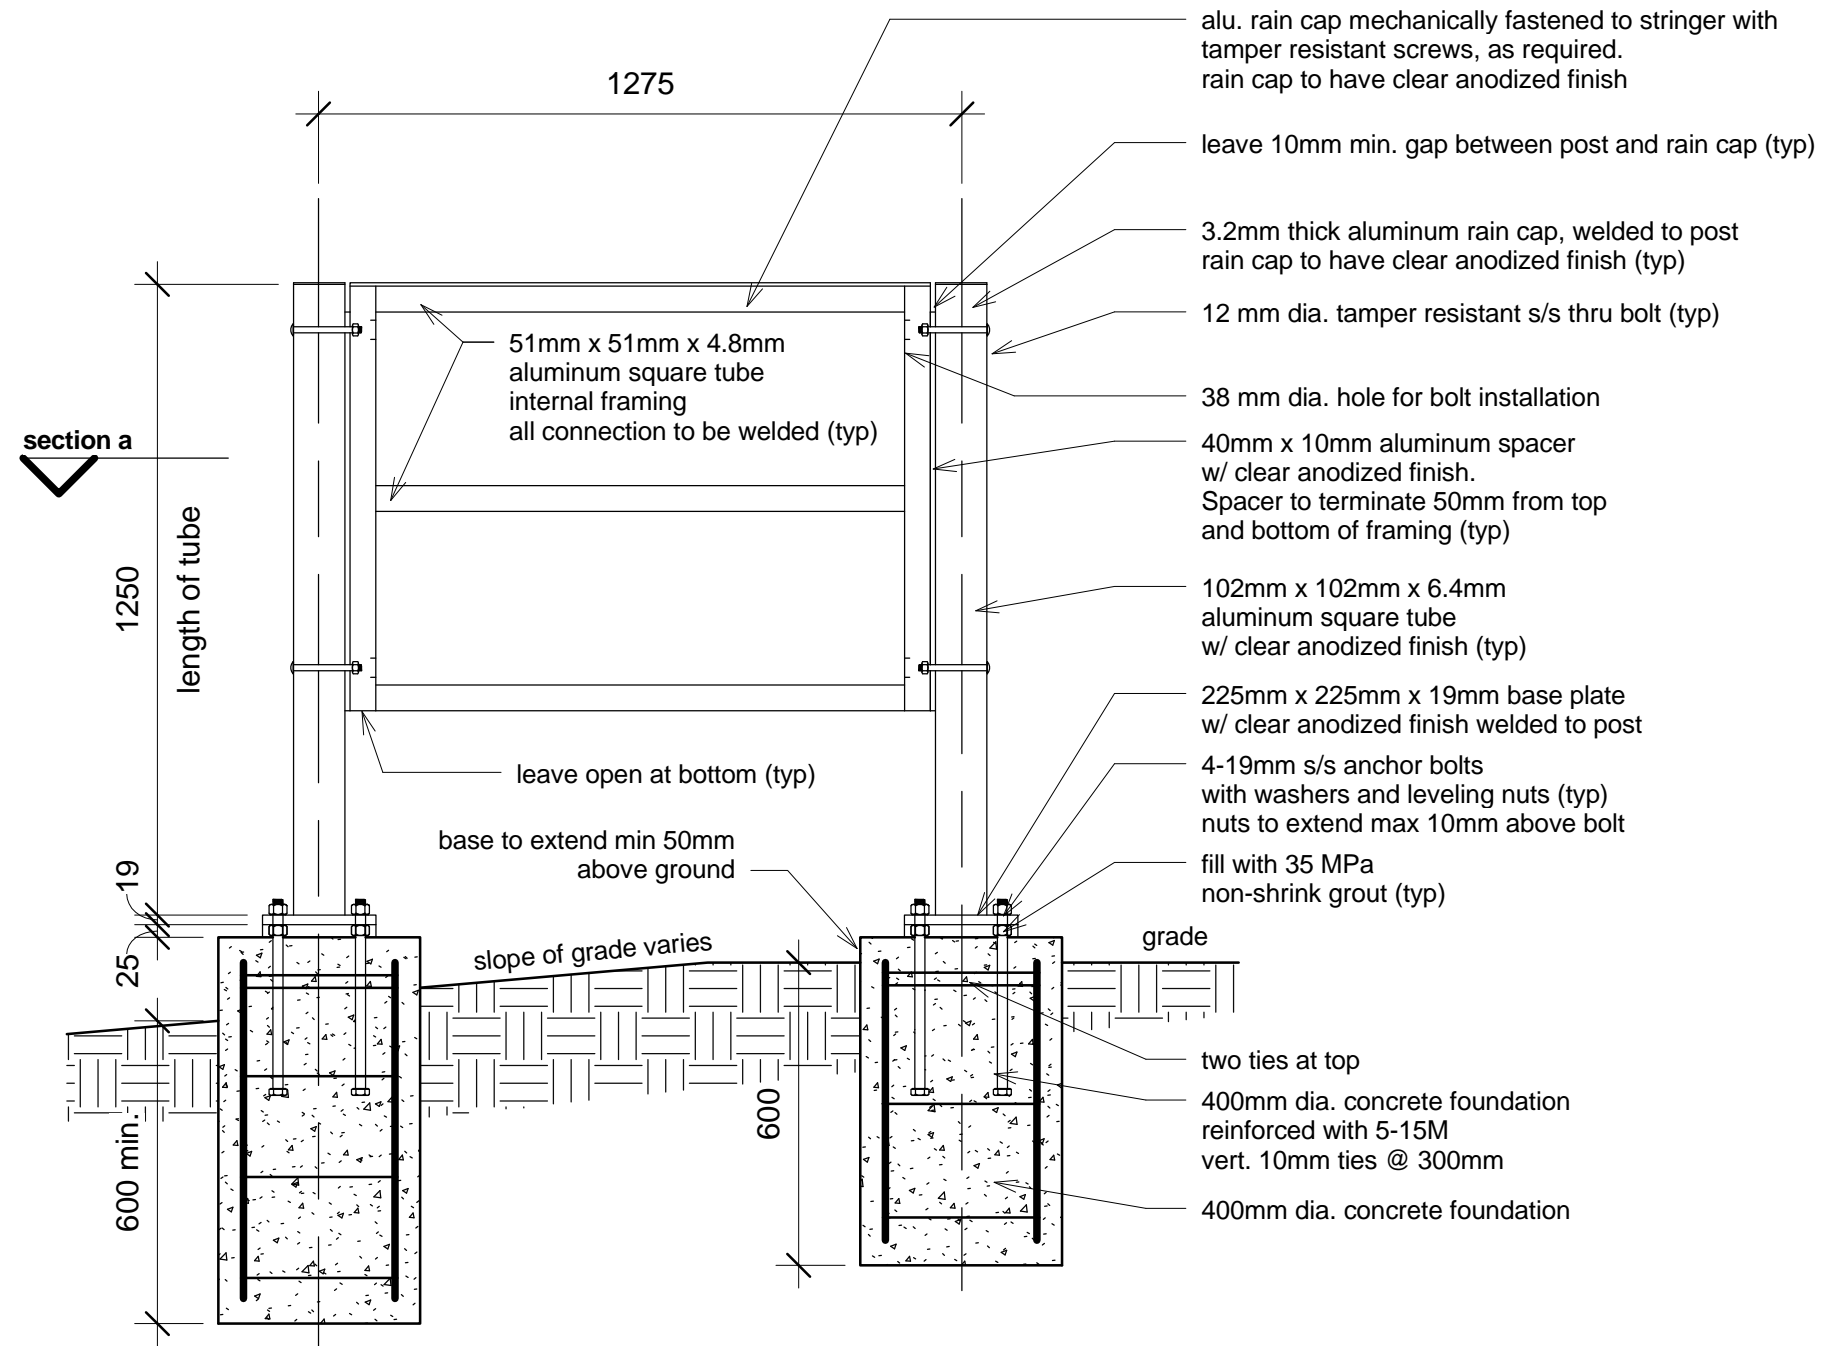

front view/section scale 1:15

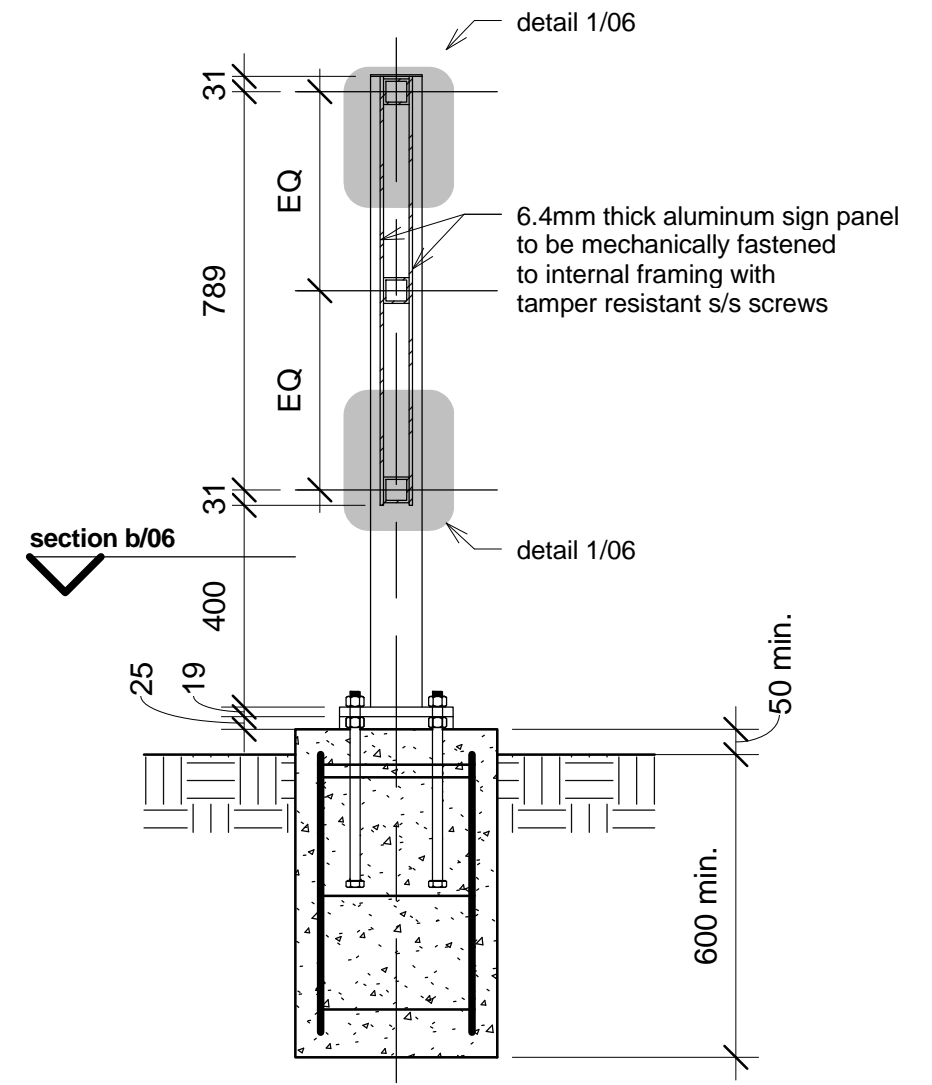


side view/section scale 1:15

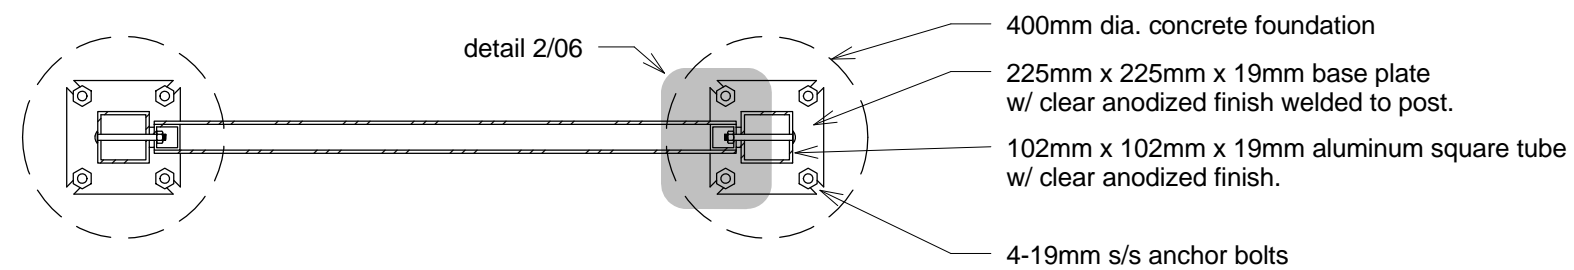


section a scale 1:15

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

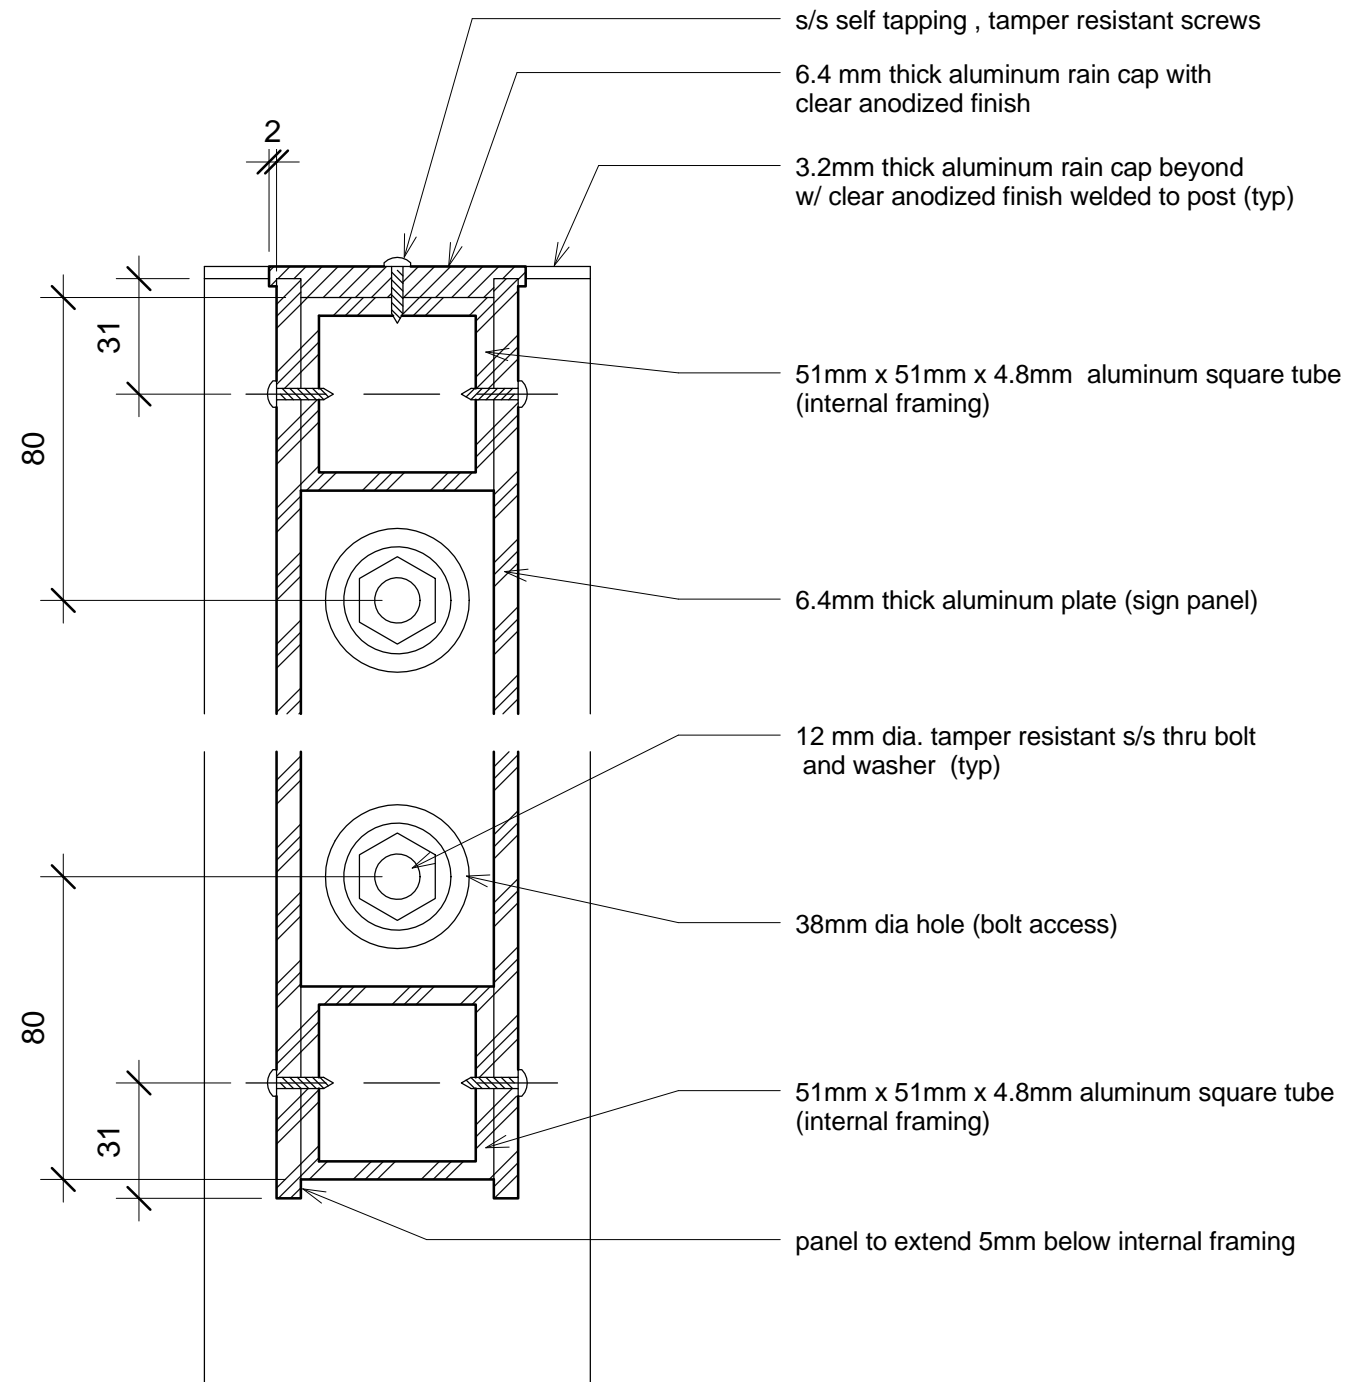


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section detail 1 scale 1:2

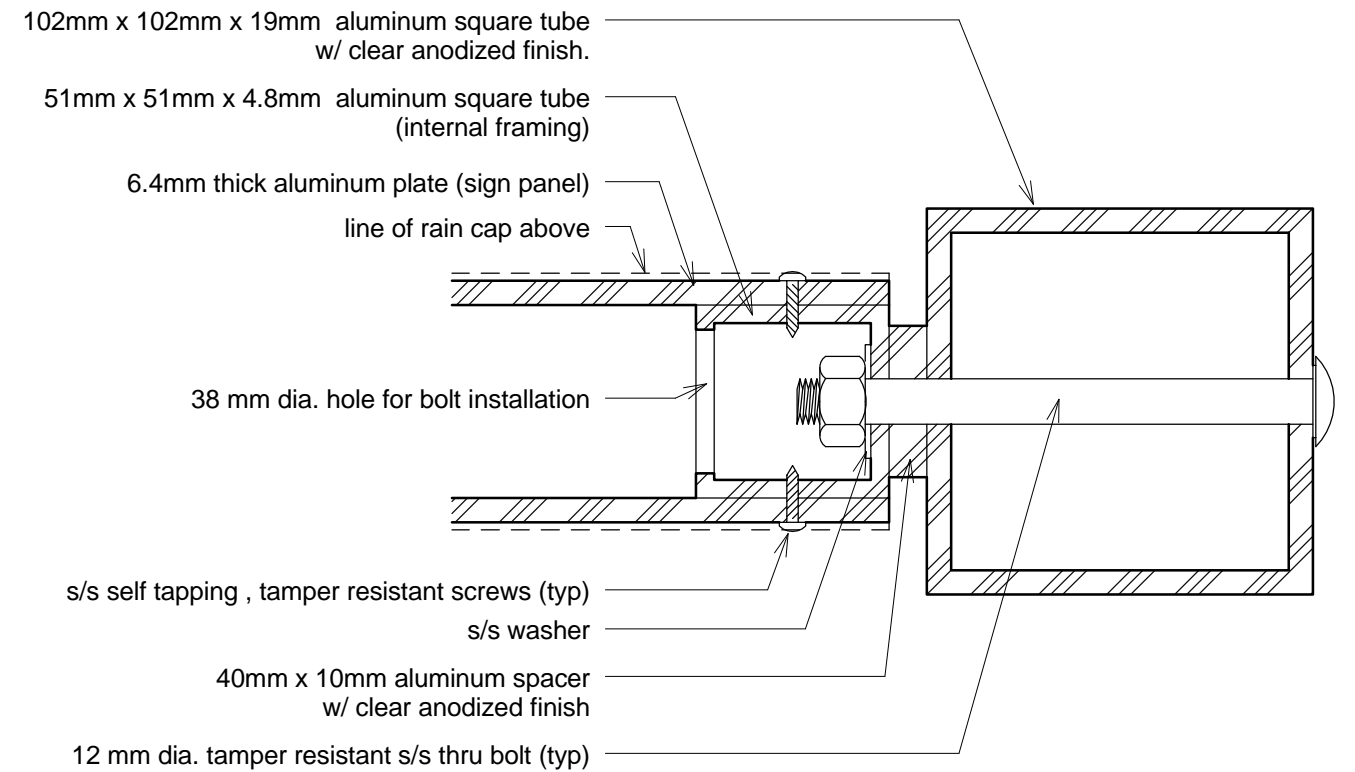

section detail 2 scale 1:2

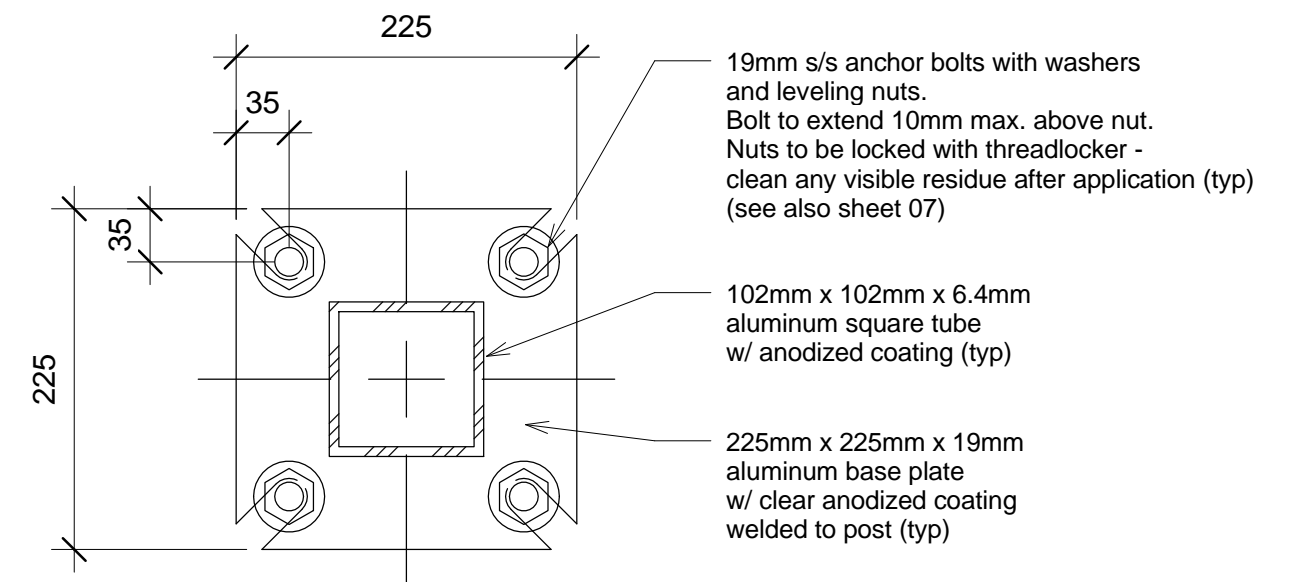

section b (slip base) scale 1:5

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #174786 (1/2" s/s x 5" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
 - rain cap attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.





Sign No. 7

Vehicular - Finnerty Gardens

Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes

project: Campus Wayfinding
 number: FM 09-8567
 issue date: Jan 31, 2012


sign: Sign No. 7 - Finnerty Gardens
 sheet name: title sheet and drawing list
 scale: as noted

sheet number: 01

core colours




clear anodized coating
application: sign structure



PANTONE 368 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
back panel (single sided sign)
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family


Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890


arrow style and arrow size in relation to text height

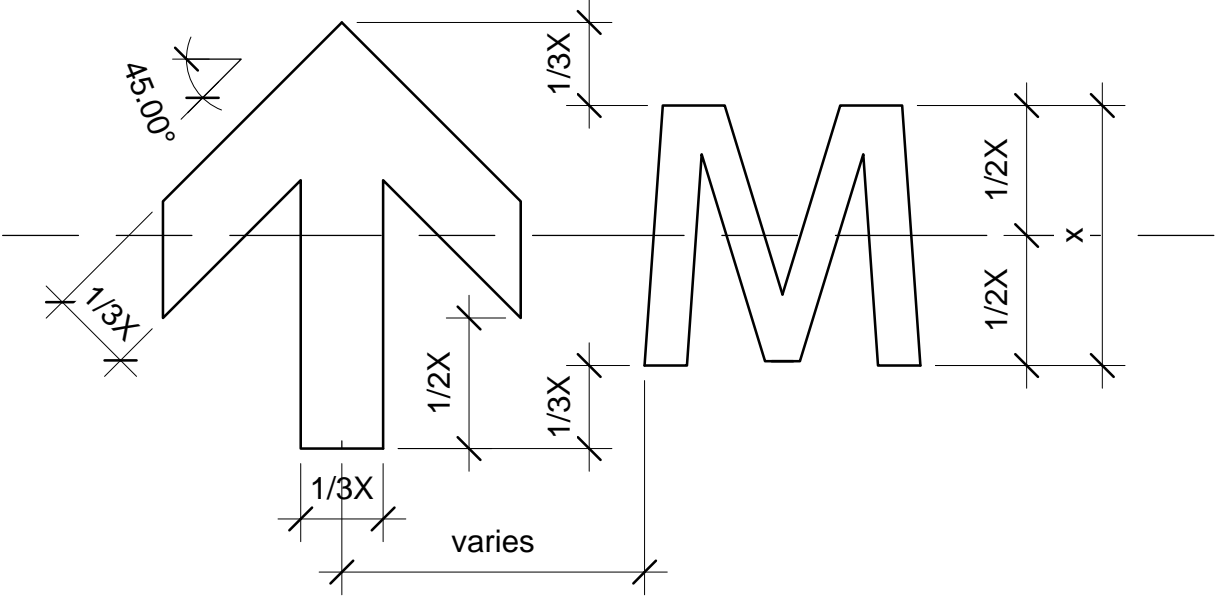


University of Victoria Logo, horizontal standard



University
of Victoria



University
of Victoria



University
of Victoria



full colour


opaque monochromatic

opaque monochromatic reversed



University
of Victoria

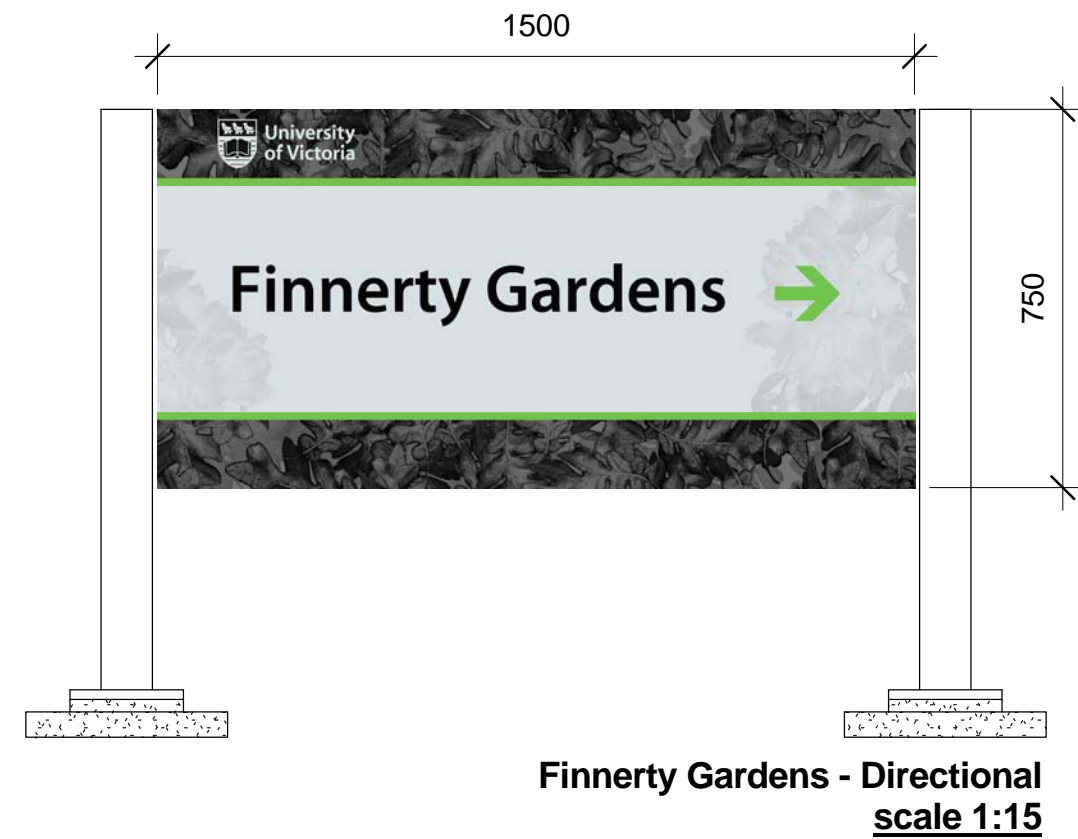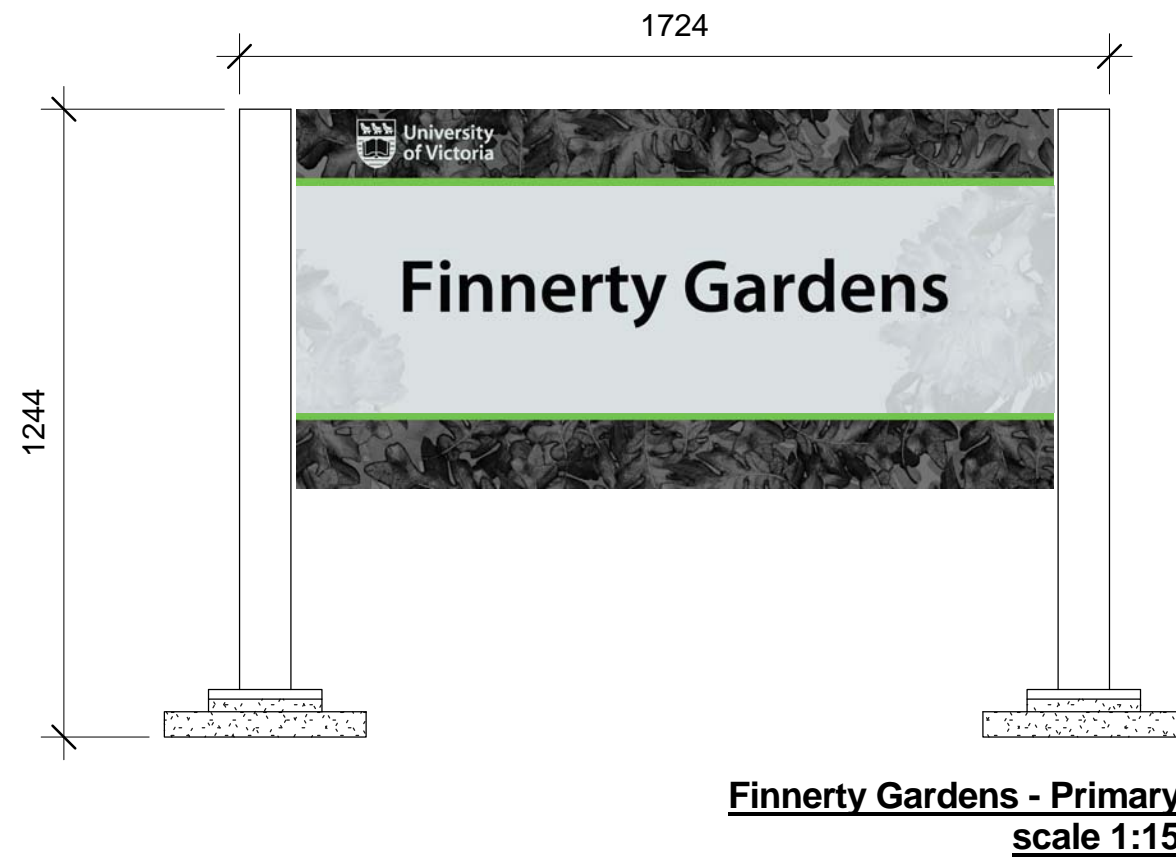

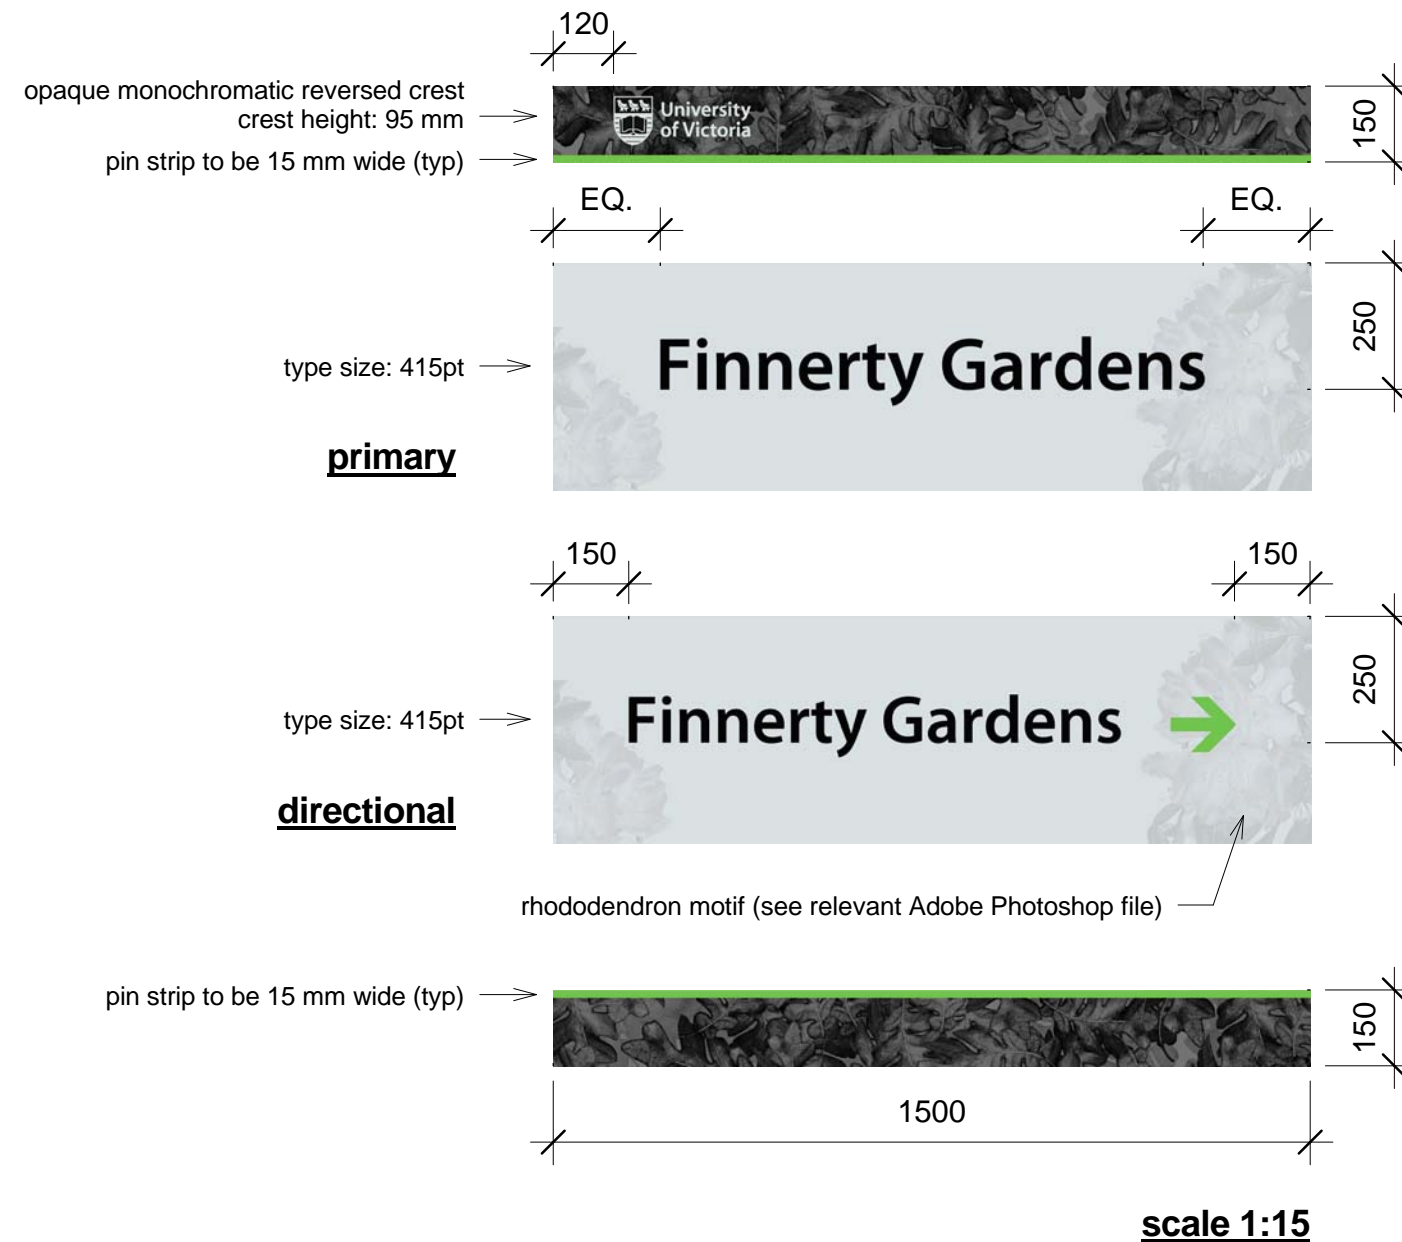


Description
Digitally printed vinyl protected with
anti-graffiti, optically clear overlaminate
Aluminum panel size (one piece): 1500 mm x 750 mm x 6.4 mm
See sheet 05 for details.


Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and overlaminate over the edges of the aluminum panel.
- 4) If single sided sign then back panel to receive vinyl printed with PANTEONE 7541 C


Refer to Adobe Photoshop files for detailed sample layout

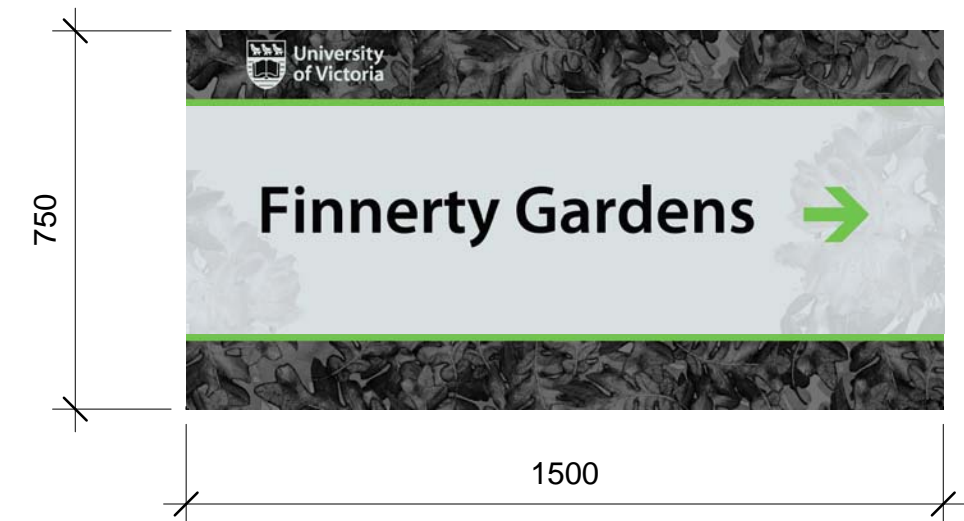


scale 1:15

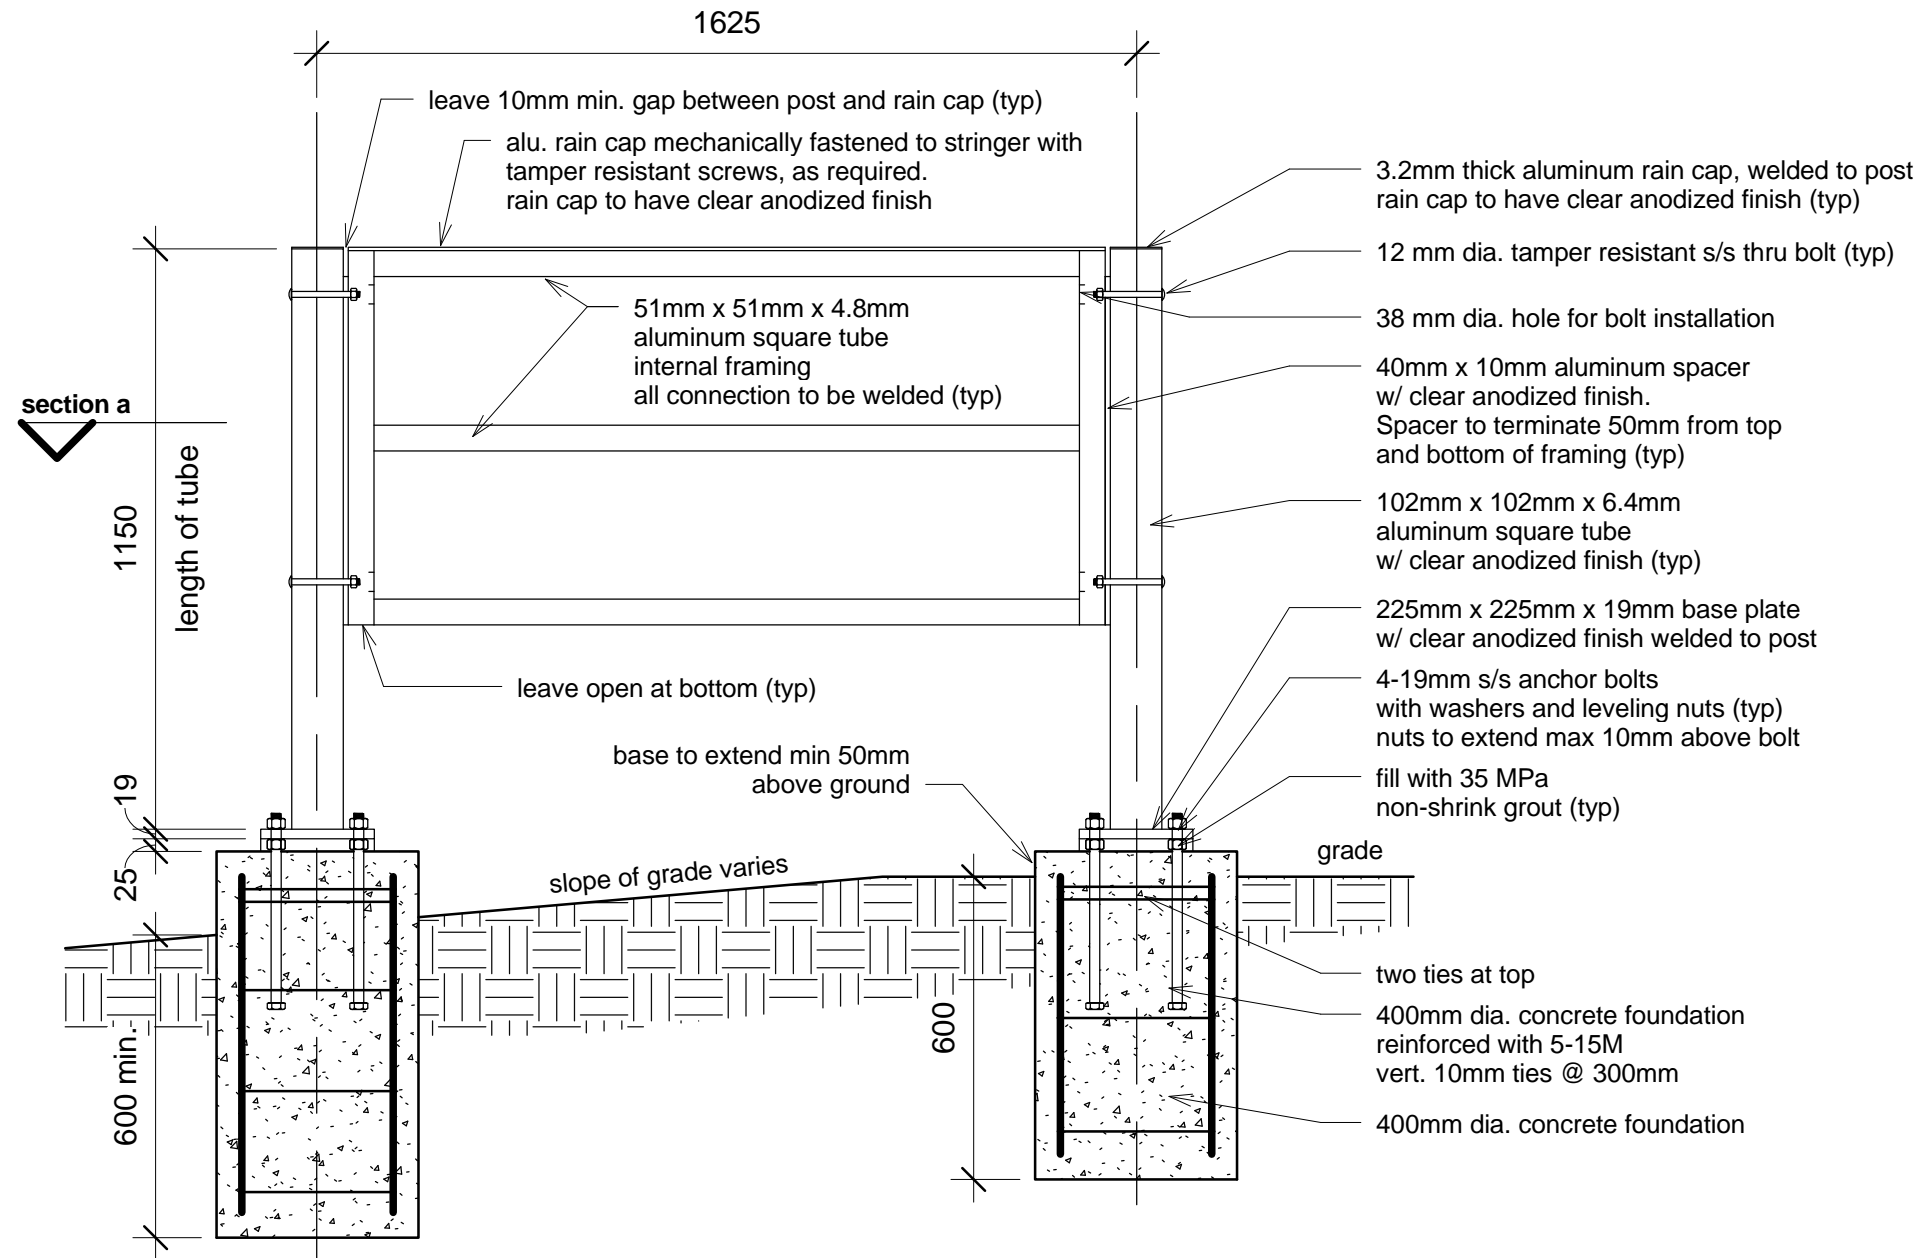

front view/section scale 1:15

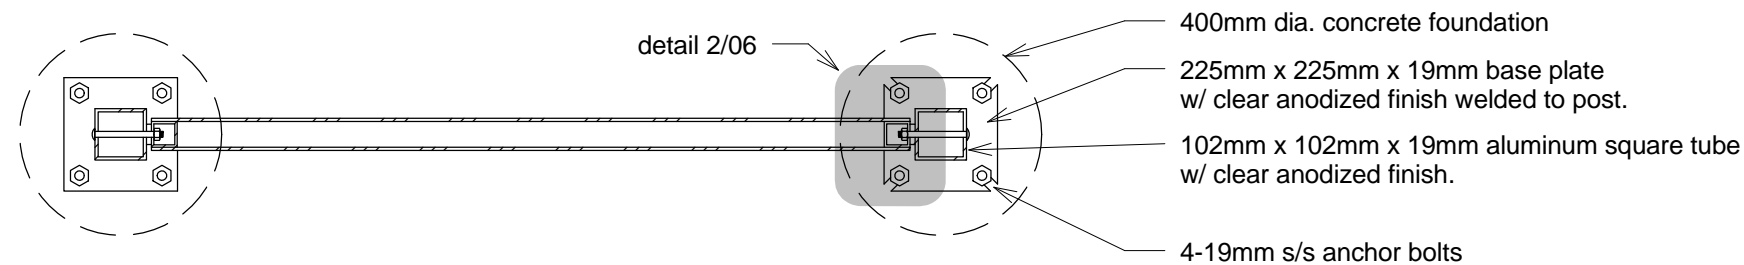


section a scale 1:15

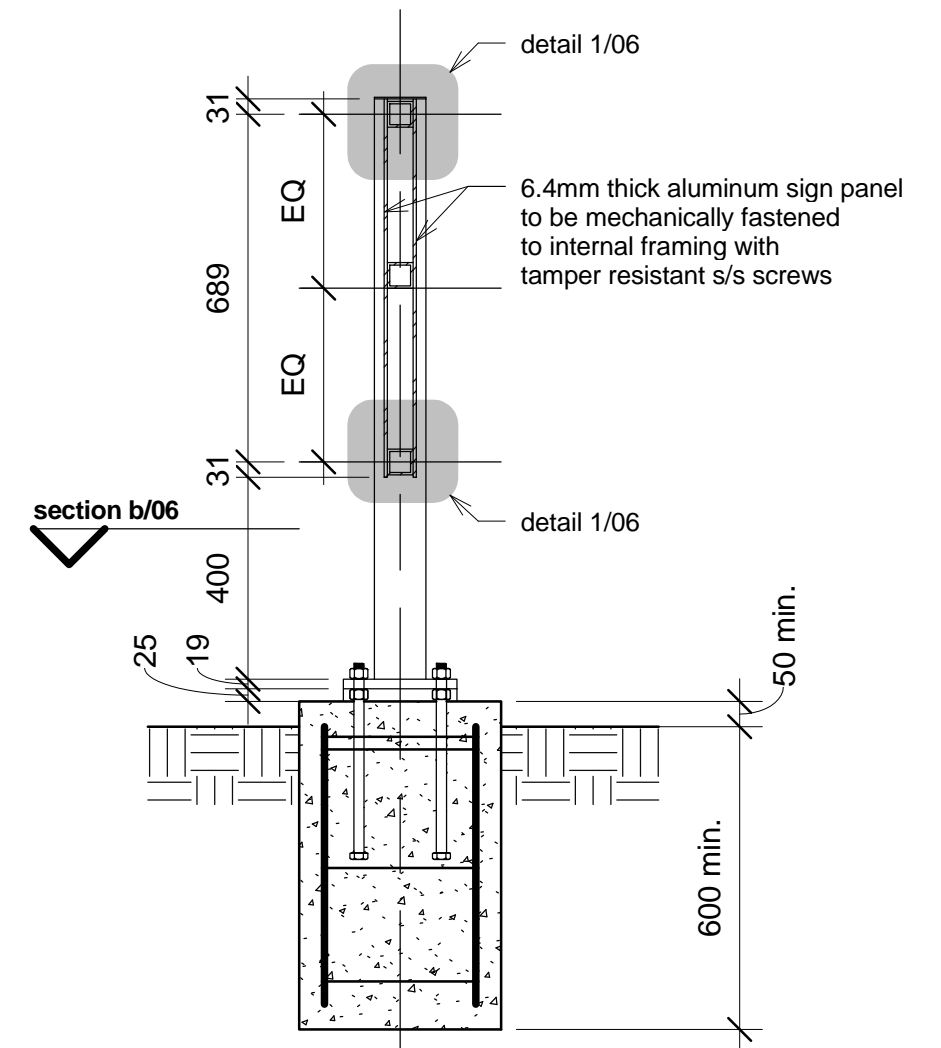


side view/section scale 1:15

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

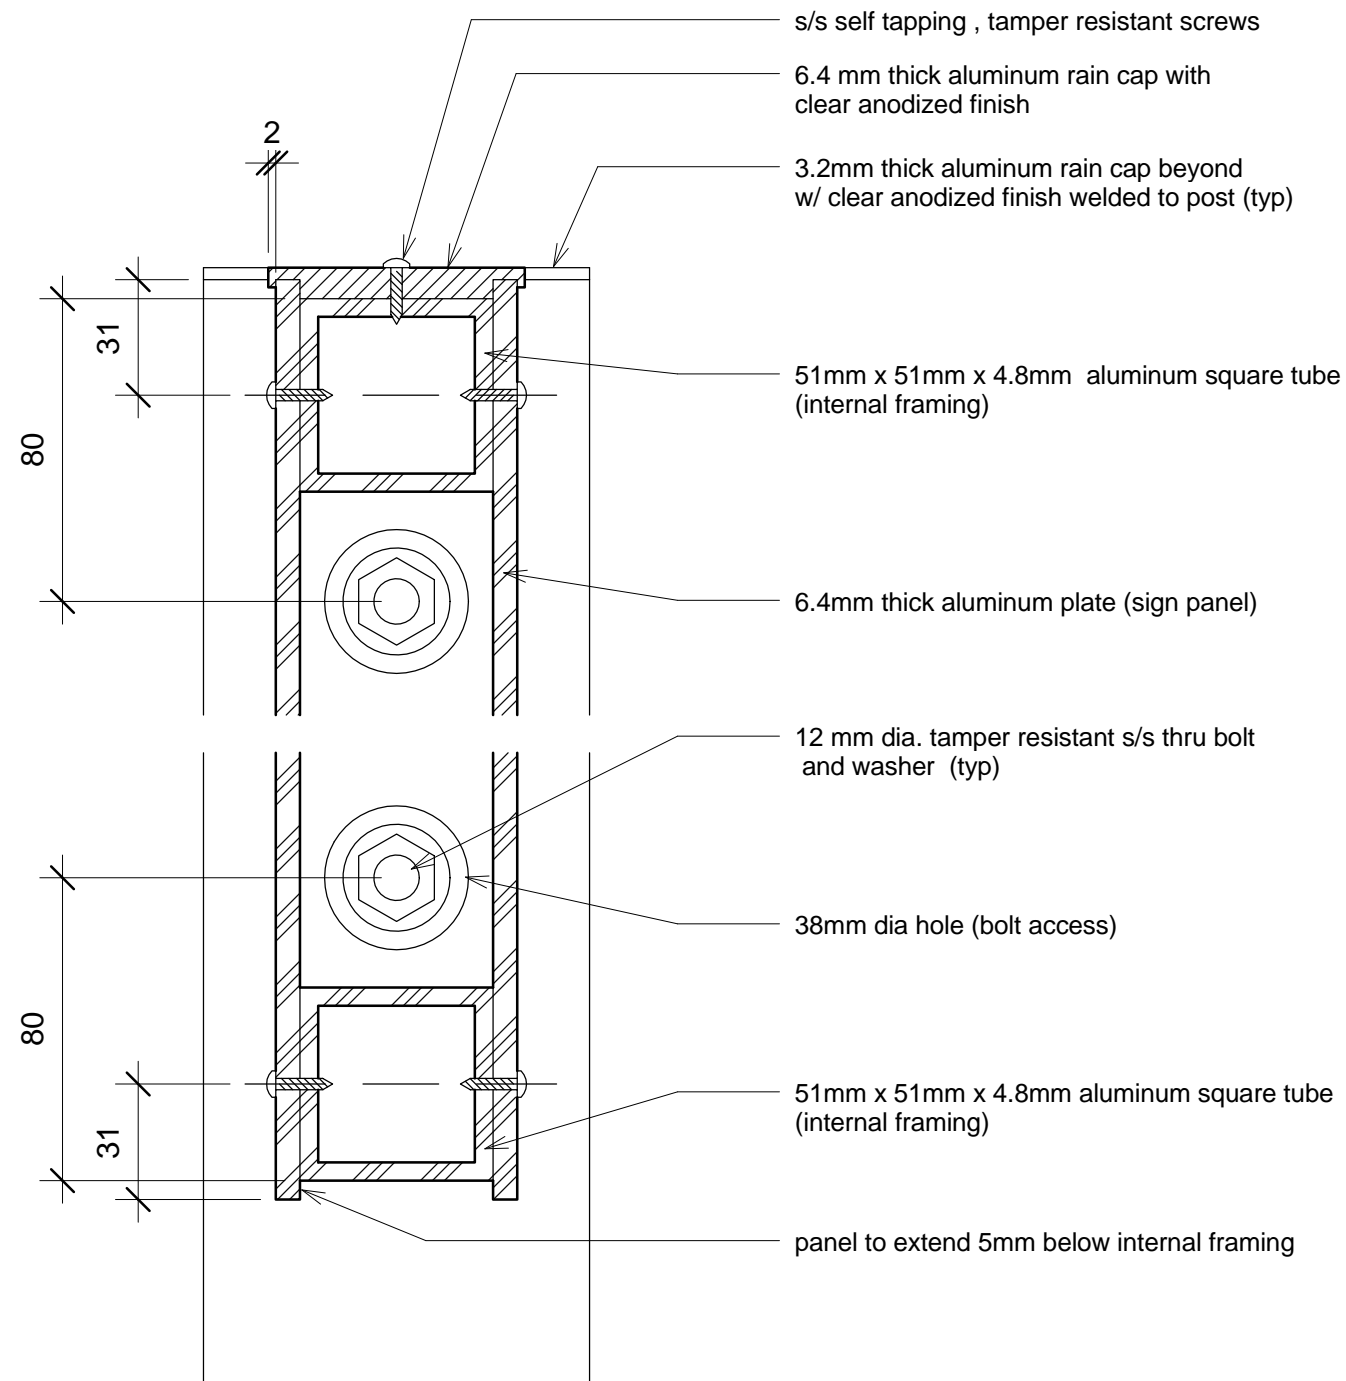


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section detail 1 scale 1:2

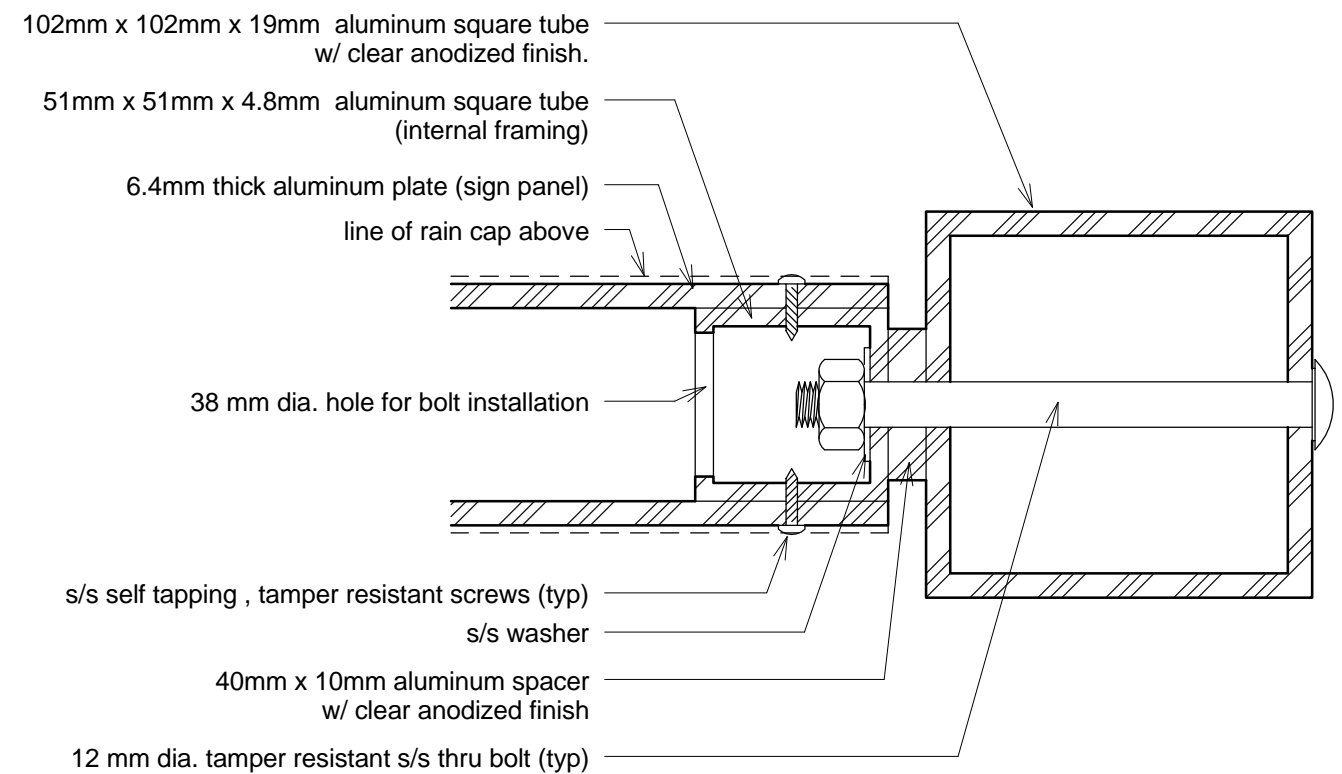

section detail 2 scale 1:2

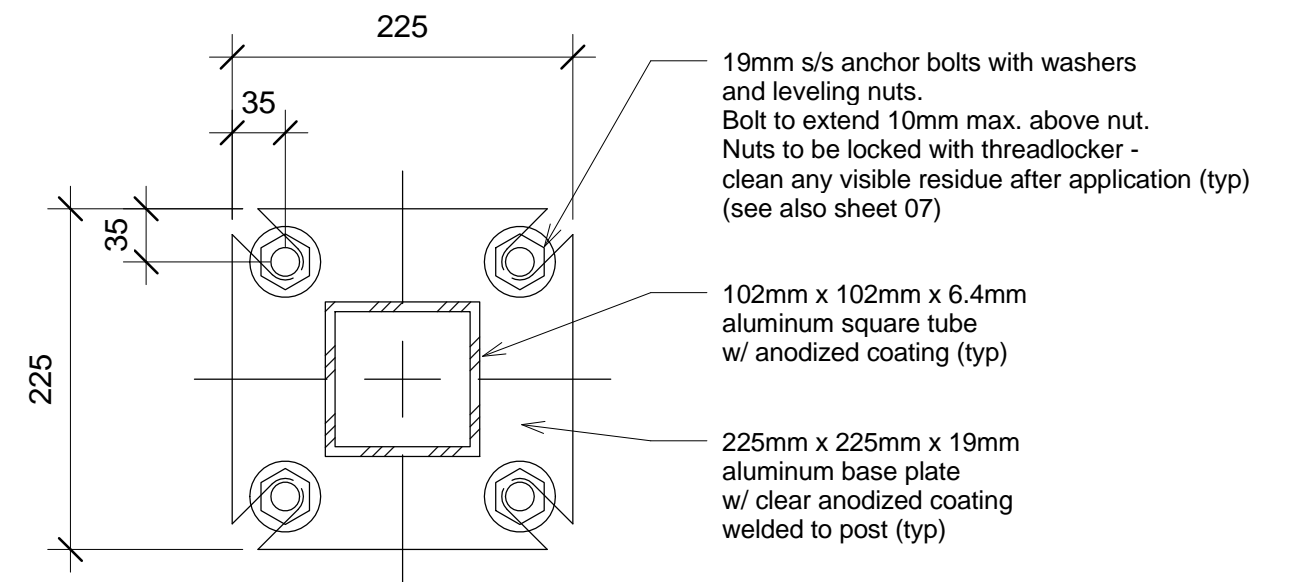

section b (slip base) scale 1:5

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 7 - Finnerty Gardens
sheet name: sign construction - details
scale: as noted

sheet
number:

06



**University
of Victoria**

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
- Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #174786 (1/2" s/s x 5" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
 - rain cap attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - overview cont.
05	sign design - graphic design details
06	sign design - graphic design details cont.
07	sign construction - cross section
08	sign construction - section plans
09	sign construction - painted canopy plan and details
10	sign construction - details
11	typical concrete slab
12	general notes




Sign No. 8

Pedestrian - Map Directory Kiosk


core colours



clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
crest - reversed monochromatic




garry oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

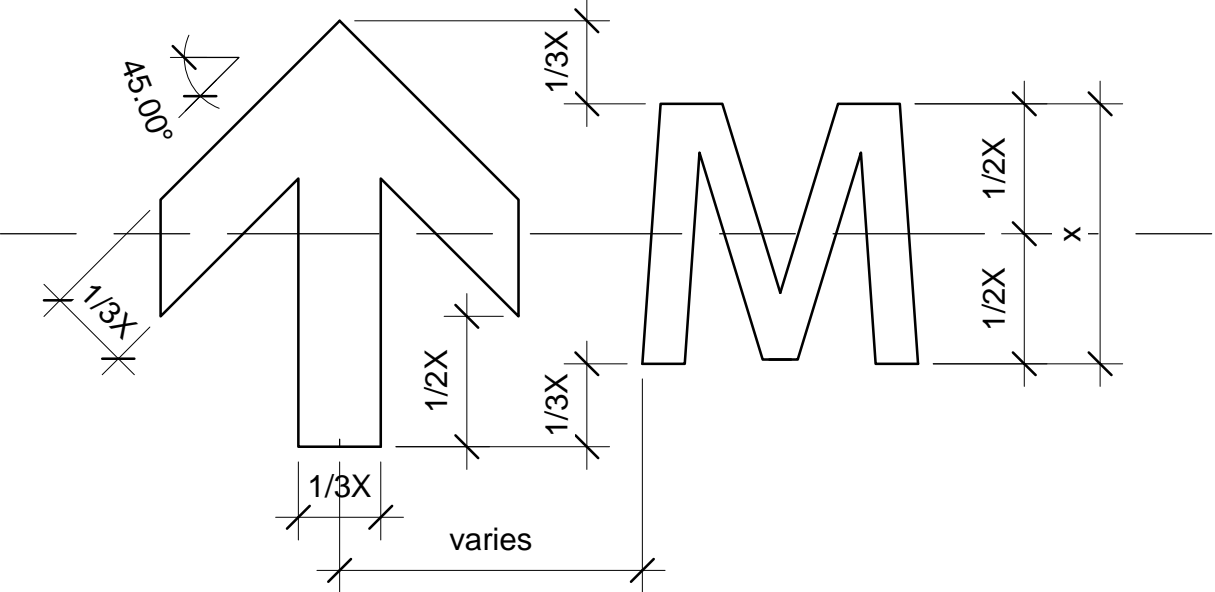


University of Victoria Logo, horizontal standard




University
of Victoria

full colour



University
of Victoria

opaque monochromatic




University
of Victoria

opaque monochromatic reversed





side elevation scale 1:20

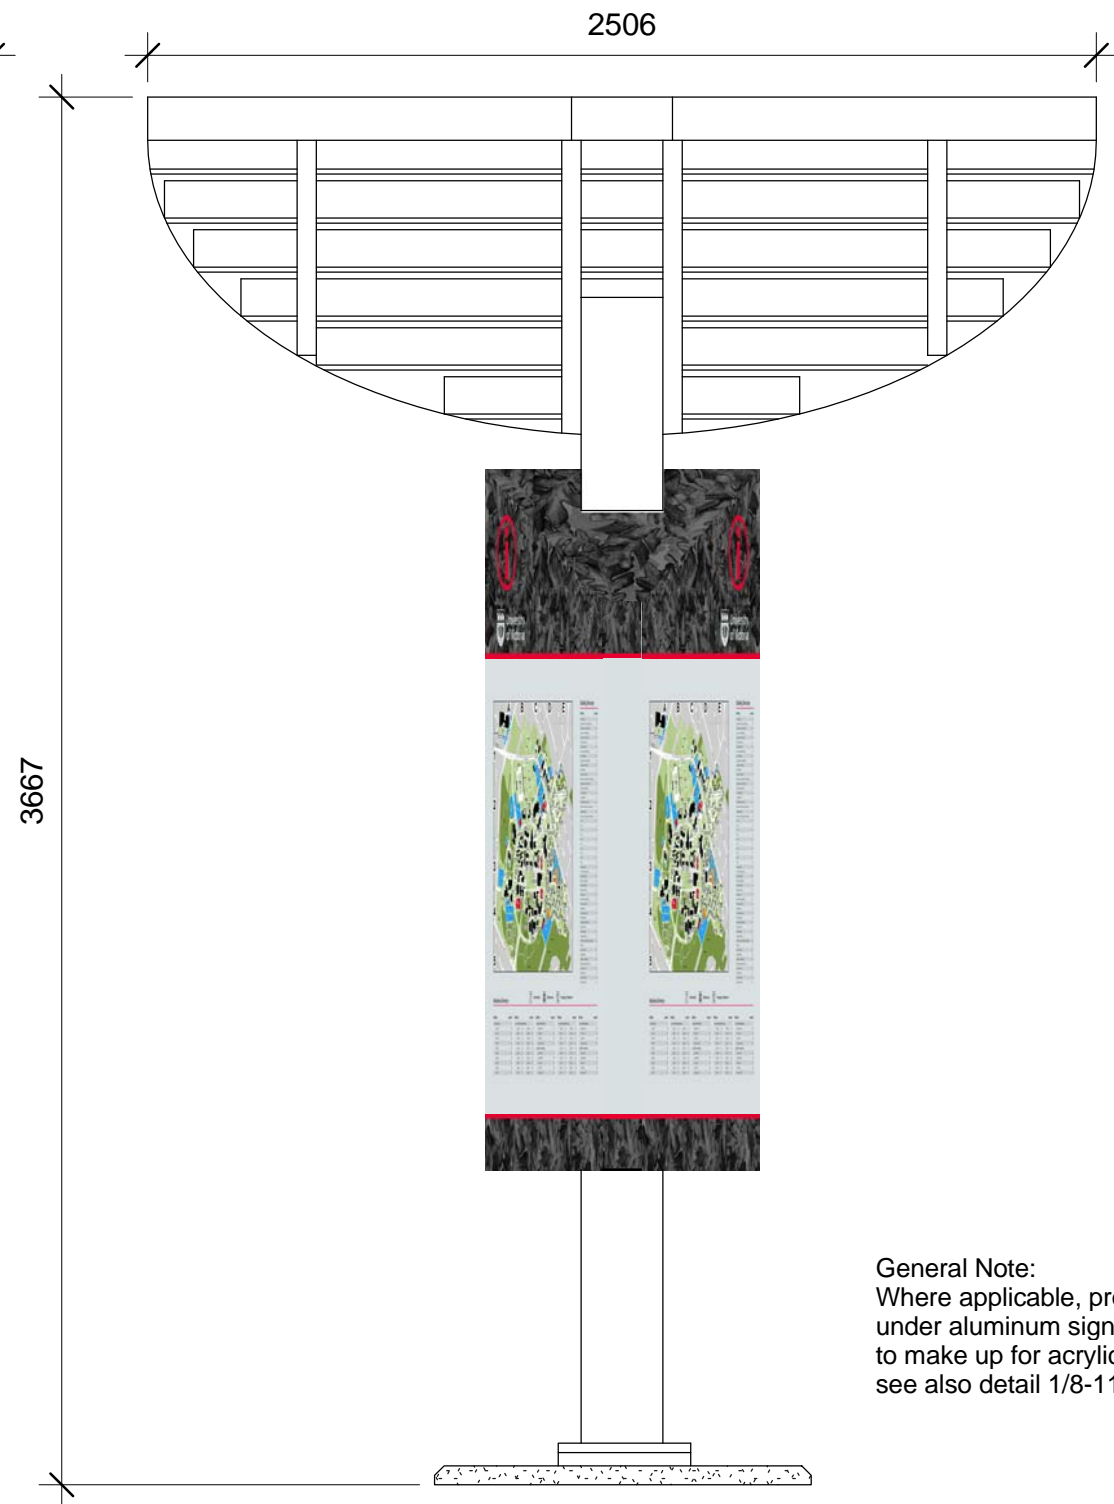

front elevation scale 1:20

General Note:
Where applicable, provide 6.4mm thick aluminum spacer
under aluminum sign panels
to make up for acrylic panel thickness
see also detail 1/8-11

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 8 Pedestrian Map Directory Kiosk
sheet name: sign design - overview
scale: as noted

sheet
number:


03



**University
of Victoria**

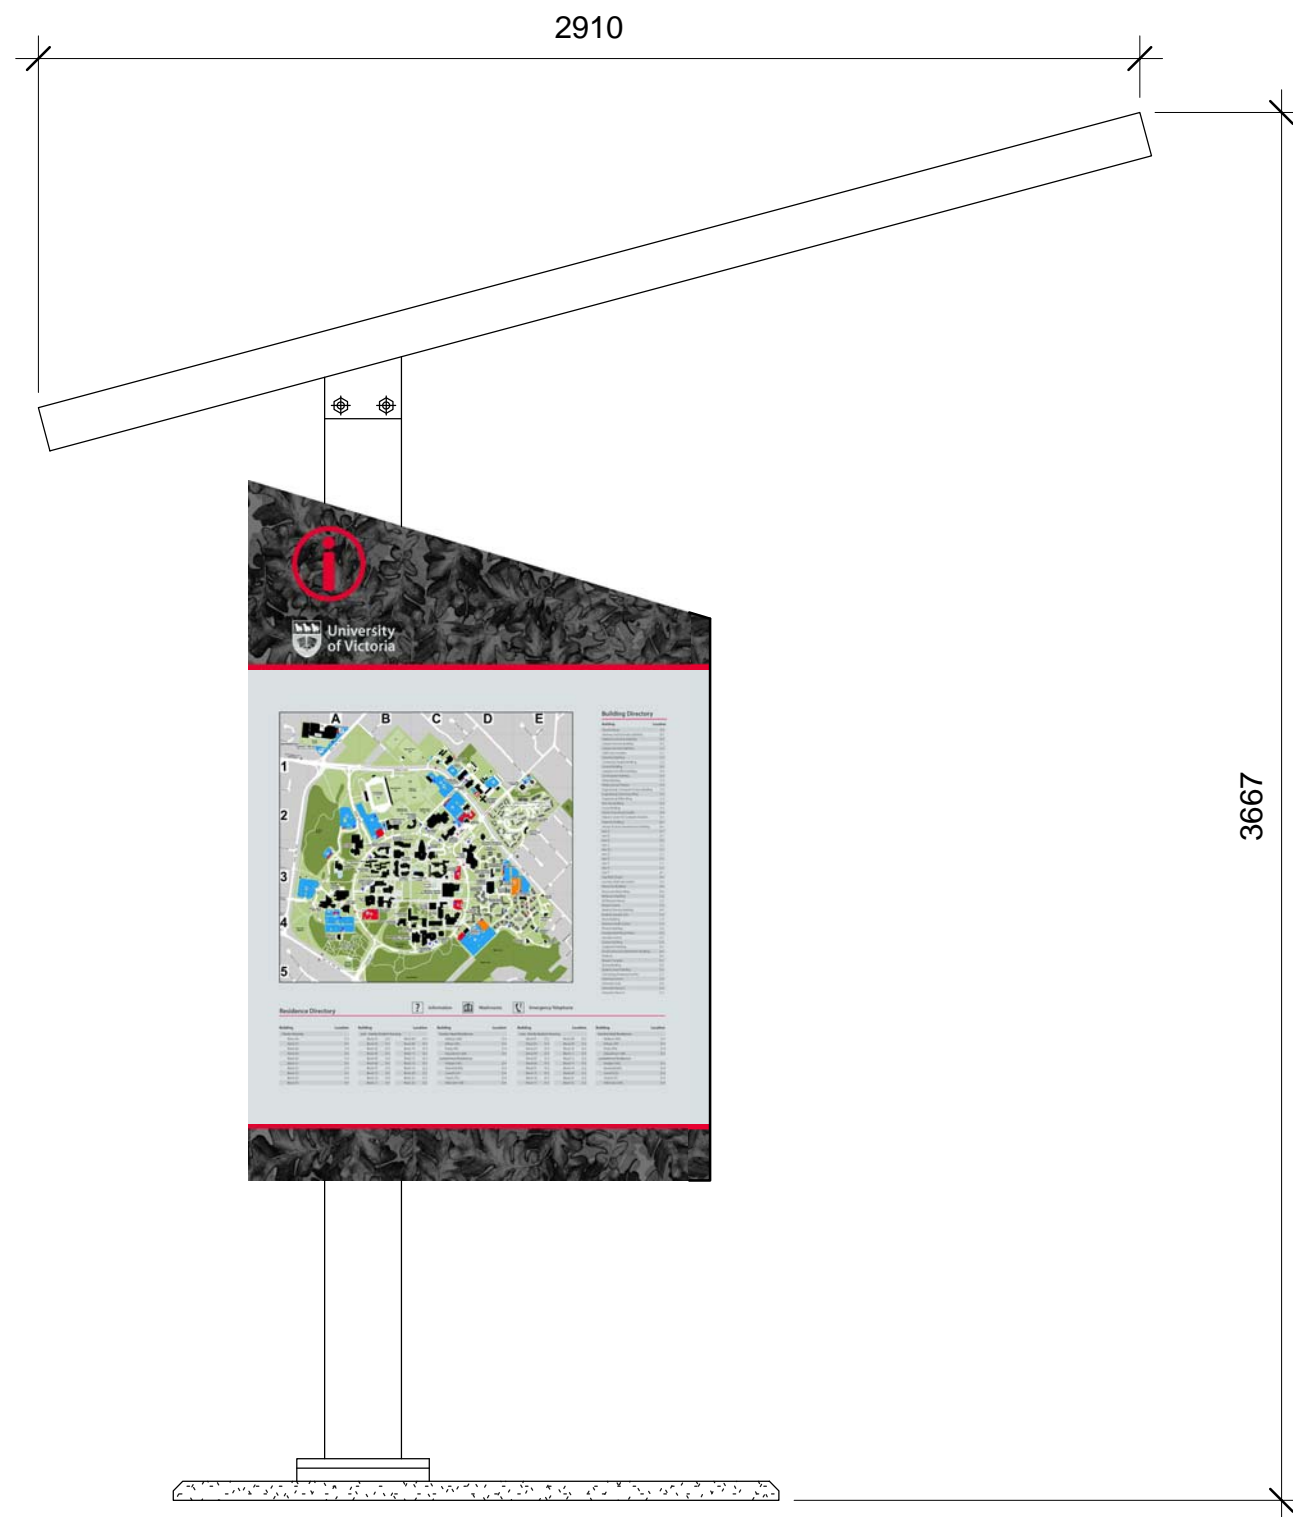

side elevation scale 1:20

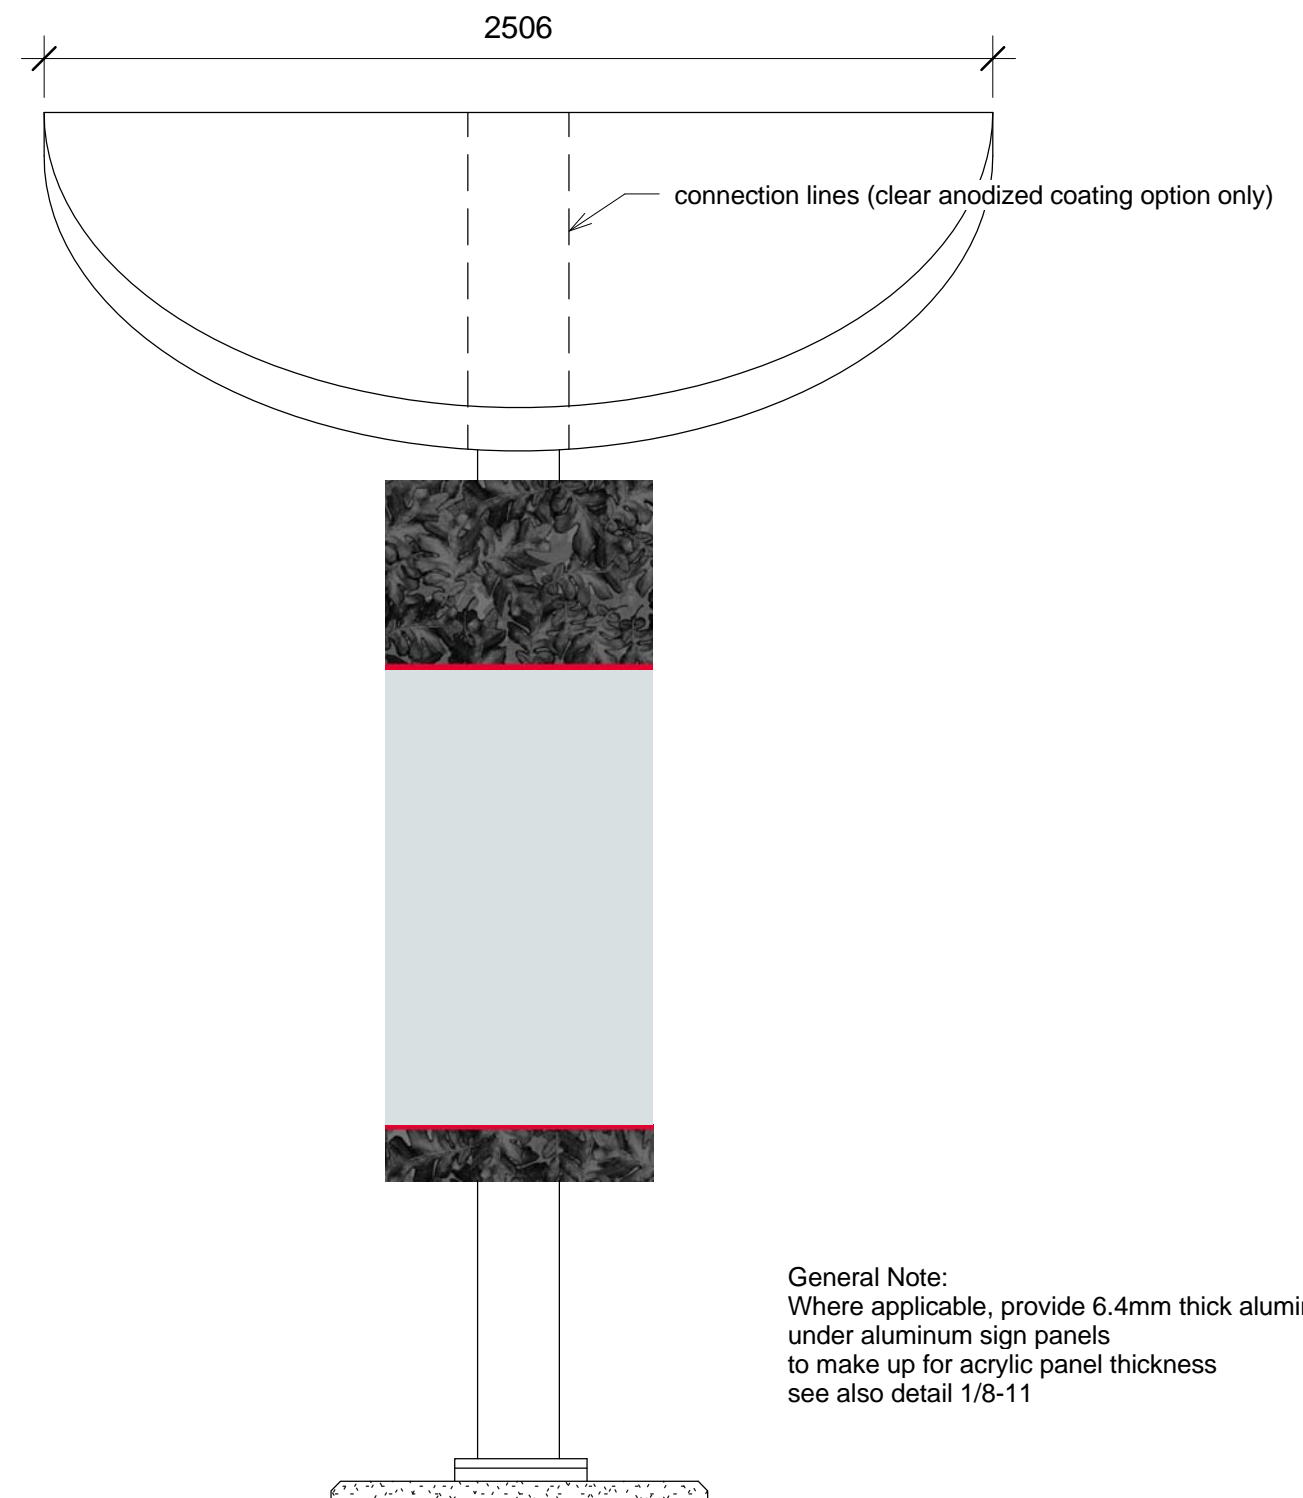

General Note:
Where applicable, provide 6.4mm thick aluminum spacer
under aluminum sign panels
to make up for acrylic panel thickness
see also detail 1/8-11

back elevation scale 1:20

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 8 Pedestrian Map Directory Kiosk
sheet name: sign design - overview cont.
scale: as noted

sheet
number:


04




**University
of Victoria**

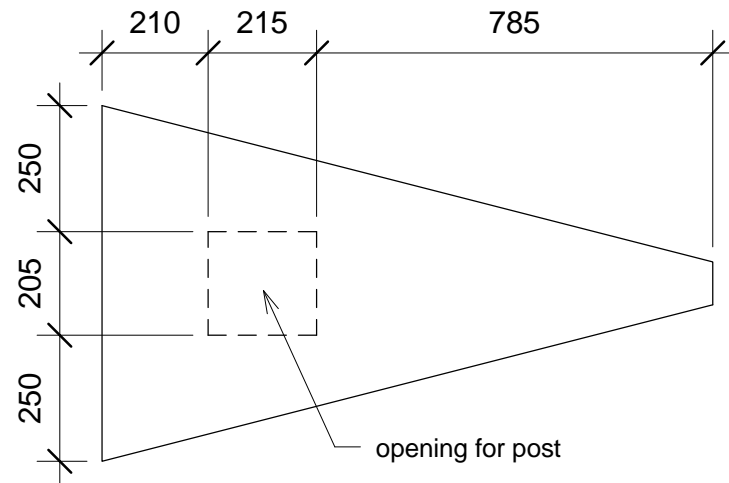

top panel:
3.2mm thick aluminum with
digitally printed vinyl (Gary Oak motif)
protected with anti-graffiti,
optically clear overlaminate.

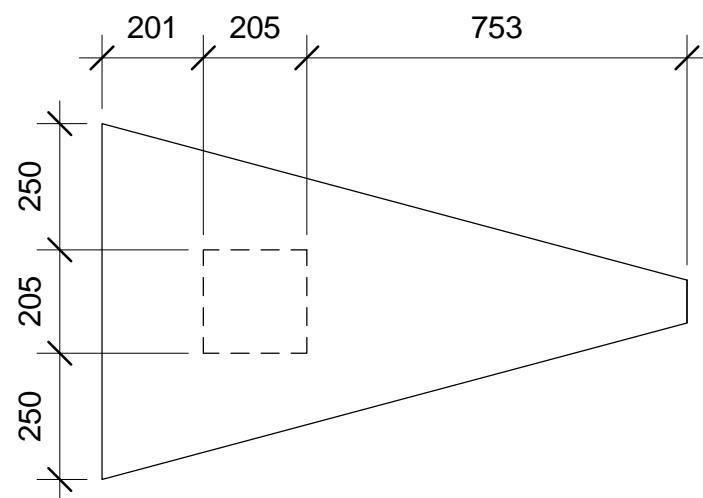


bottom panel:
3.2 mm thick aluminum with
clear anodized coating

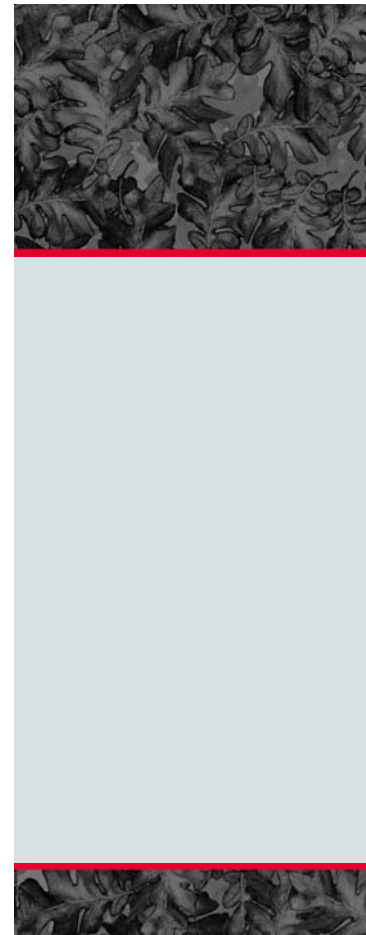

back panel:
Digitally printed vinyl protected
with anti-graffiti,
optically clear overlaminate.
Aluminum panel size:
710 mm x 1848 mm x 3.2 mm



Digitally printed vinyl protected with
anti-graffiti, optically clear overlaminate.
19mm thick acrylic push-thru pictogram
Aluminum panel size:
1190 mm x 500 mm x 3.2 mm

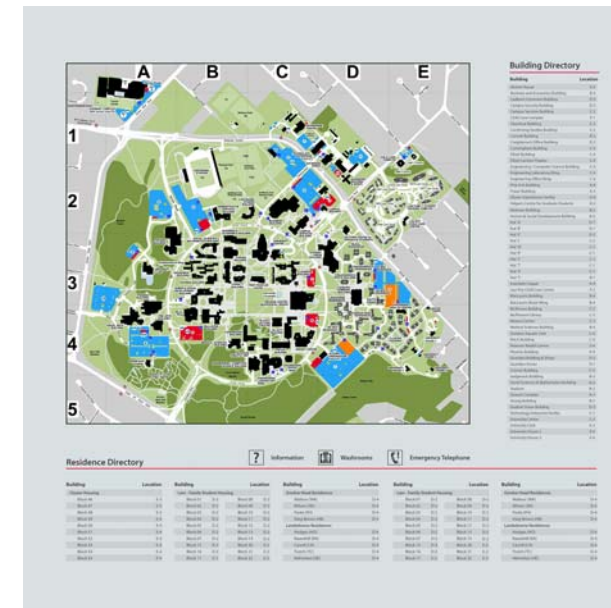

non-glare clear acrylic panel,
digitally printed-on vinyl, diffusion layer.
Acrylic panel size: 1200 mm x 1200 mm x 6.4 mm



Digitally printed vinyl protected with
anti-graffiti, optically clear overlaminate.
Aluminum panel size:
1190 mm x 150 mm x 3.2 mm

Non-glare clear acrylic:
Plaskolite OPTIX Abrasion Resistant Non-Glare
or equivalent.
Clear acrylic (pictograms):
Plaskolite OPTIX, Chemcast GP or equivalent

First surface prints:
Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlaminate: 3M 8914, Avery DOL 6060 or equivalent.

2nd surface prints:
CAV-50 reverse print - i/w/i (2nd surface)
Overlaminate: 3M 8914, Avery DOL 6060
or equivalent (first surface)

- 1) Vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Where applicable wrap vinyl and overlaminate over the edges of the alu. panel.
- 4) All panels to be mechanically fastened to substrate.
- 5) Directory map shown for reference only. directory map with all associated texts and pictograms to be provided in digital format by University of Victoria
- 6) Manufacturer to confirm all dimensions prior to fabrication.

General note:
Manufacturer to confirm all dimensions
prior to fabrication.

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 8 Pedestrian Map Directory Kiosk
sheet name: sign design - graphic design details
scale: as noted

sheet
number:



05

opaque monochromatic reversed
crest height: 95 mm

pin strip to be 15 mm wide (typ)



19mm thick clear acrylic glued to inside face of aluminum panel.
Red translucent vinyl applied to front of push through pictogram
and white diffuser vinyl applied on the back face.

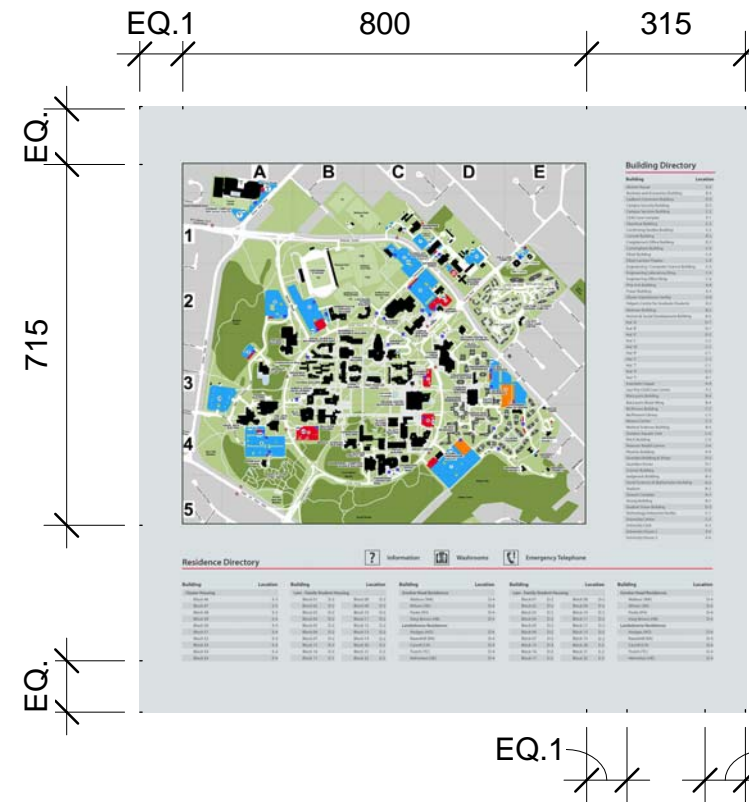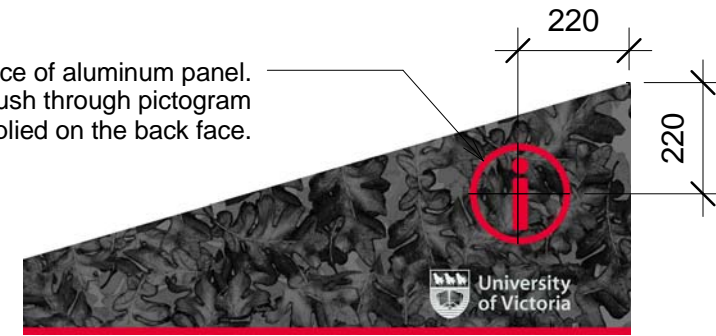


← type size: 50pt

← type size: 22pt

directory map shown for
reference only.
current directory map to be provided
in digital format
by University of Victoria

pin strip to be 15 mm wide (typ)

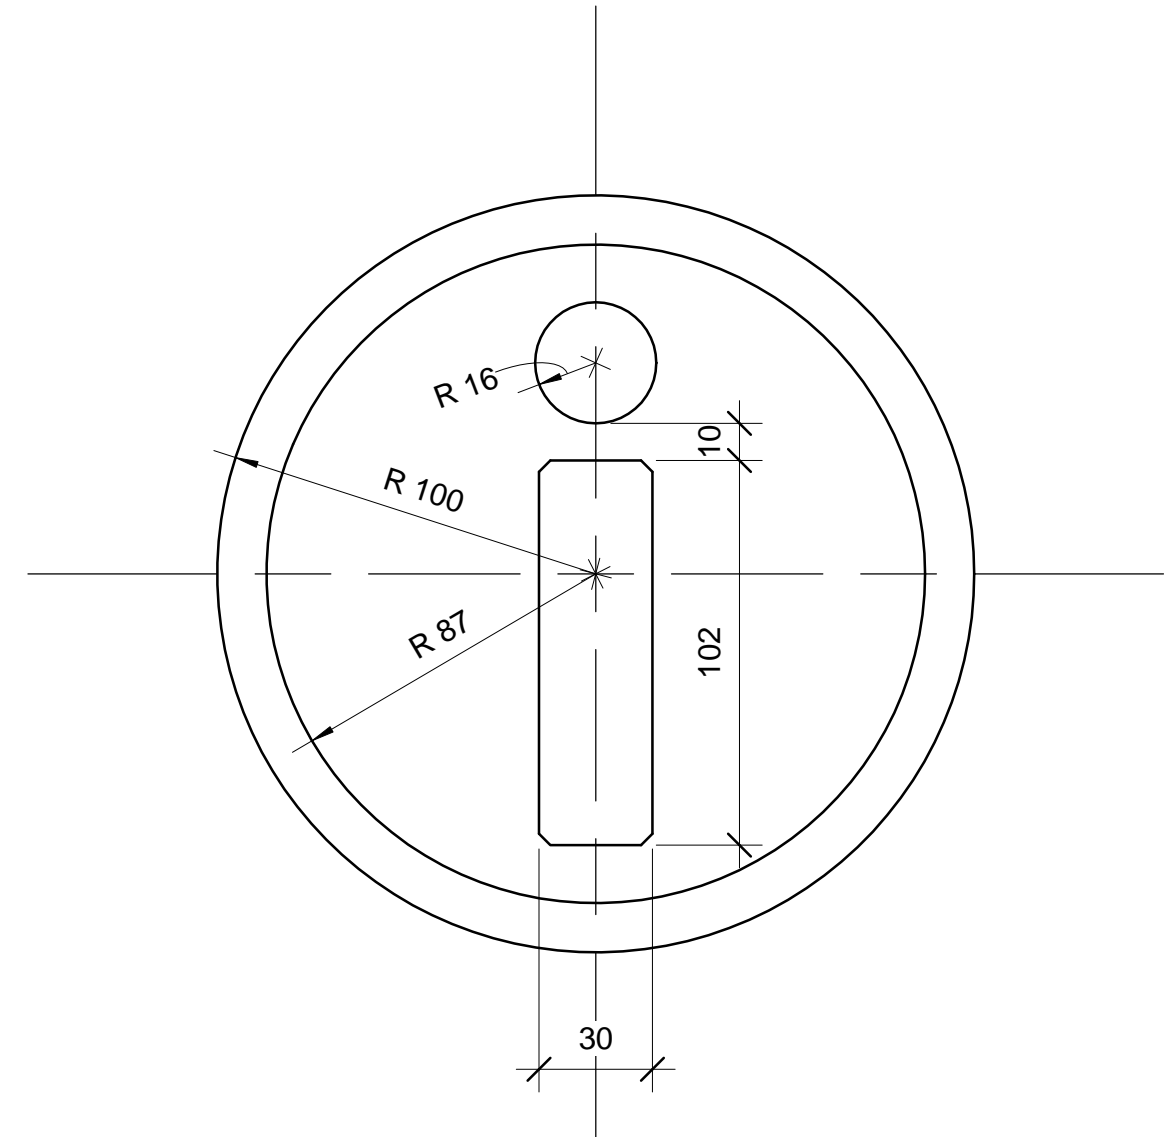


General note:
Manufacturer to confirm all dimensions
prior to fabrication.

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 8 Pedestrian Map Directory Kiosk
sheet name: sign design - graphic design details cont.
scale: as noted

sheet
number:


06

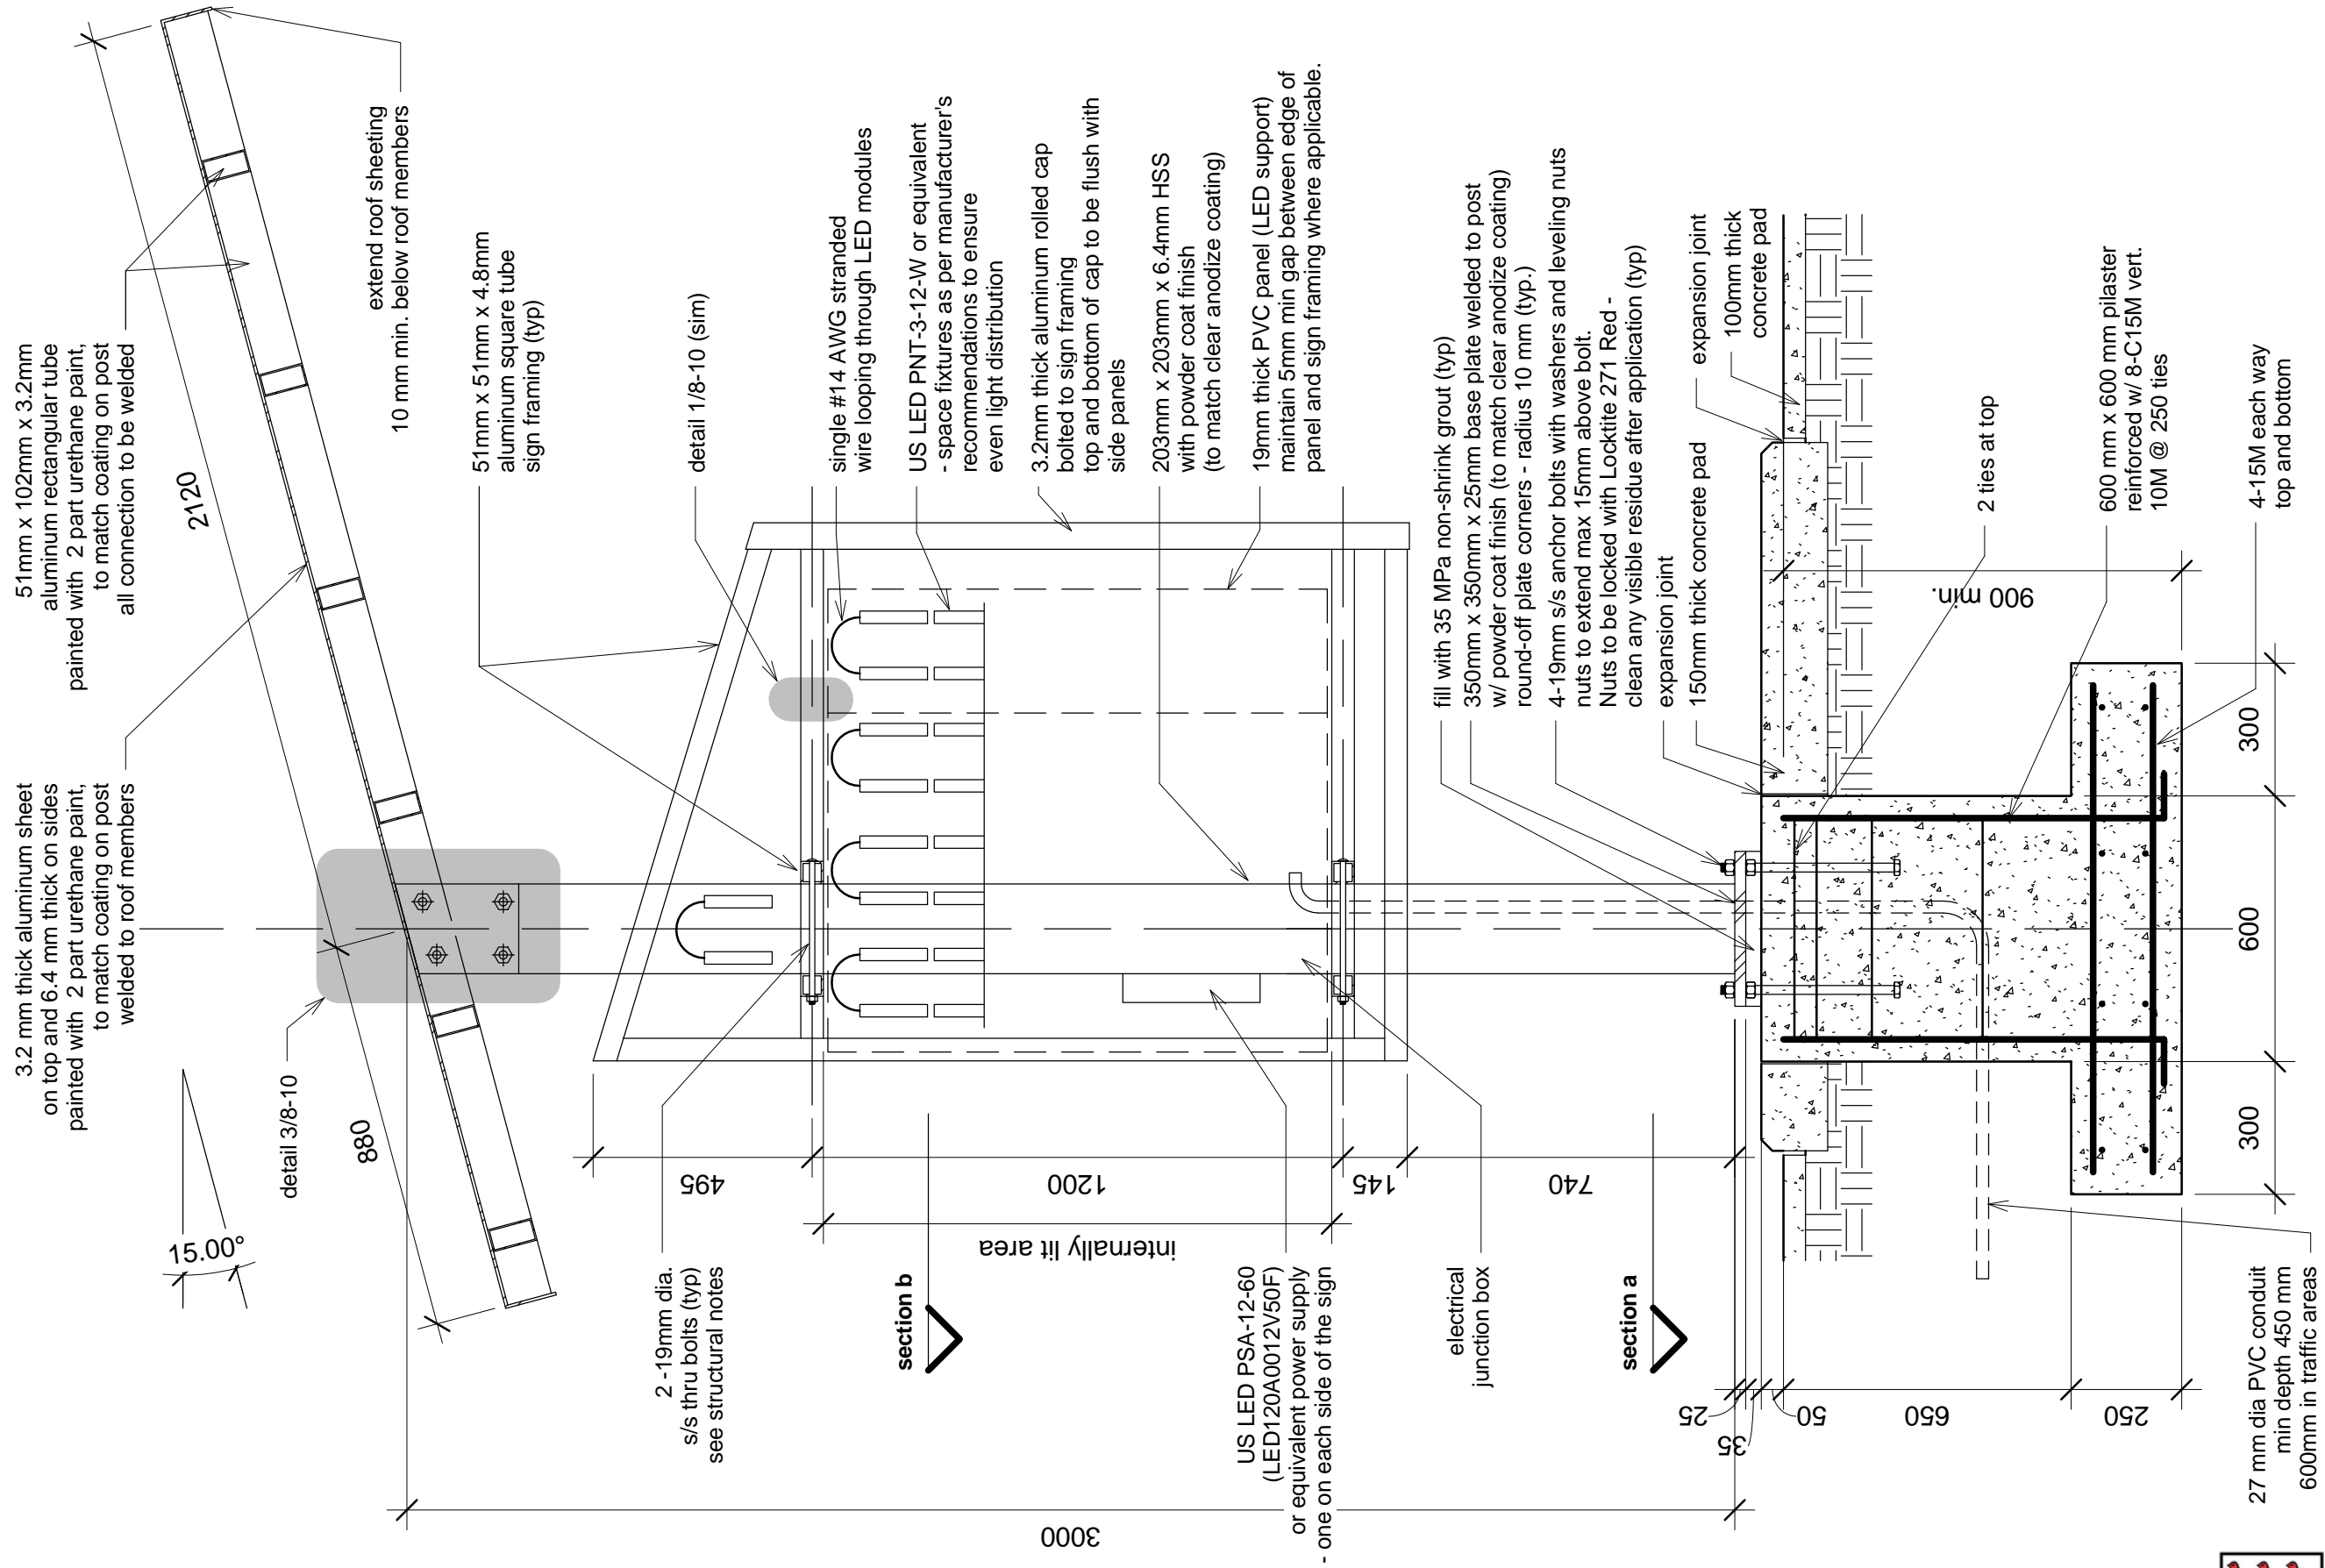


long section scale 1:15

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

- 1) provide ventilation holes as required
- 2) US LED PSA-12-60 power supply to LED source of power to a maximum of 50 MegaBright 12 LED Modules
- 3) Sign must have a CSA label as an assembly

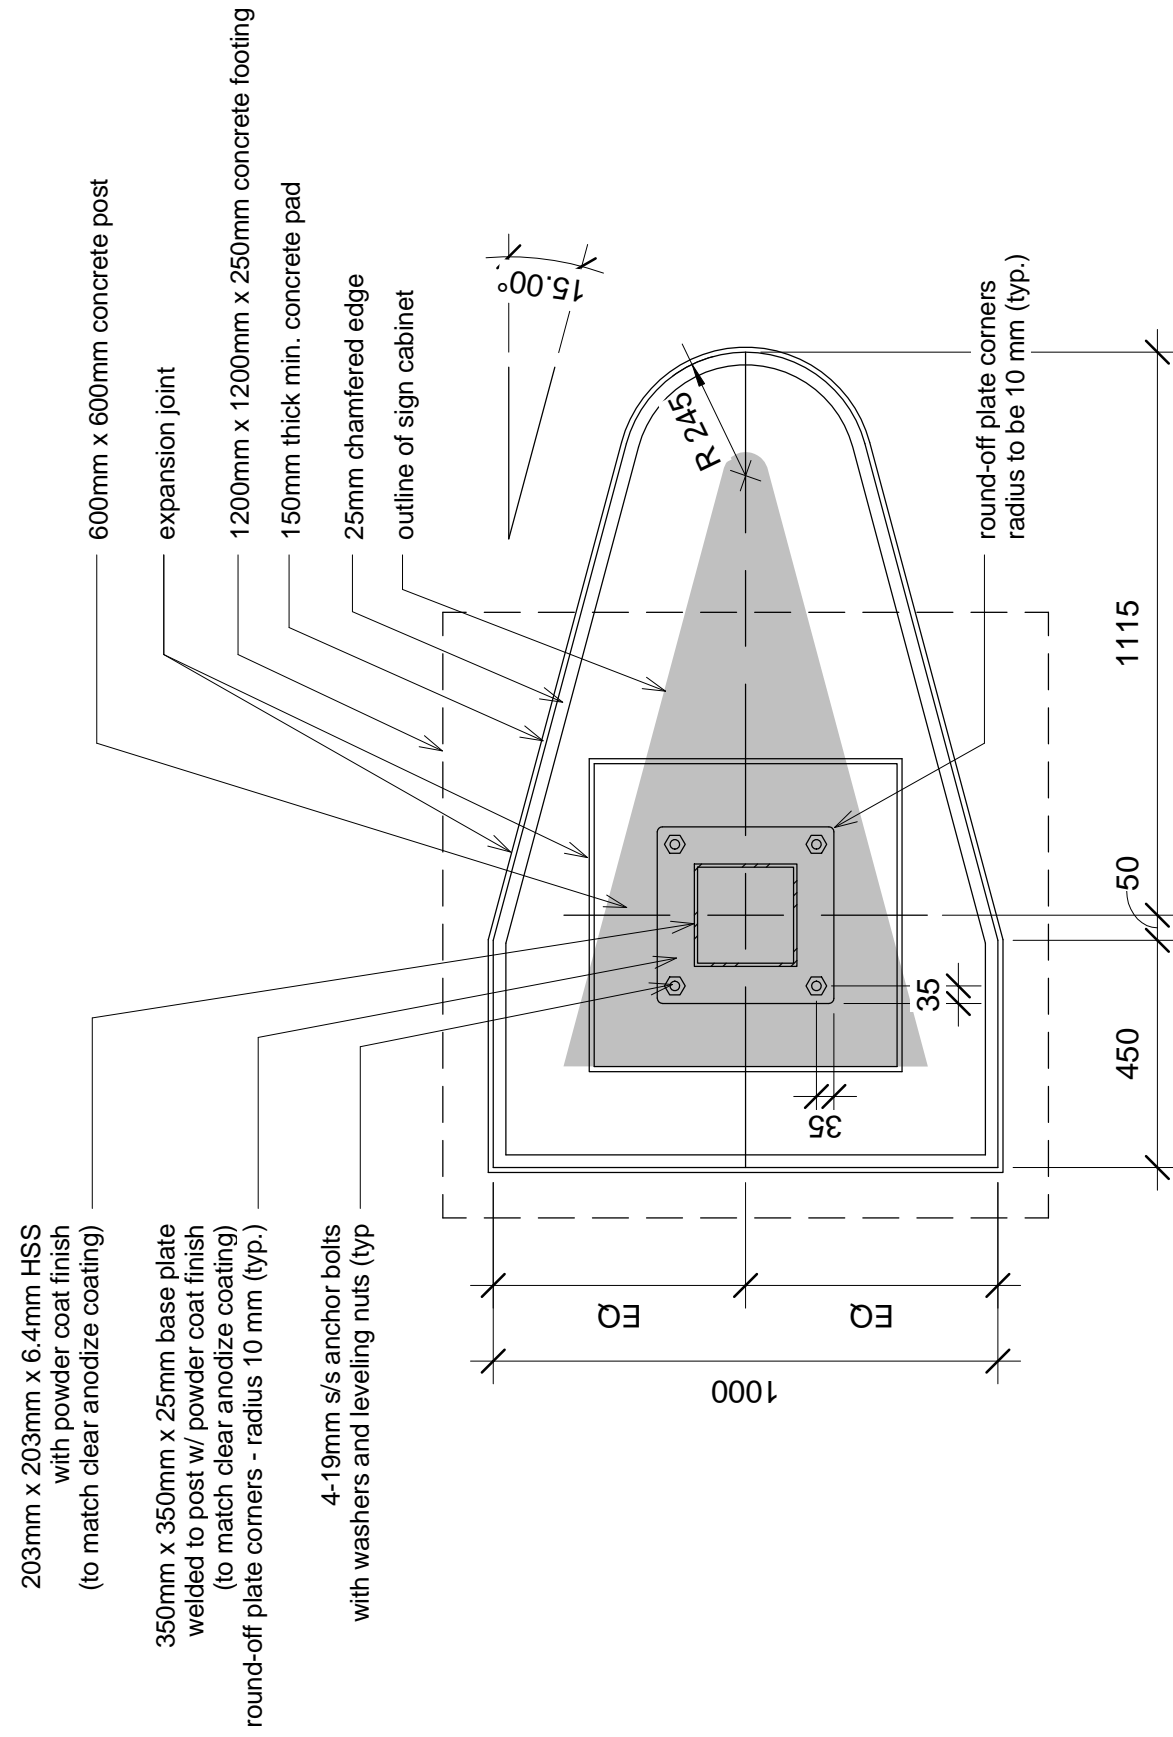

section a scale 1:15

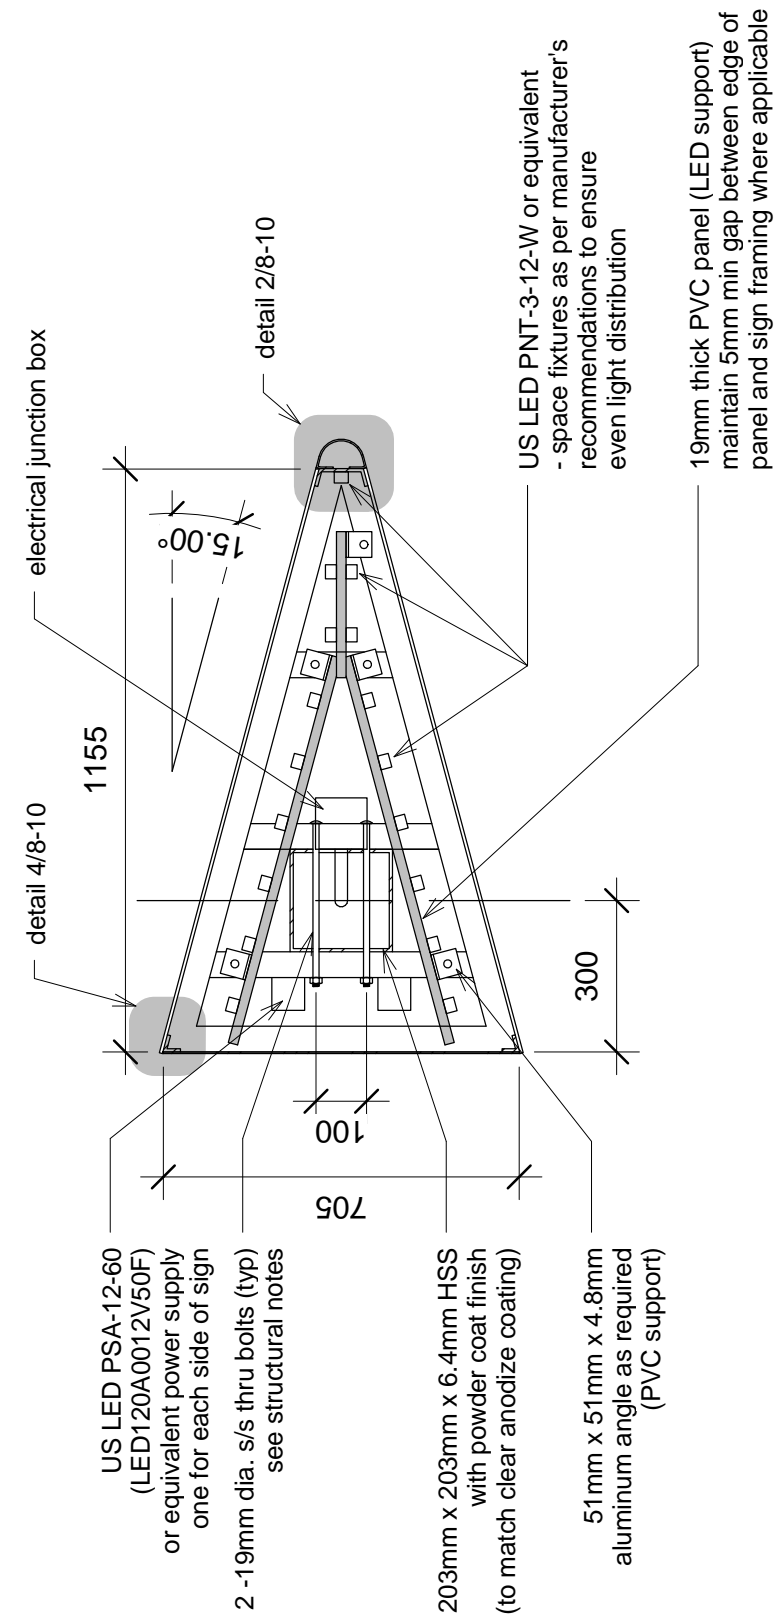

section b scale 1:15

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 8 Pedestrian Map Directory Kiosk
sheet name: sign construction - painted canopy plan and details
scale: as noted


sheet
number:

09




University
of Victoria


General Note:
Manufacturer to verify all dimensions
prior to sign fabrication. All discrepancies
should be reported to the Architect.

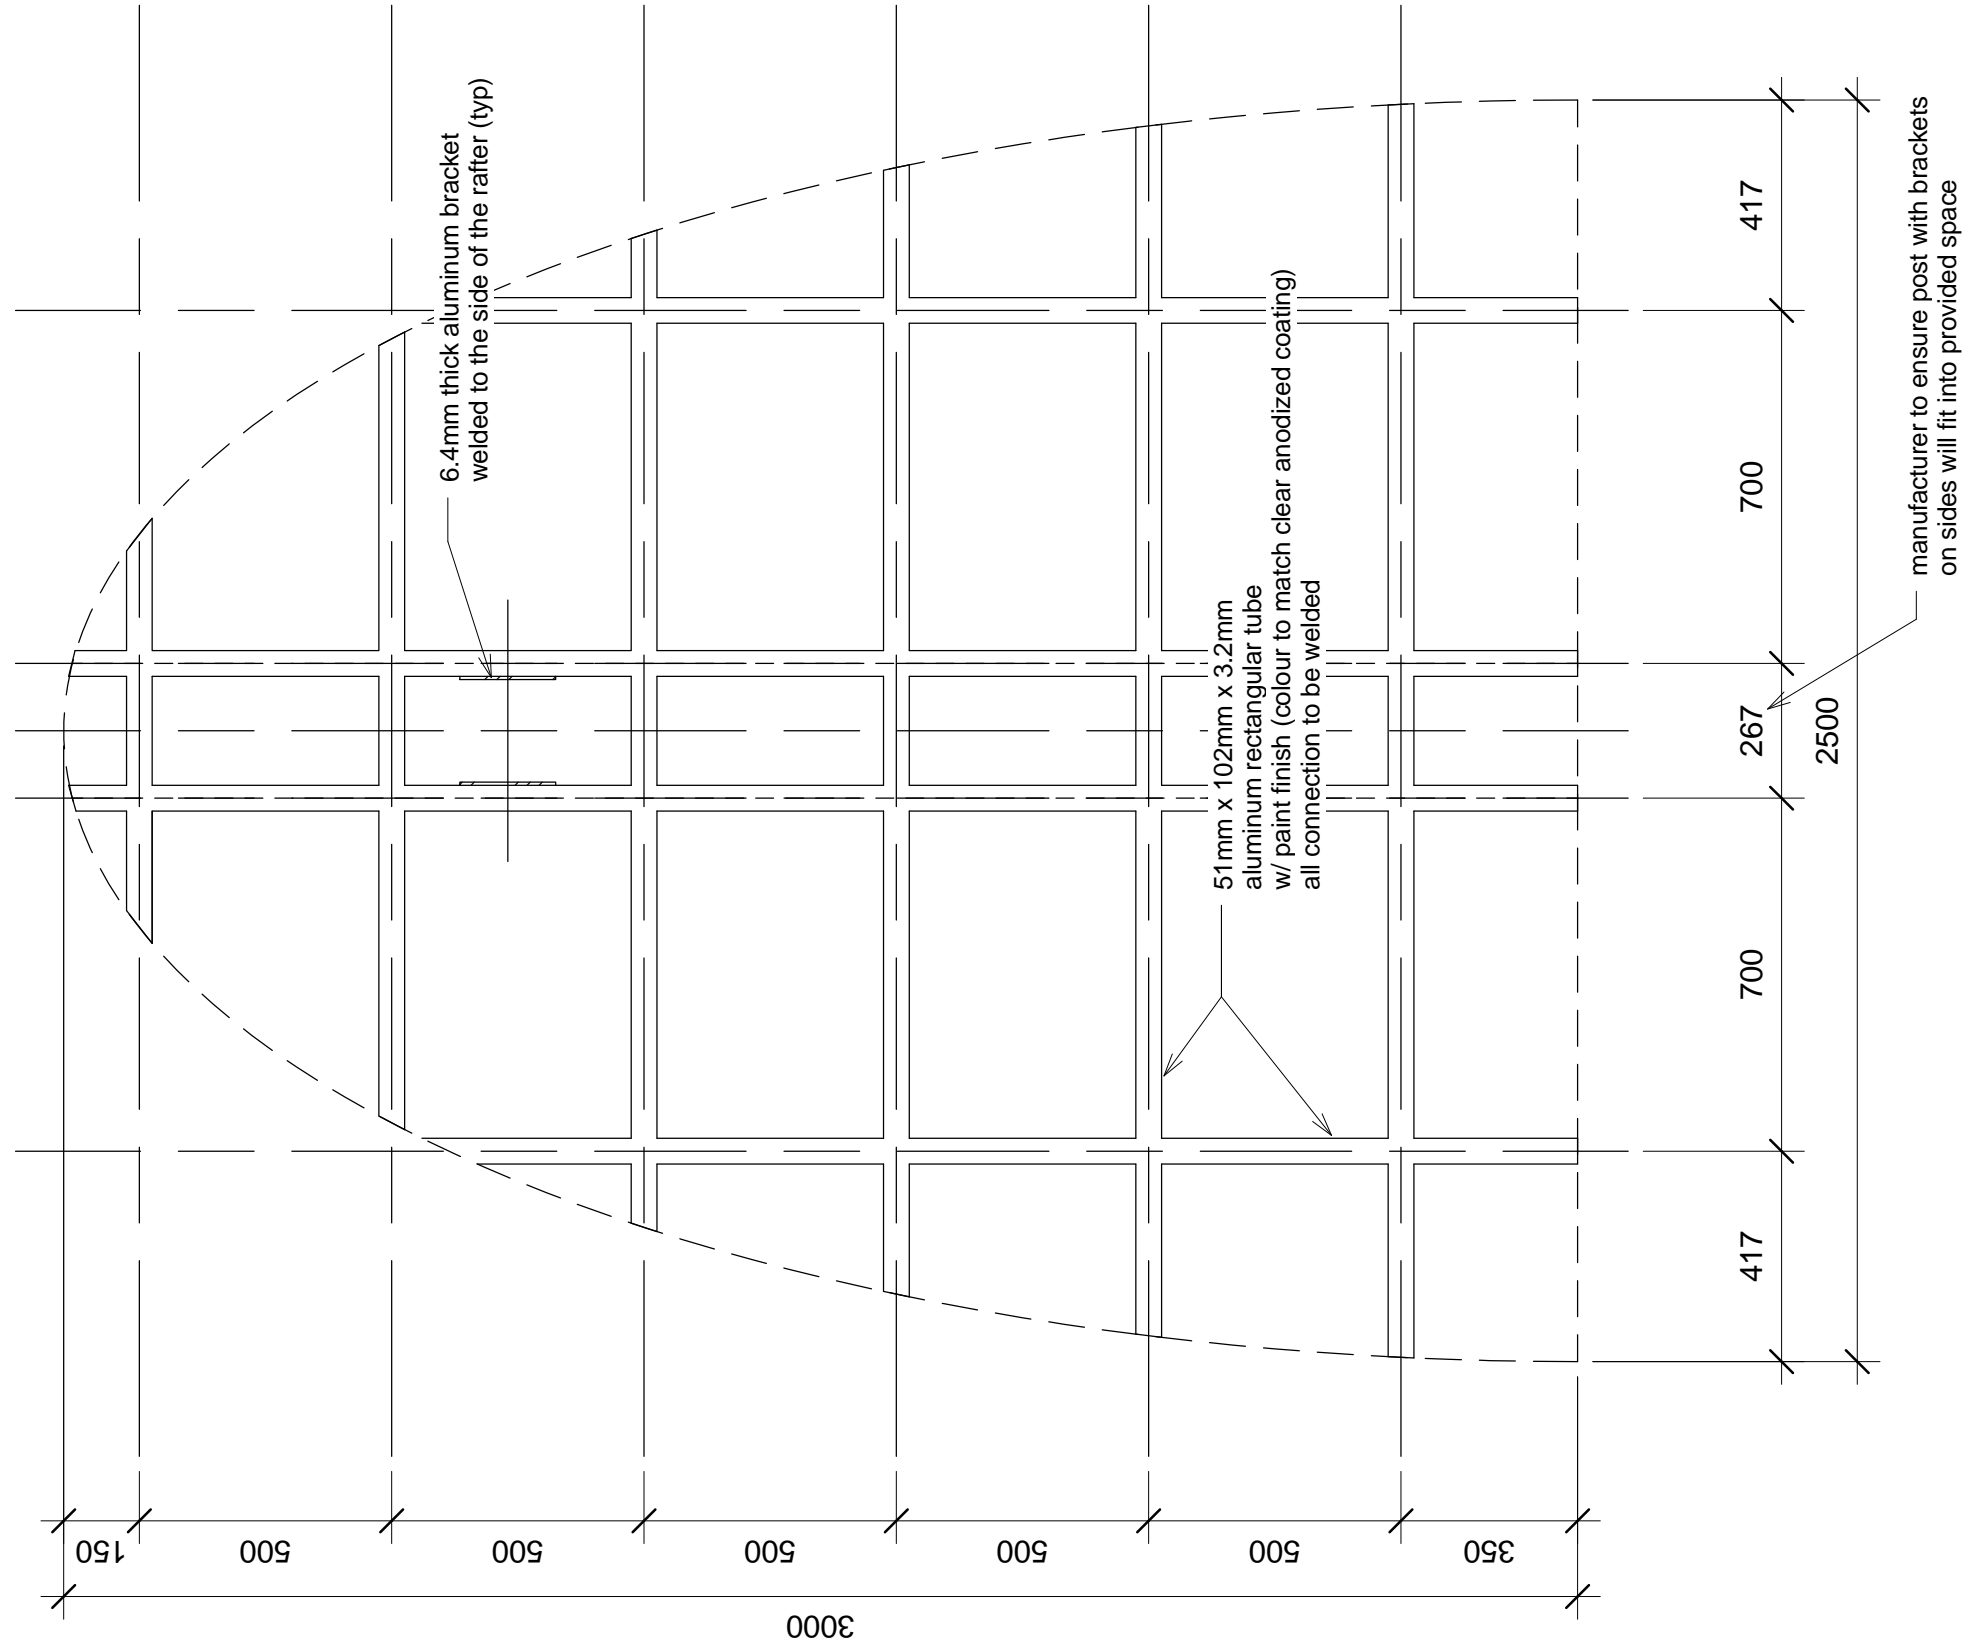


roof (paint finish option)
plan scale 1:15

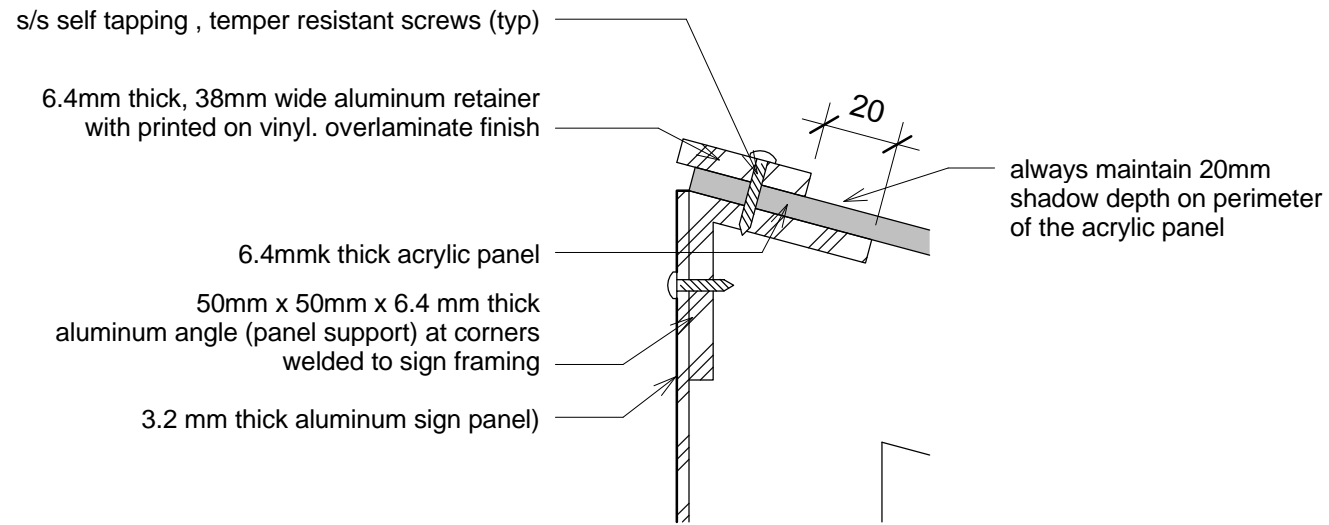


detail 4 scale 1:2

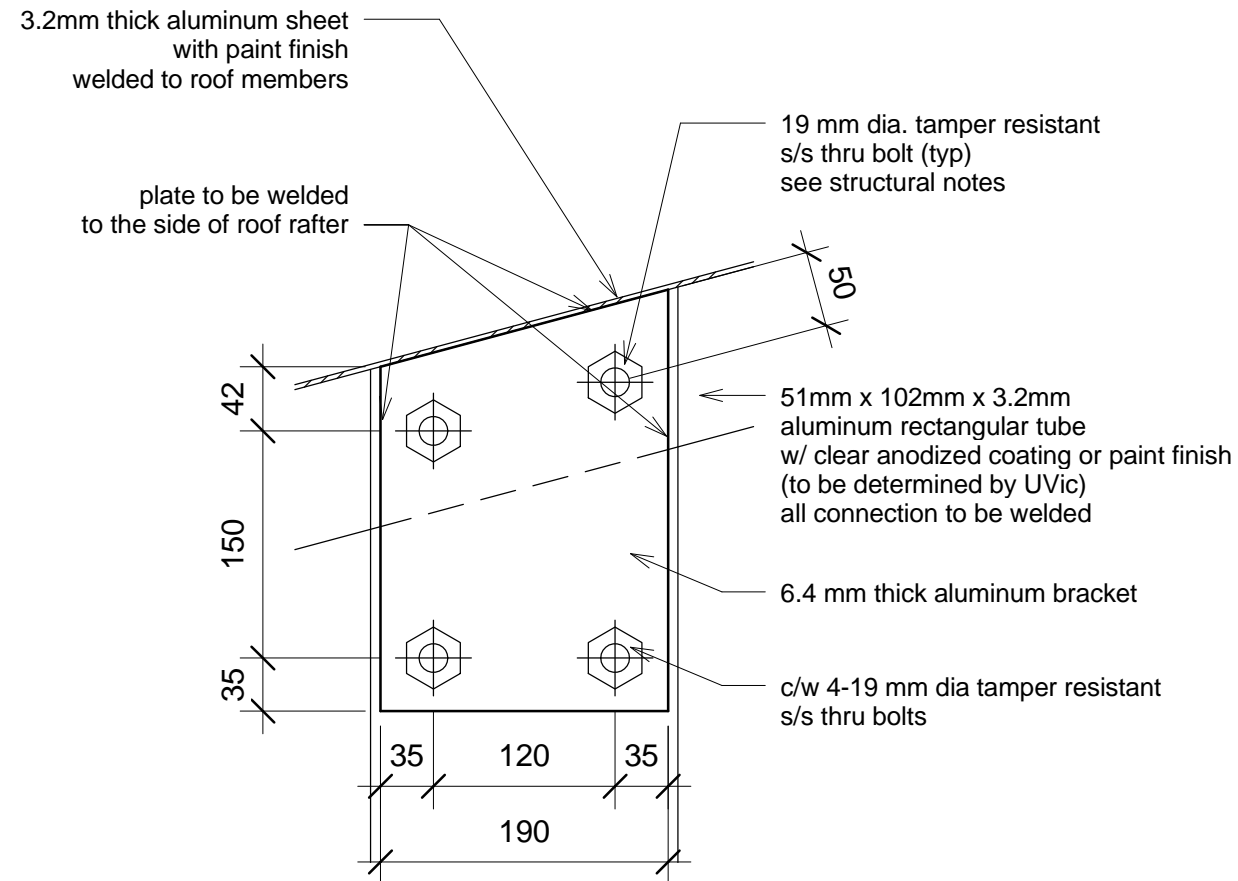

detail 3 scale 1:5

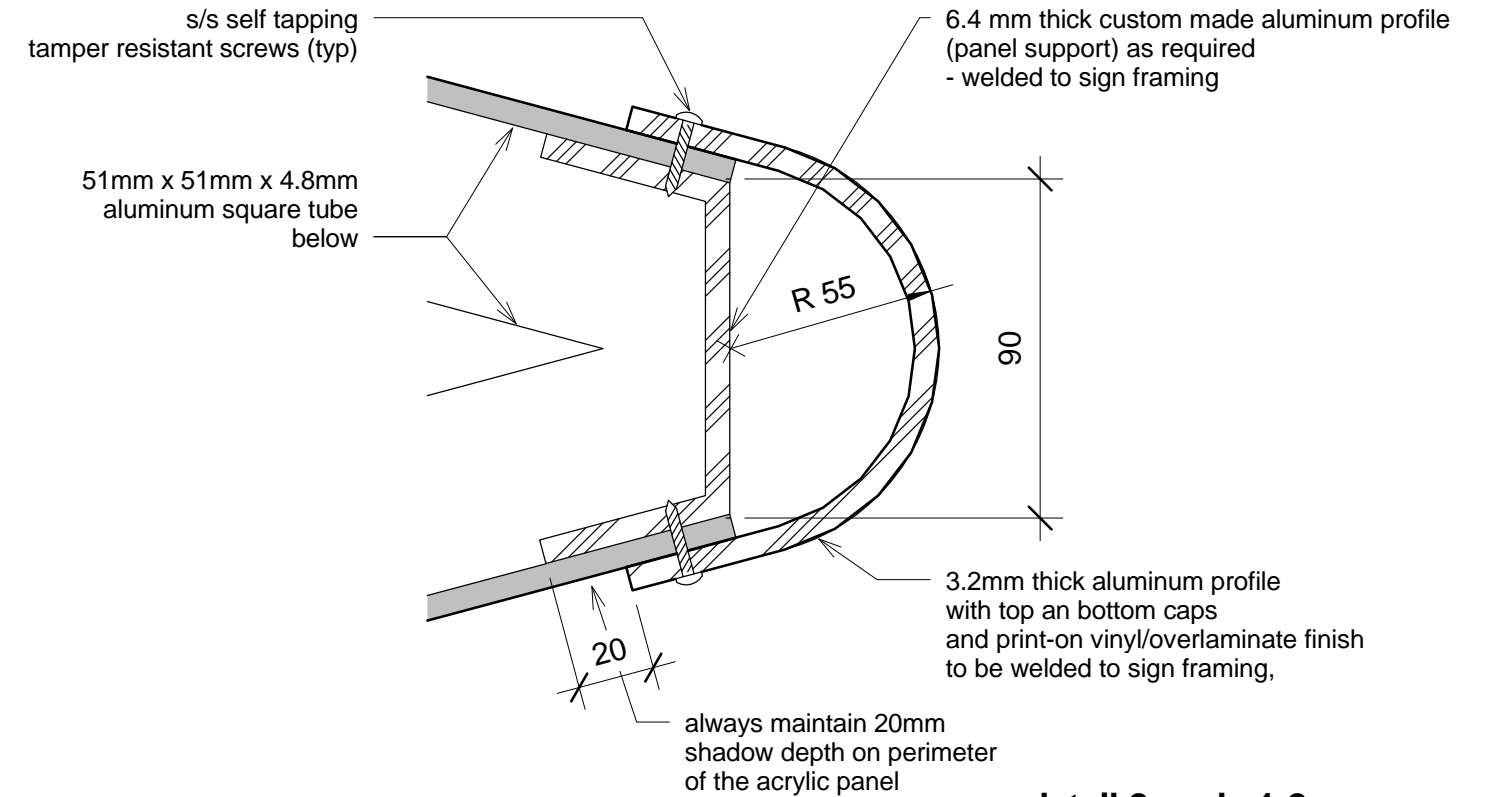


detail 2 scale 1:2

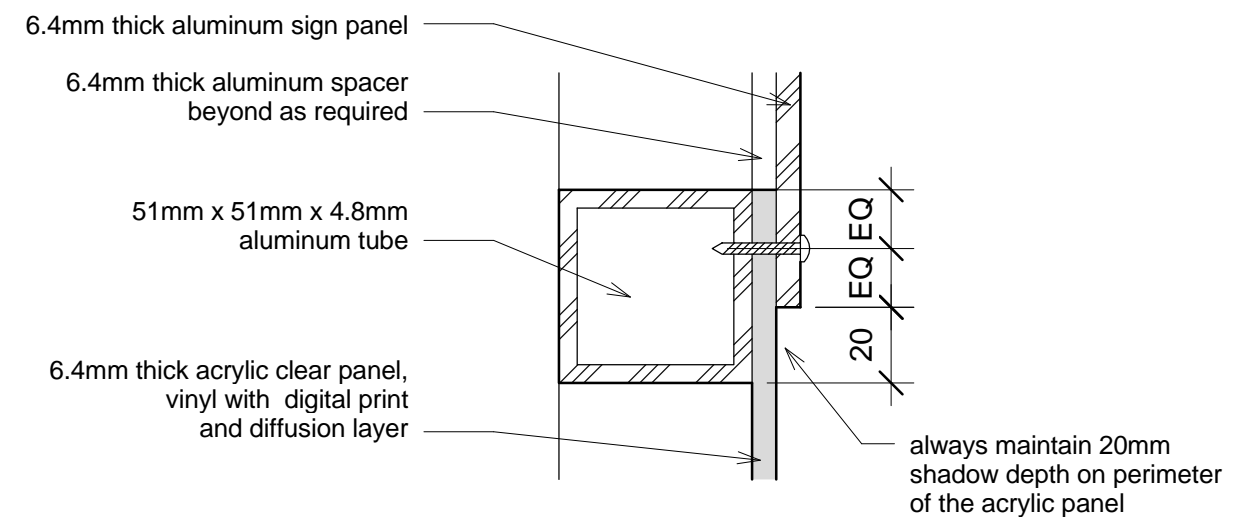

detail 1 scale 1:2

General Note:
Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

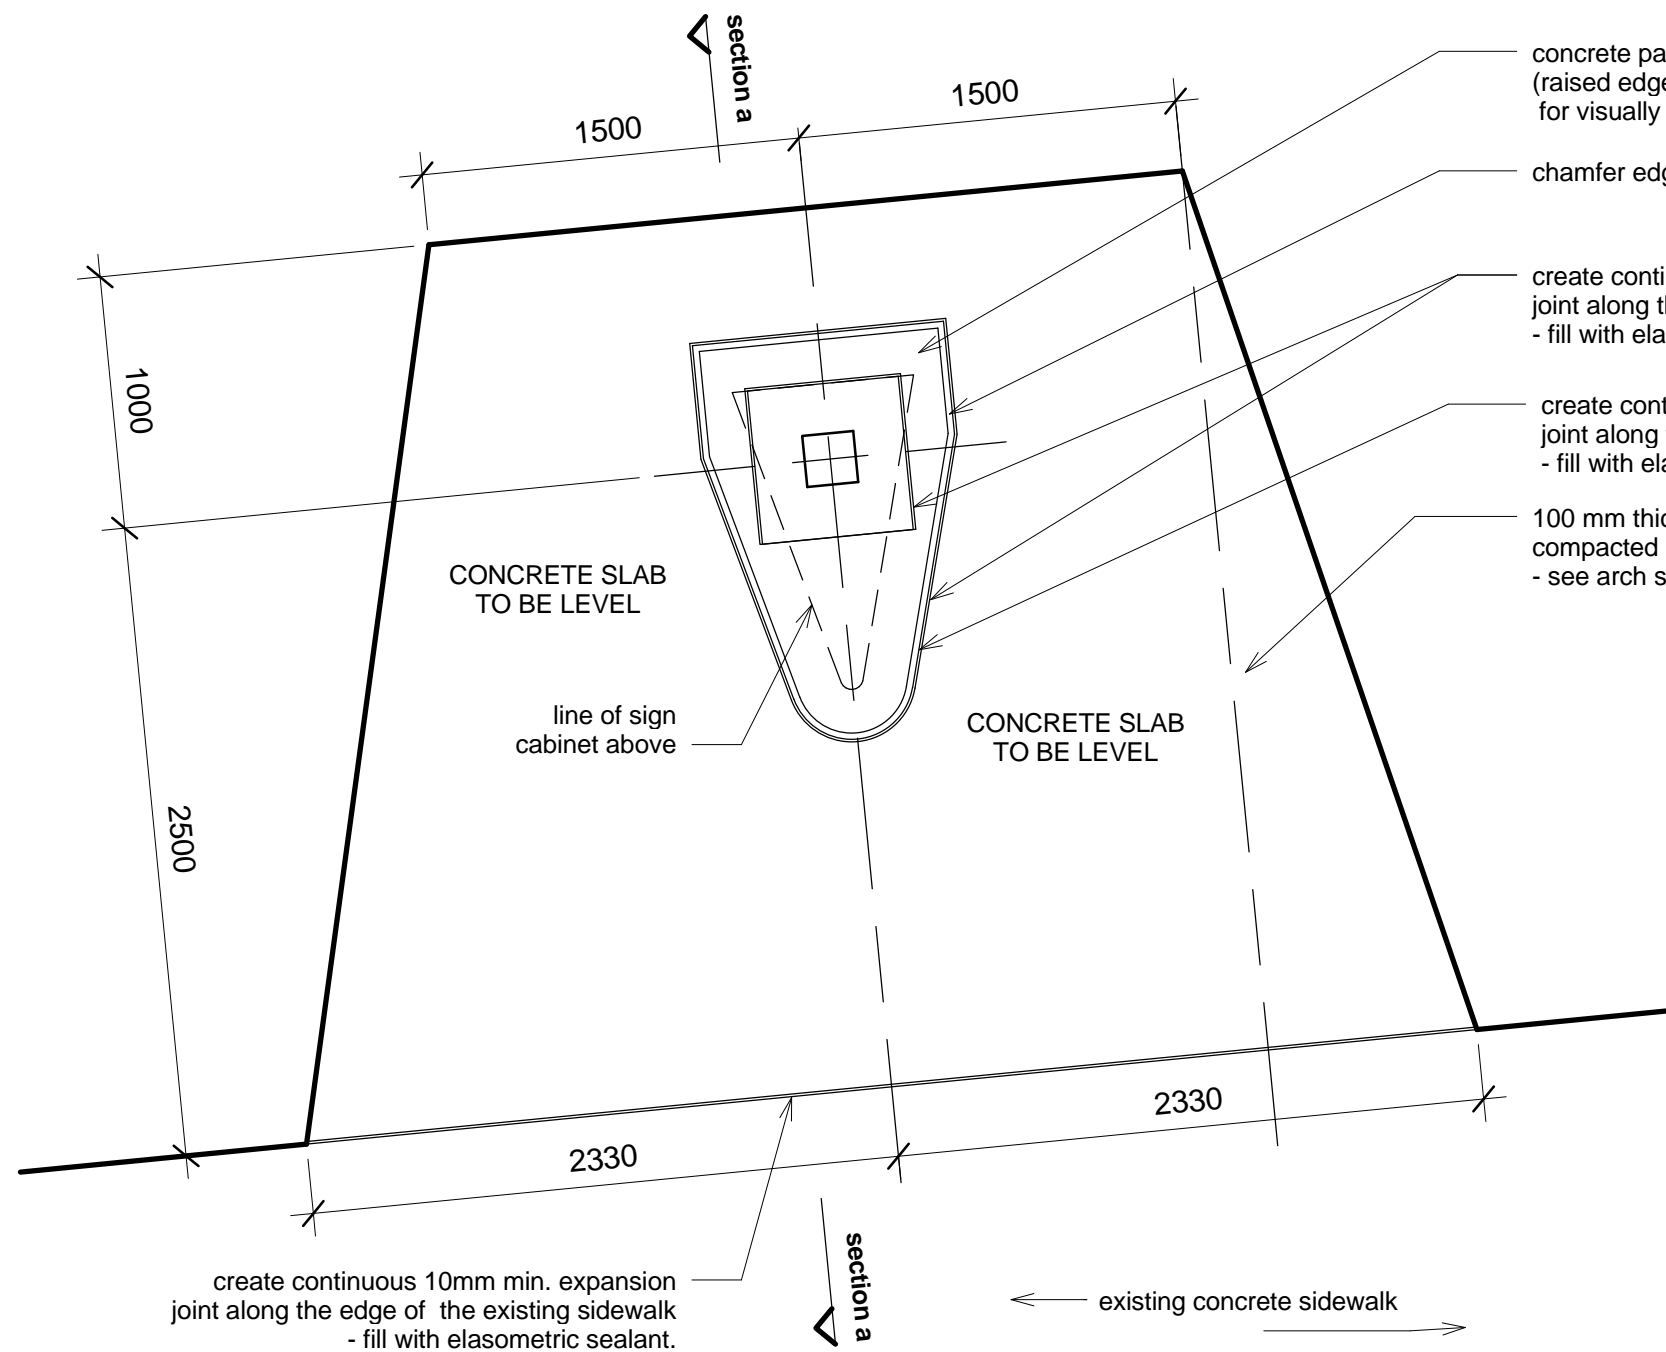


1. plan view scale 1:30

- concrete pad as per sheet 08 of arch. drawings (raised edge of the pad acts as a warning element for visually impaired.)
- chamfer edges
- create continuous 10mm min. expansion joint along the edge of the existing sidewalk - fill with elasometric sealant
- create continuous 10mm expansion joint along the edge of the concret pad - fill with elasometric sealant.
- 100 mm thick concrete slab on compacted gravel bed to match existing sidewalk - see arch specifications Section 32 13 13 (typ)

General Notes:

- 1) top of 100mm thick concrete slab to be flush with existing sidewalk. Concrete pad is to be modified accordingly - always maintain 50mm height difference.
- 2) drawing should be read in conjunction with arch. specifications
- 3) Contractor to verify all dimensions on site prior to sign installation

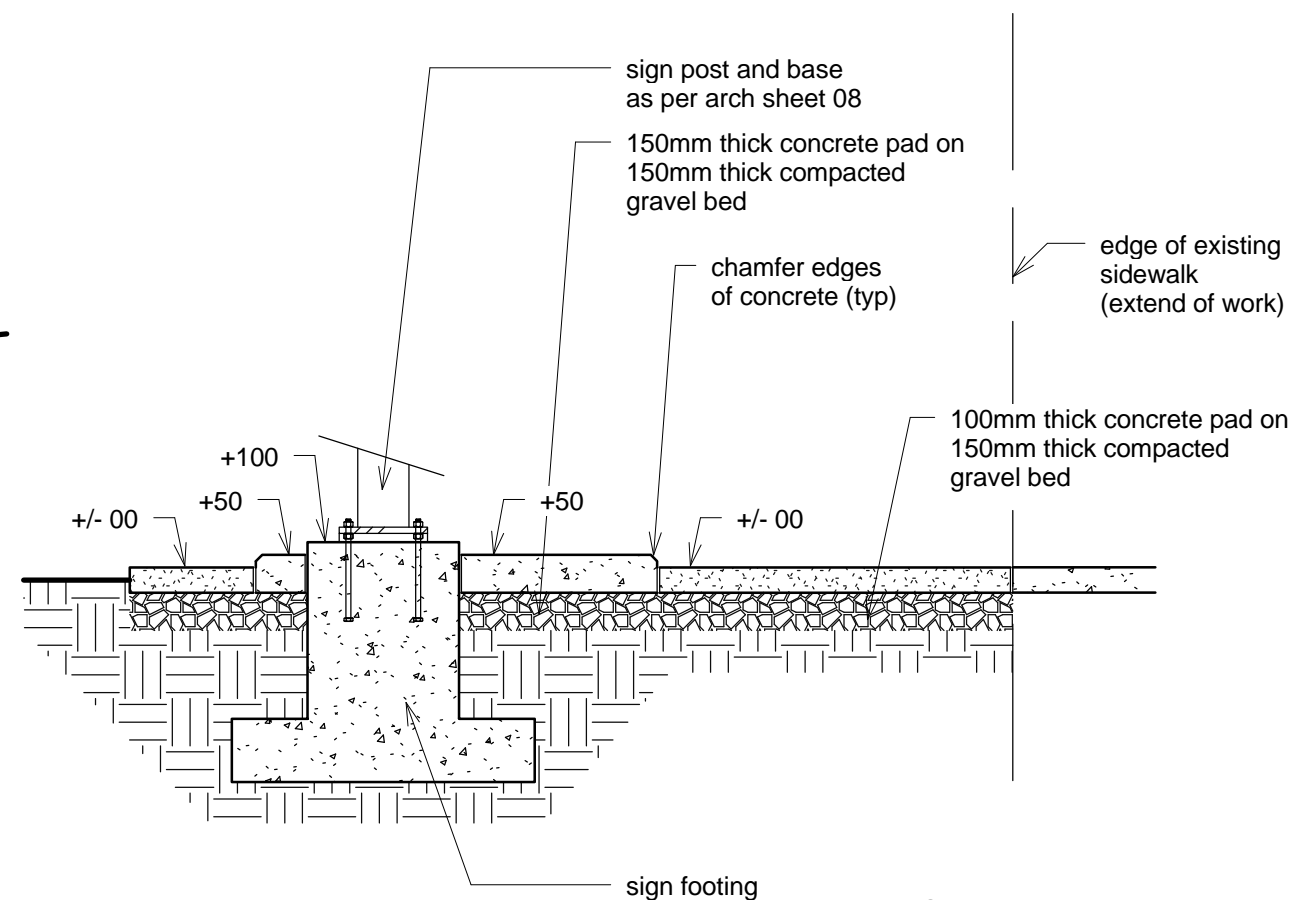

2. section a-a scale 1:30

General Note:
Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.



GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
- Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47349 (3/4" s/s threaded)
 - washers: Fastenal part #71027 (3/4" s/s wahers)
 - nuts: Fastenal part #70717 (3/4" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 4. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with the Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.

STRUCTURAL NOTES (cont)

- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant "Torx-Pin" screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be "Pentagon" tamper resistant bolts, with "Pentagon" nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with "Pentagon" security nuts.

ELECTRICAL NOTES

- 1. Signs must be provided with CSA label
- 2. LED modules, power supplies, cable, wire and junction box must be integral with signs
- 3. All electrical installations to be done in accordance with the Canadian Electrical Code and as reccomended by the LED lighting manufacturer.
- 4. Run 2#8 +GND conductors in 27mm PVC conduit from sign to existing campus exterior lighting pole standard. Intercept existing underground conduit, install an H20 rated flush junction box with bolt-on cover and splice into exterior lighting circuit.
- 4. The sign manufacturer shall provide an electrical shop drawings indicating input power requirements and a schematic wiring diagram for the sign.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - section
06	sign construction - plans and sections
07	sign construction - details
08	sign construction - push thru pictogram
09	general notes



Sign No. 9 Pedestrian - Major Directional

core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTEONE 7541 C
application: background,
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

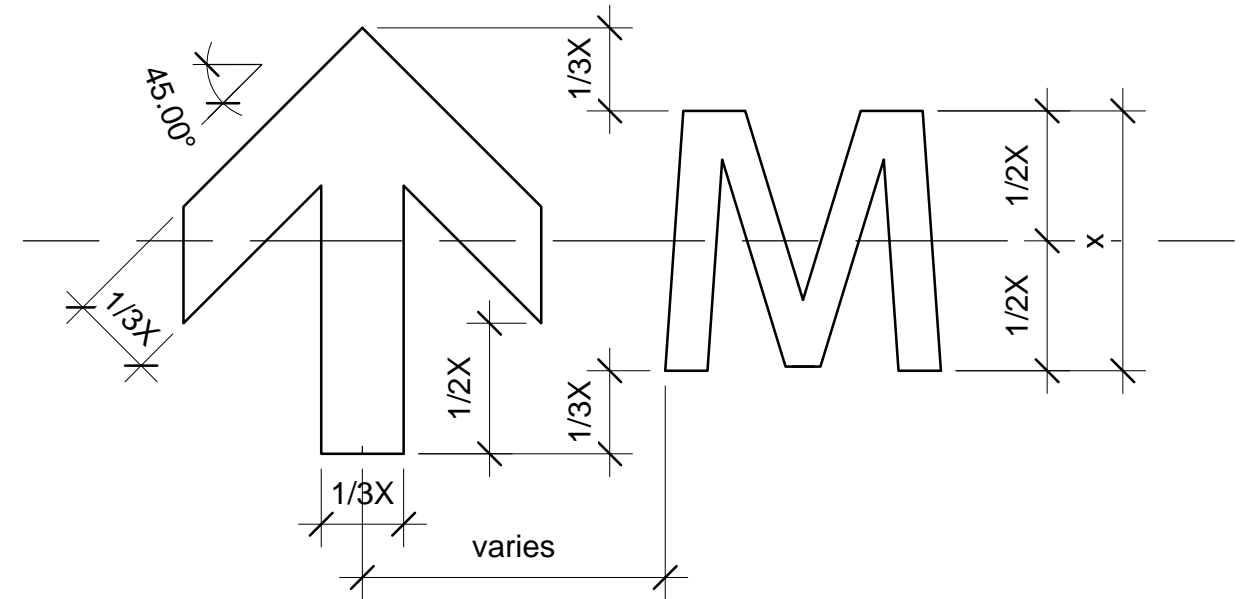

University of Victoria Logo, horizontal standard



University of Victoria



University of Victoria



full colour

opaque monochromatic

opaque monochromatic reversed

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 9 - Major Directional
sheet name: typography, colours and pictograms
scale: as noted

sheet
number:


02




**University
of Victoria**

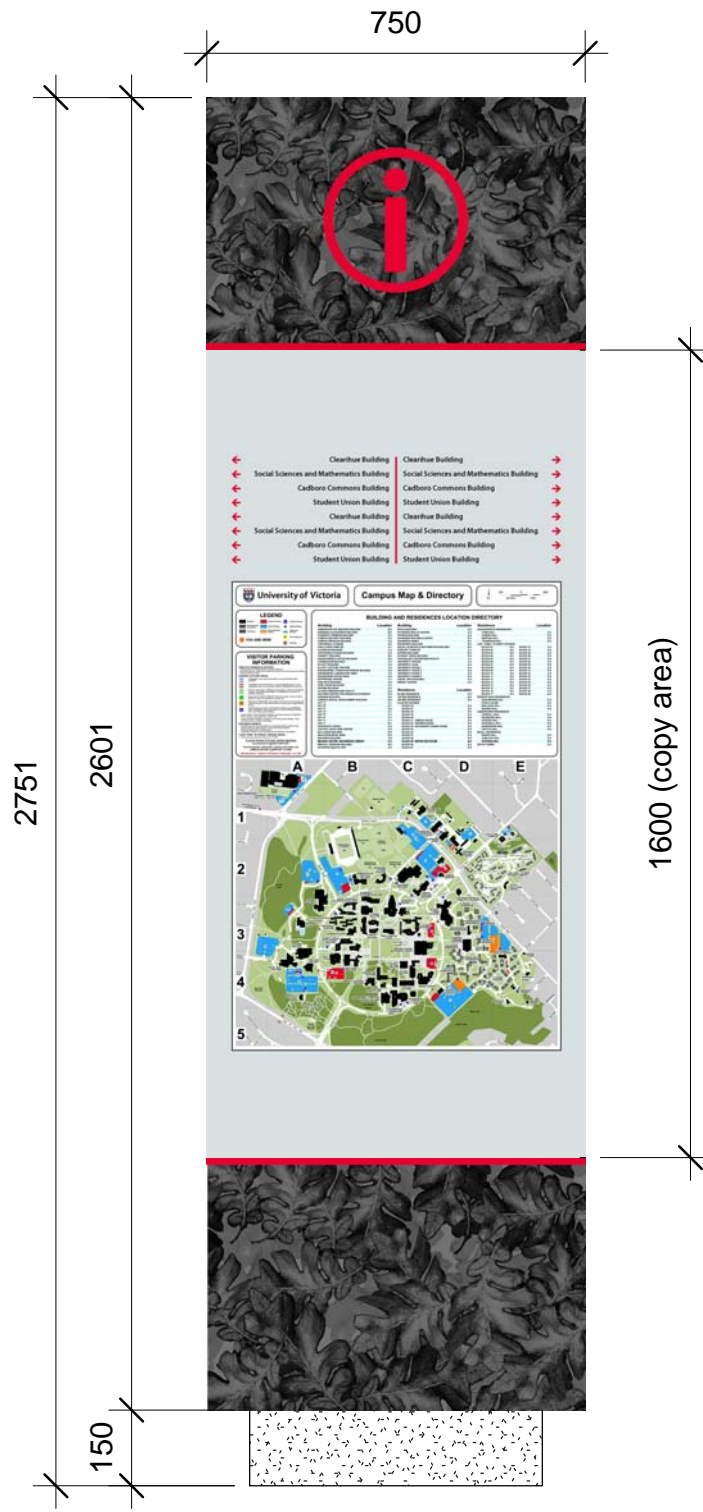

back

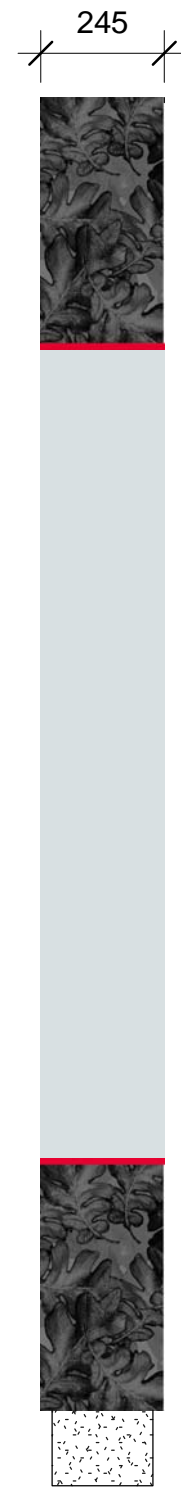

side

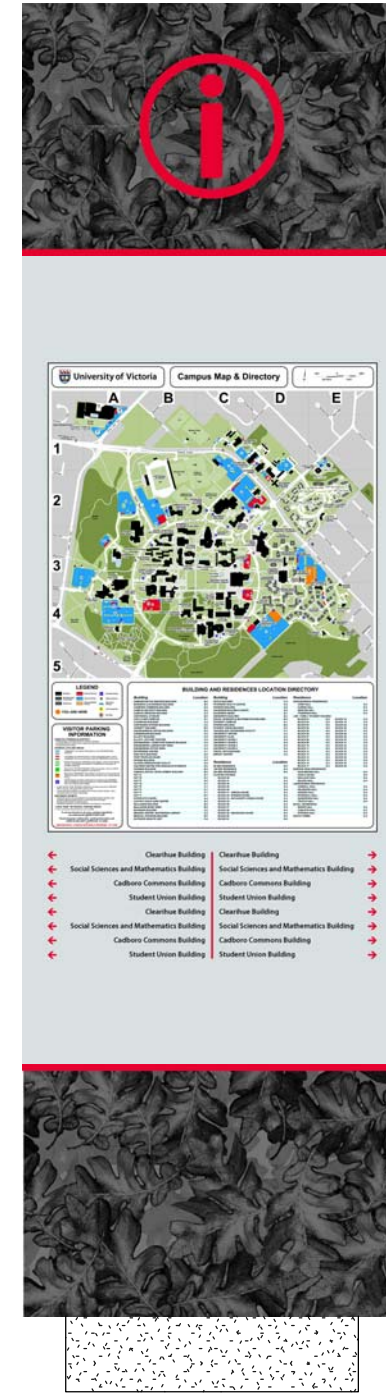

front



side

General Note:
Where applicable, provide 6.4mm
thick aluminum spacer
under aluminum sign panels
to make up for acrylic panel
thickness
see also detail 3/9-07

scale 1:15





Digitally printed vinyl protected with anti-graffiti, optically clear overlamine. Aluminum panel size: 283 mm x 744 mm x 3.2 mm



Digitally printed vinyl protected with anti-graffiti, optically clear overlamine. Aluminum panel size: 270 mm x 506 mm x 3.2 mm





Digitally printed vinyl protected with anti-graffiti, optically clear overlamine. 19mm thick acrylic push-thru pictogram - see dwg 08 for details. Aluminum panel size: 744 mm x 506 mm x 6.4 mm

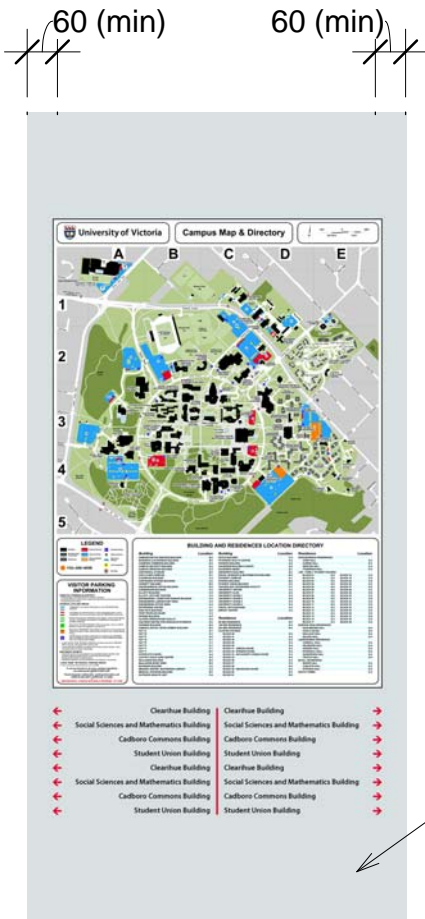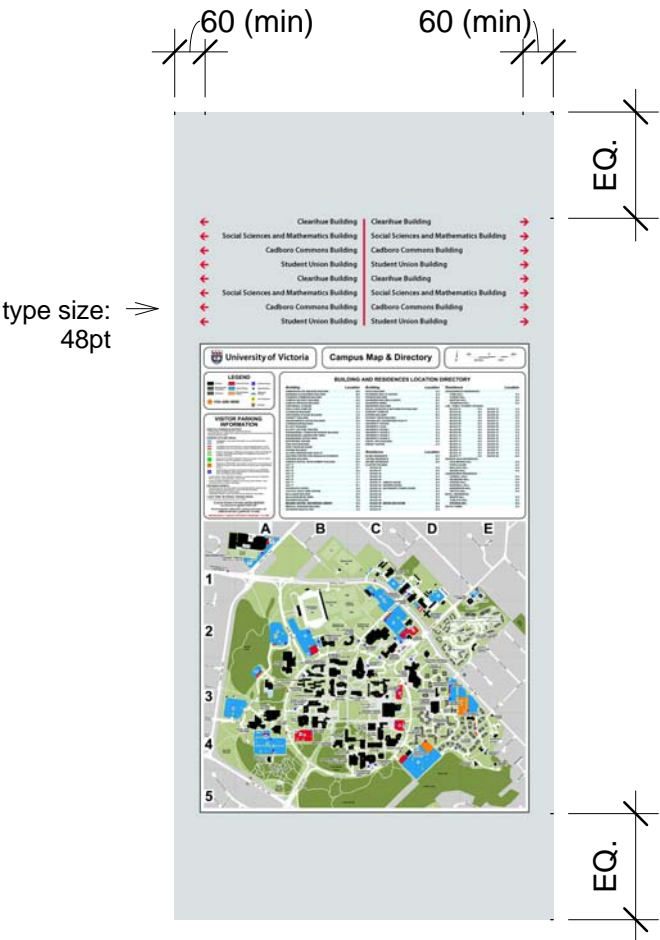

Digitally printed vinyl protected with anti-graffiti, optically clear overlamine. For aluminum panel size see sign construction drawings

6.4 mm thick non-glare clear acrylic panel

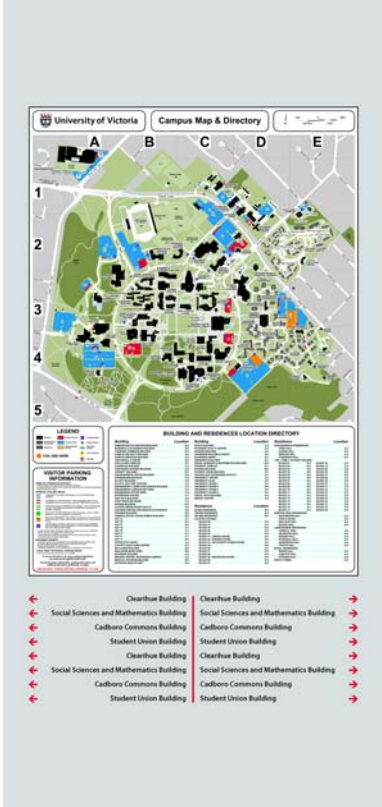


Non-glare clear acrylic: Plaskolite OPTIX Abrasion Resistant Non-Glare or equivalent.
Clear acrylic (pictograms): Plaskolite OPTIX, Chemcast GP or equivalent

First surface prints:
Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.

- 2nd surface prints:
CAV-50 reverse print - i/w/i (2nd surface)
Overlamine: 3M 8914, Avery DOL 6060 or equivalent (first surface)
- 1) Vinyl to be printed on, installed as per manufacturer's recommendations.
 - 2) Use compatible UV inks and overlaminates as recommended by manufacturer
 - 3) Where applicable wrap vinyl and overlamine over the edges of the alu. panel.
 - 4) All panels to be mechanically fastened to substrate.
 - 5) Directory map shown for reference only. directory map with all associated texts and pictograms to be provided in digital format by University of Victoria
 - 6) Manufacturer to confirm all dimensions prior to fabrication.
 - 7) Manufacturer to ensure watertightness of panel conenctions.

Refer to Adobe Photoshop files for detailed sample layout

Digitally printed vinyl protected with anti-graffiti, optically clear overlamine. Aluminum panel size: 744 mm x 506 mm x 6.4 mm



scale 1:15

sides

front


project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 9 - Major Directional
sheet name: sign design - graphic design details
scale: as noted

sheet number:

04



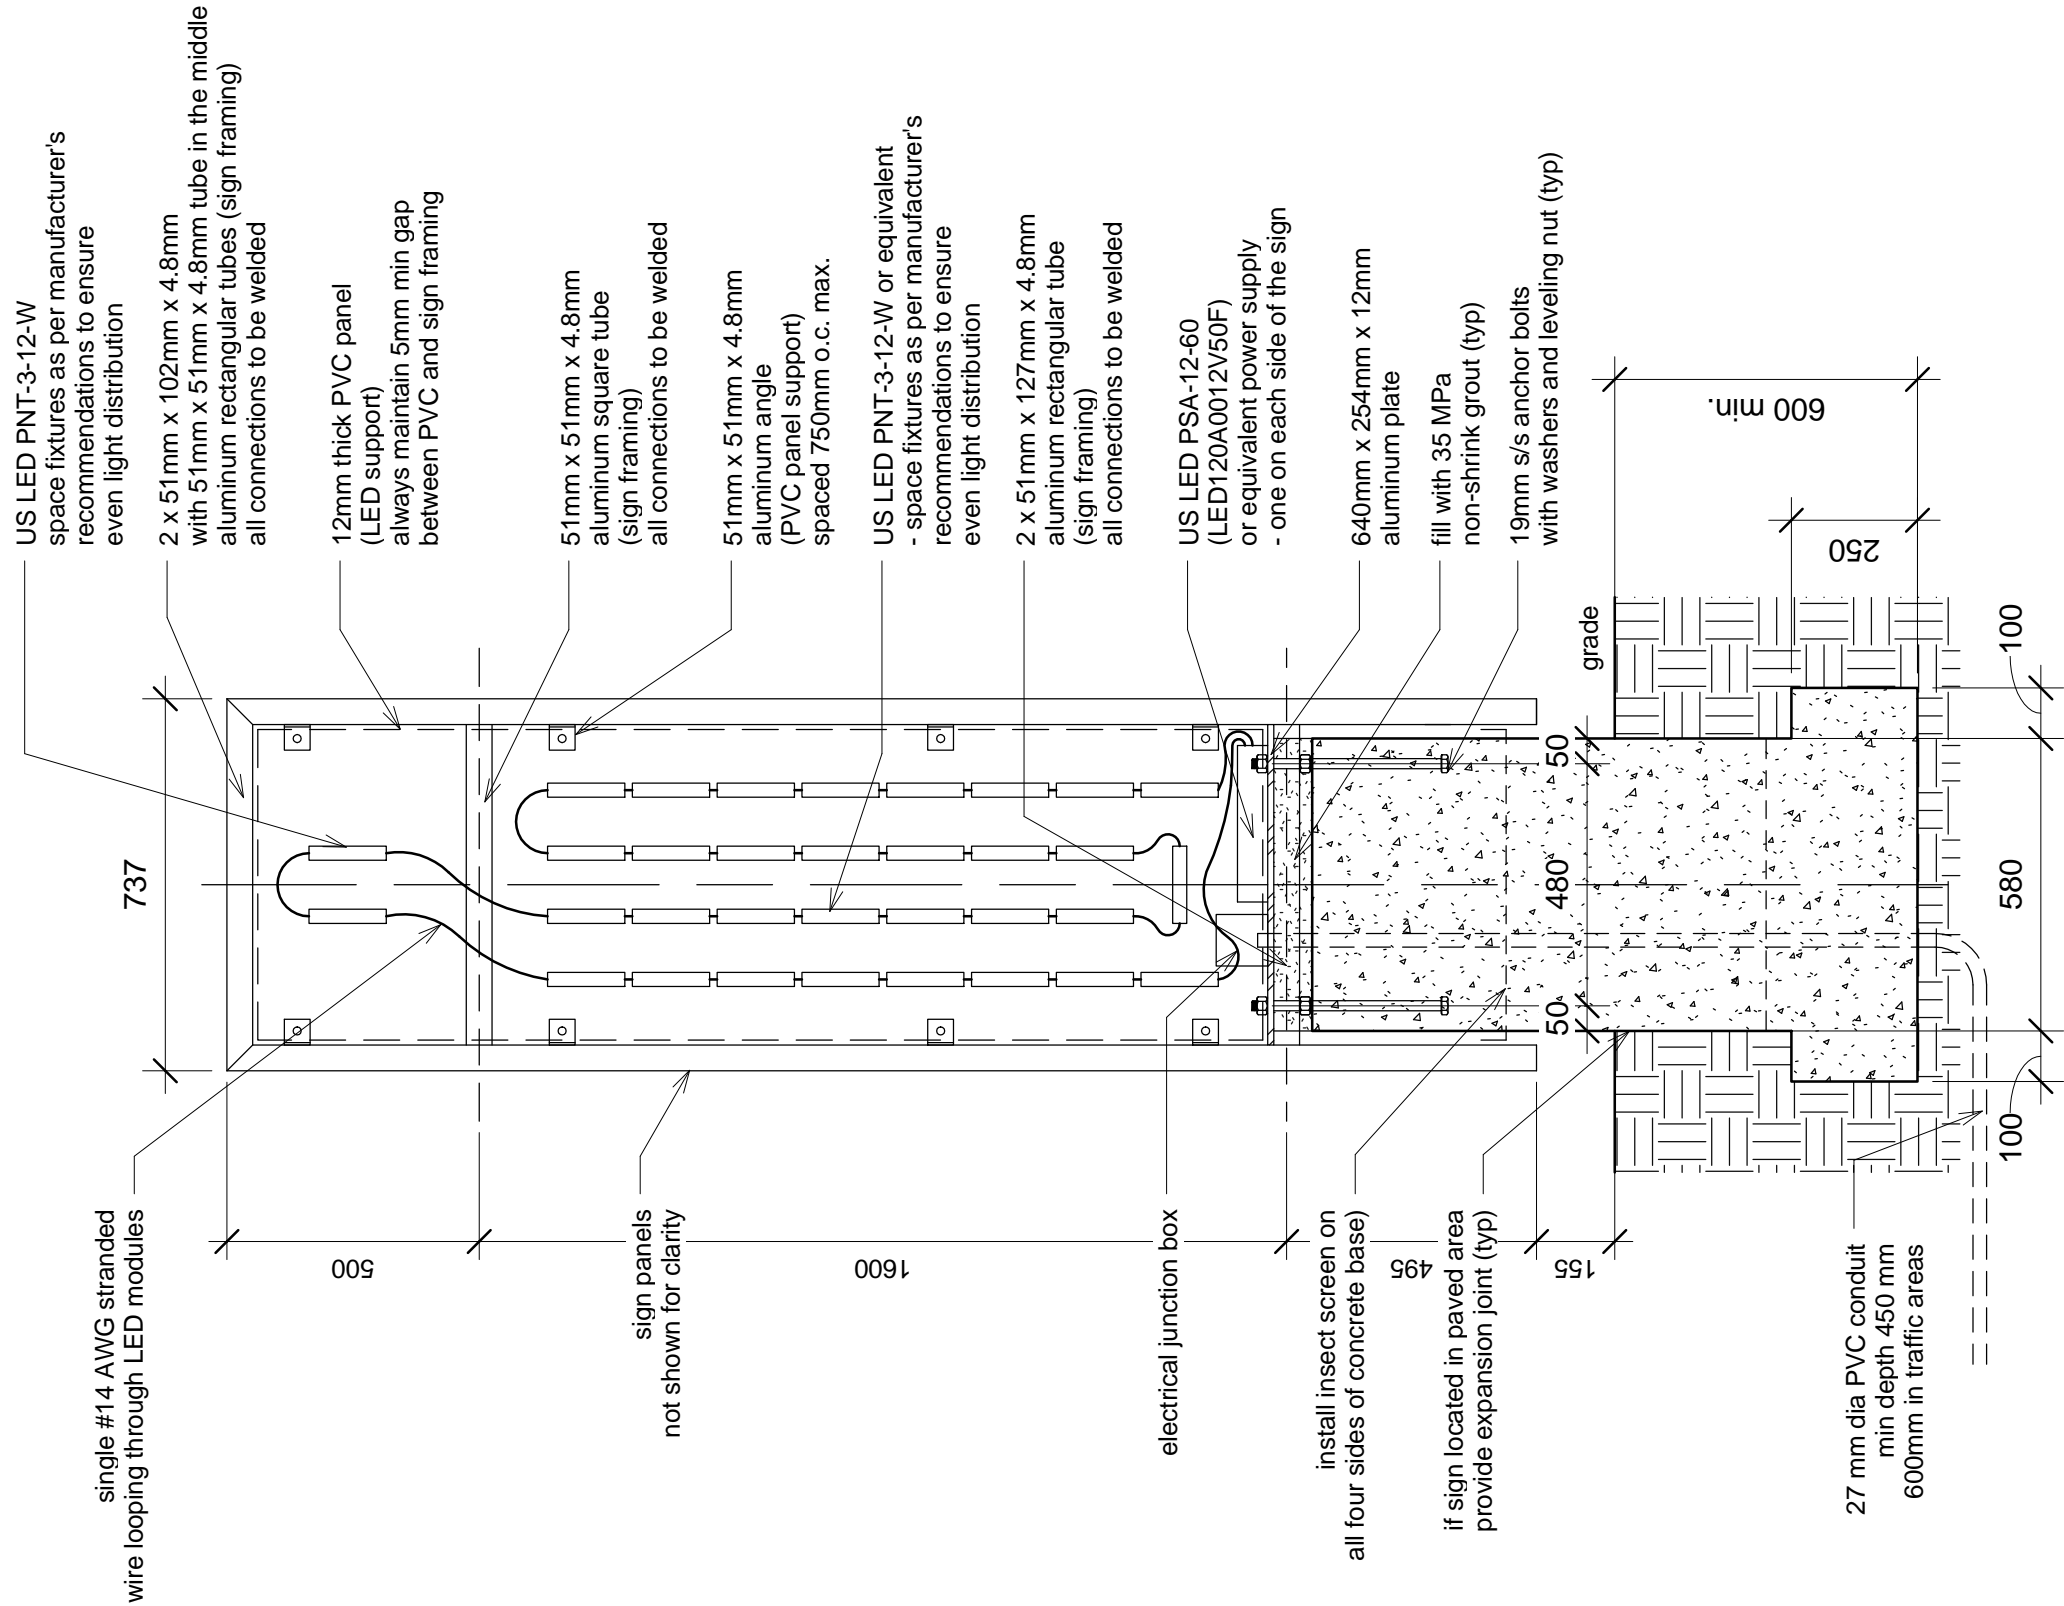



- 1) provide ventilation holes as required
- 2) US LED PSA-12-60 power supply to provide source of power to a max. of 50 MegaBright 12 LED Modules
- 3) Sign must have a CSA label as an assembly

General Note:
Manufacturer to verify all dimensions
prior to sign fabrication. All discrepancies
should be reported to the Architect.




General Note:
Manufacturer to verify all diemnsions
prior to sign fabrication. All discrepancies
should be reported to the Architect.

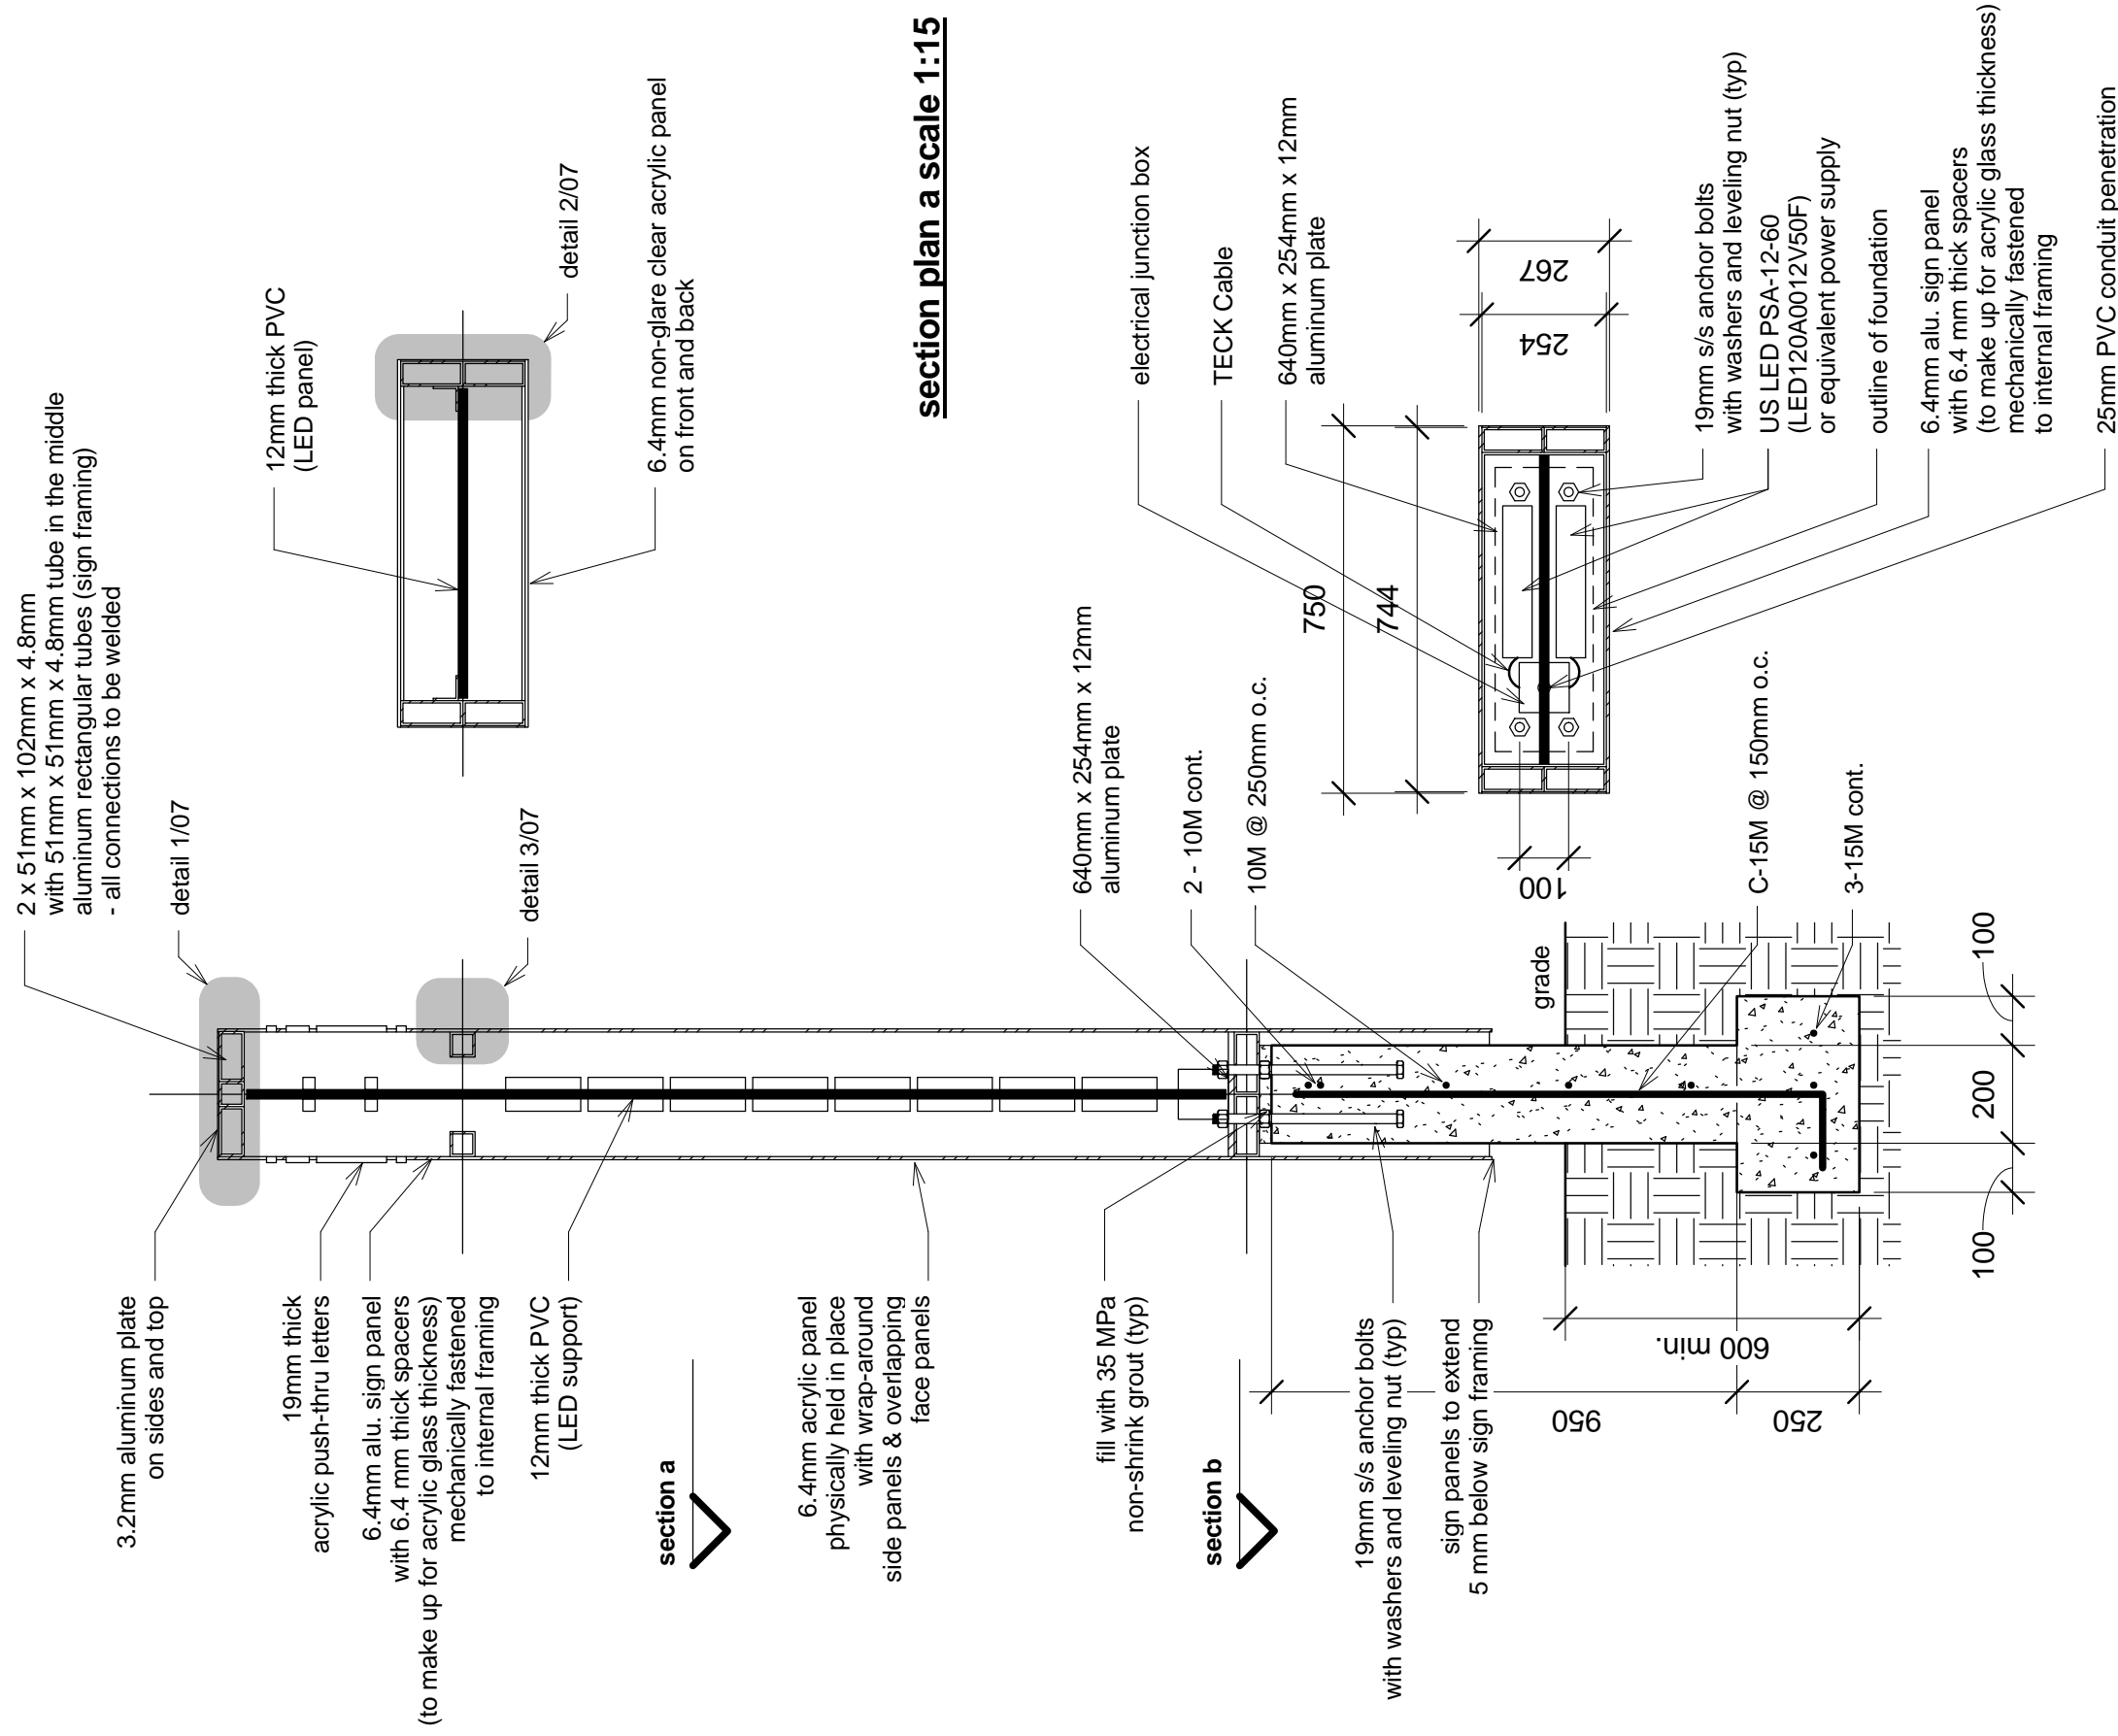

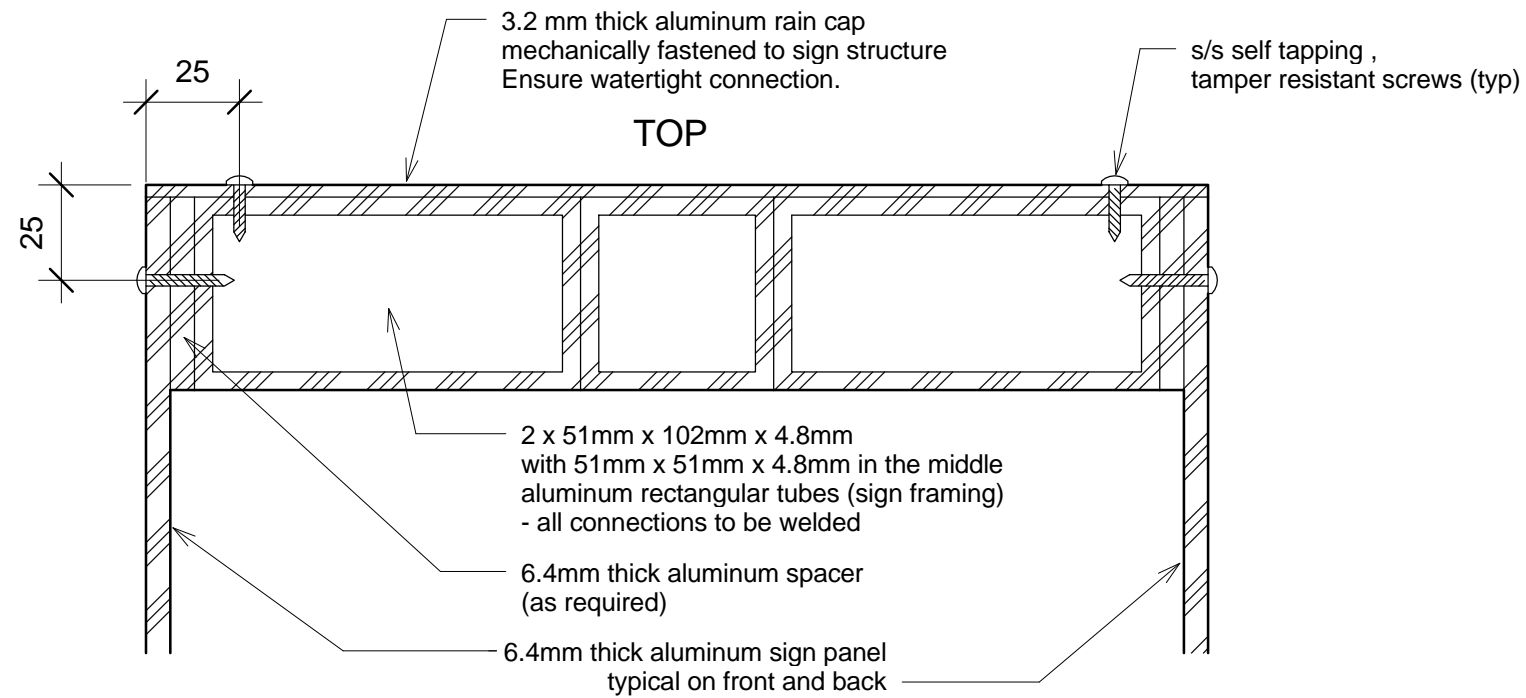


detail 1 scale 1:2

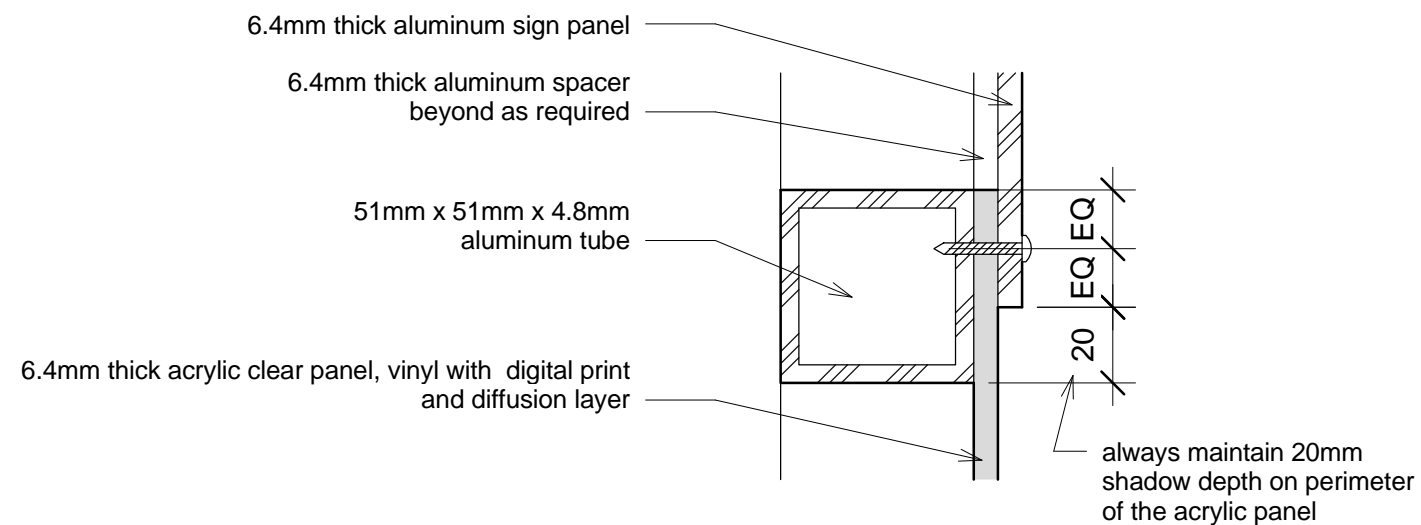


detail 3 scale 1:2

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

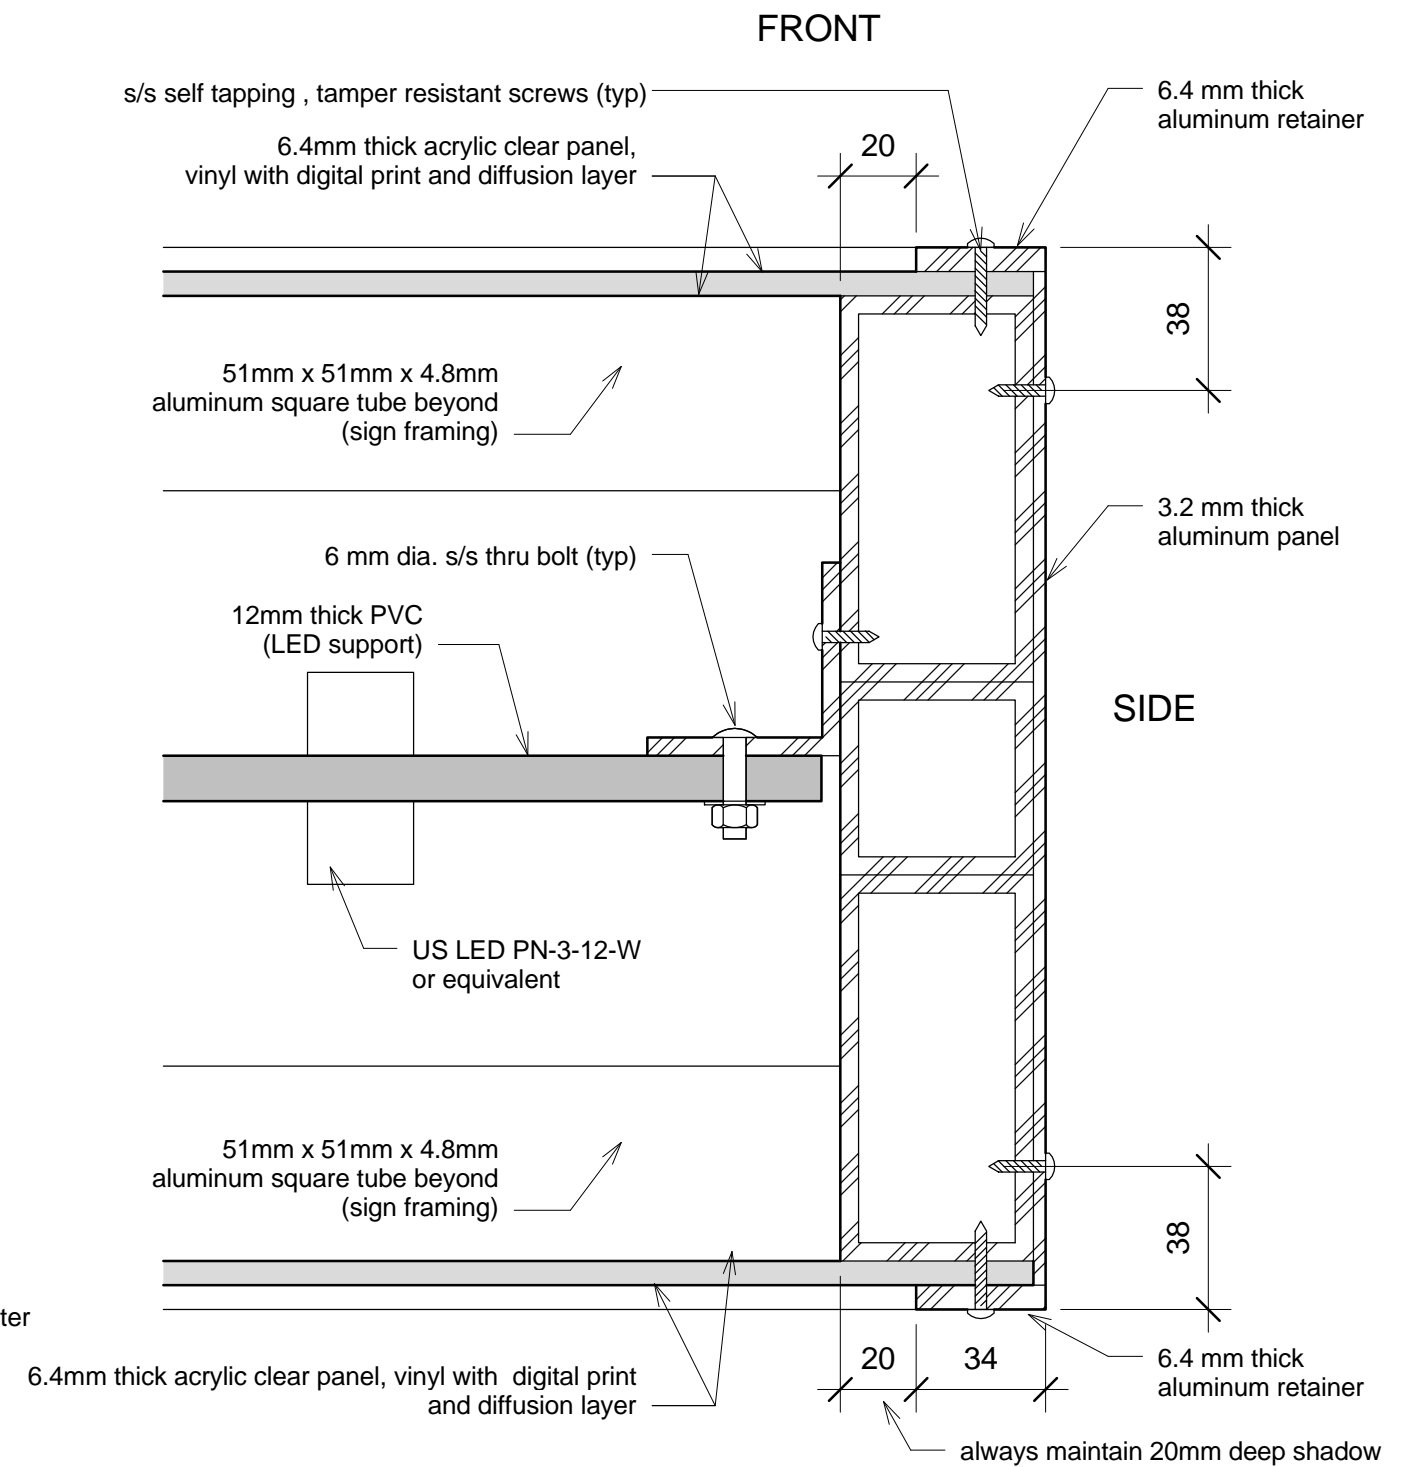

detail 2 scale 1:2

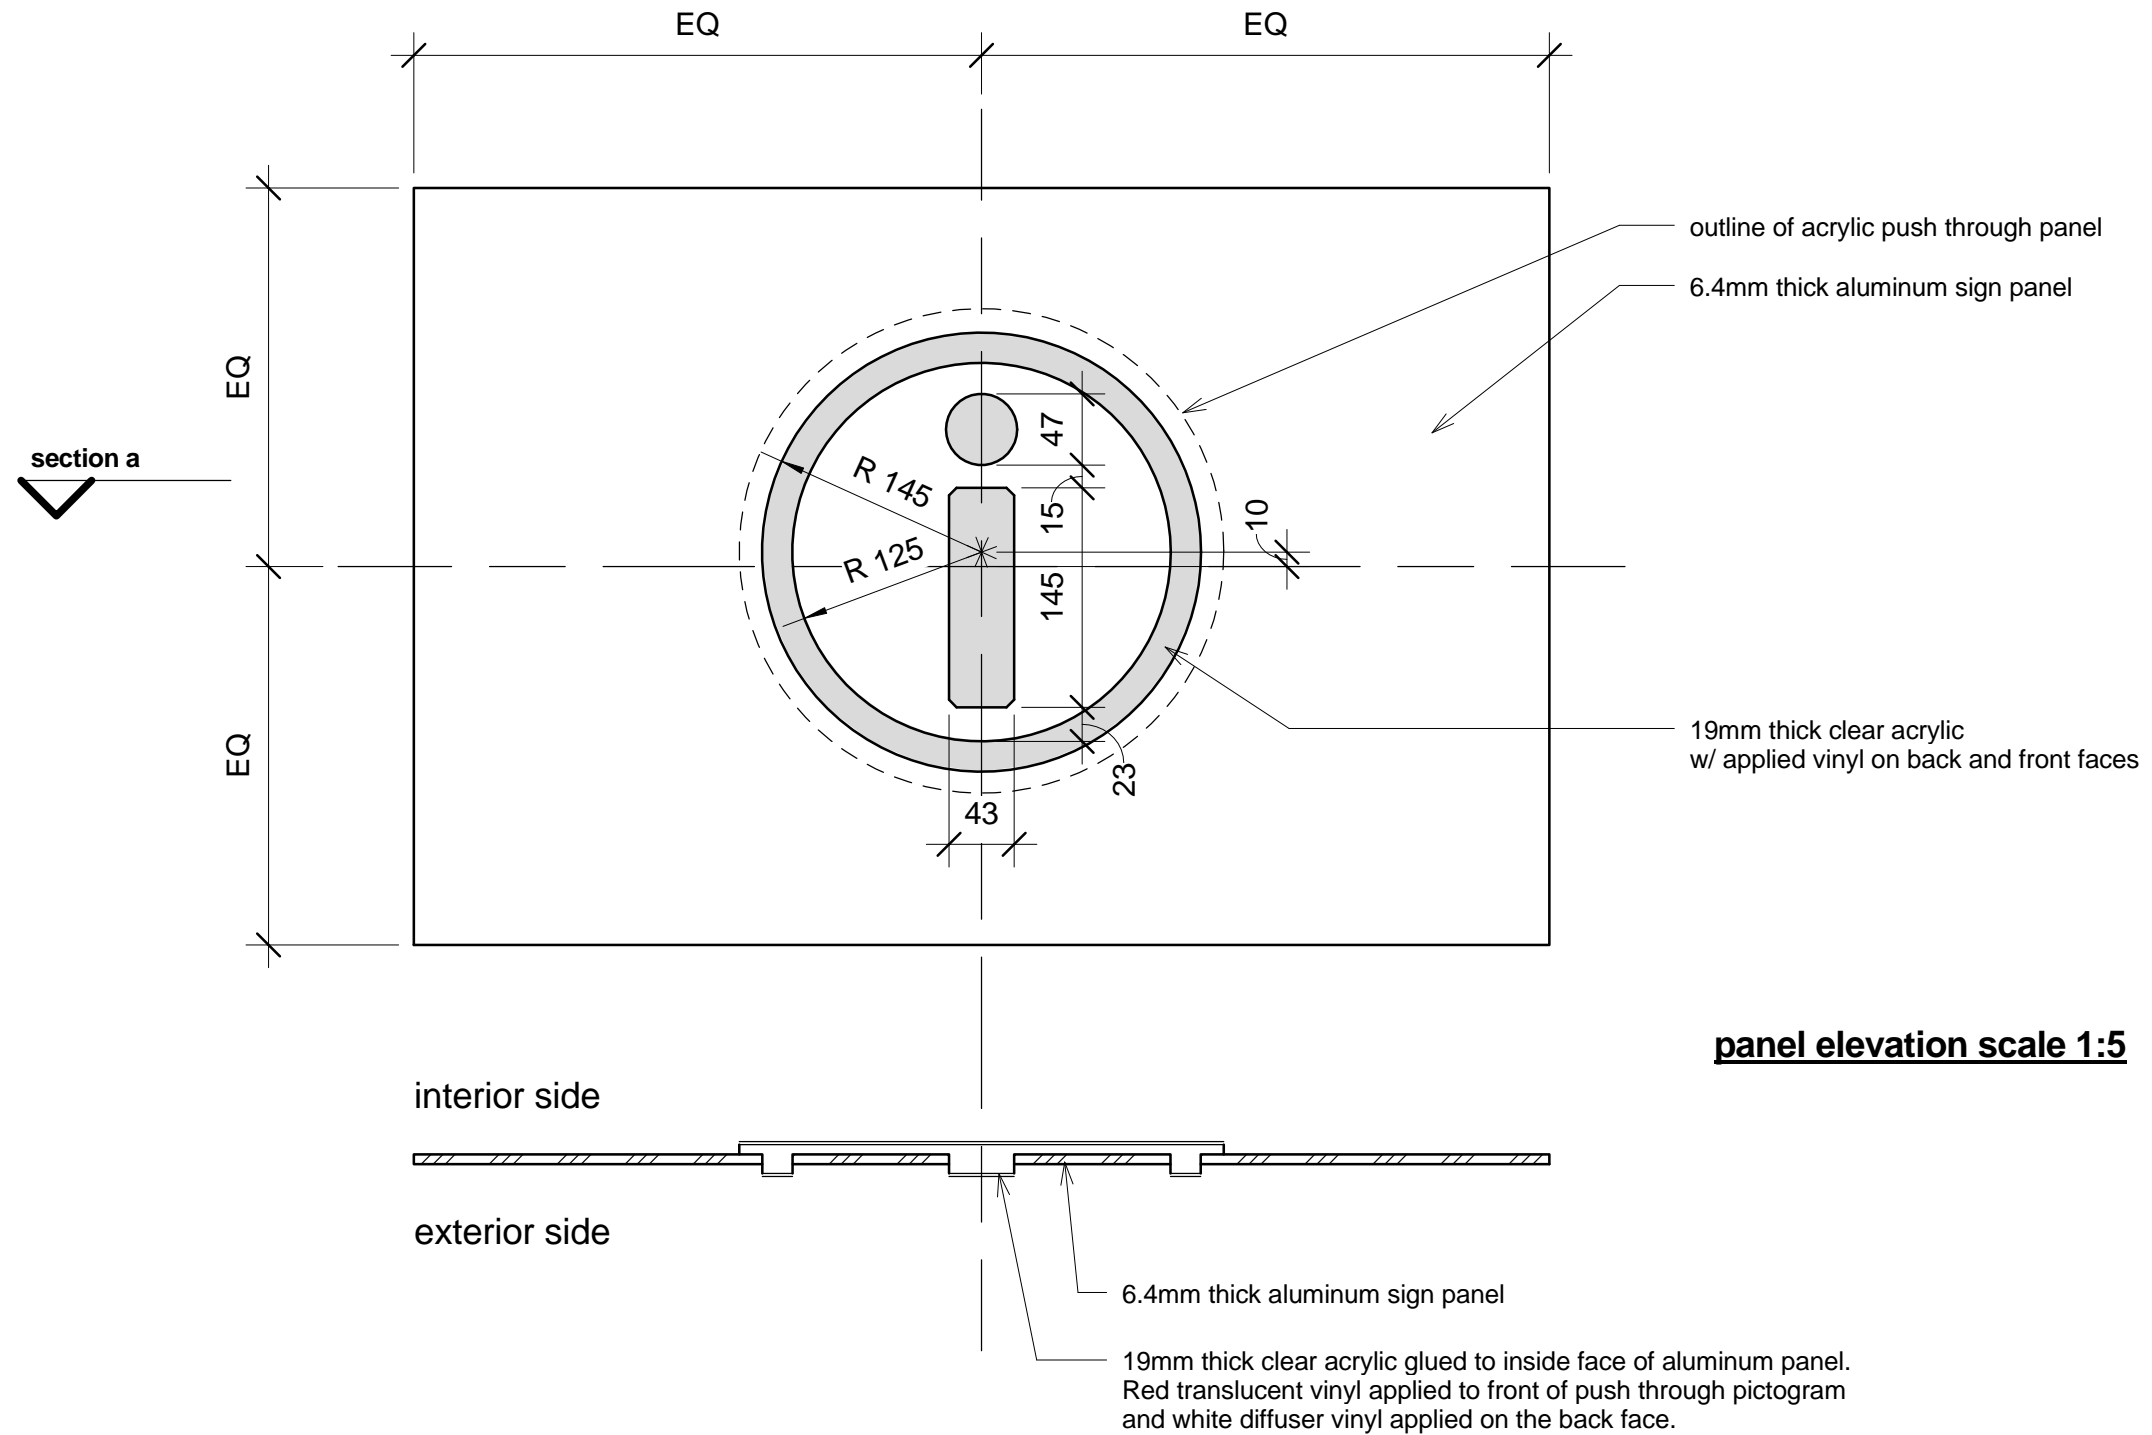

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section a scale 1:5

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47349 (3/4" s/s threaded)
 - washers: Fastenal part #71027 (3/4" s/s wahers)
 - nuts: Fastenal part #70717 (3/4" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 4. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with the Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.

STRUCTURAL NOTES (cont)

- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant "Torx-Pin" screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be "Pentagon" tamper resistant bolts, with "Pentagon" nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with "Pentagon" security nuts.

ELECTRICAL NOTES

- 1. Signs must be provided with CSA label
- 2. LED modules, power supplies, cable, wire and junction box must be integral with signs
- 3. All electrical installations to be done in accordance with the Canadian Electrical Code and as reccomended by the LED lighting manufacturer.
- 4. Run 2#8 +GND conductors in 27mm PVC conduit from sign to existing campus exterior lighting pole standard. Intercept existing underground conduit, install an H20 rated flush junction box with bolt-on cover and splice into exterior lighting circuit.
- 4. The sign manufacturer shall provide an electrical shop drawings indicating input power requirements and a schematic wiring diagram for the sign.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes - structural




Sign No. 10

Pedestrian - Intermediate Directional

core colours



clear anodized coating



PANTONE 185 C
pinstrip, arrows



PANTONE 426 C
text



PANTEONE 7541 C
background, UVic Logo



gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family


Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ

abcdefghijklmnopqrstuvwxyz

1234567890

arrow style and arrow size in relation to text height

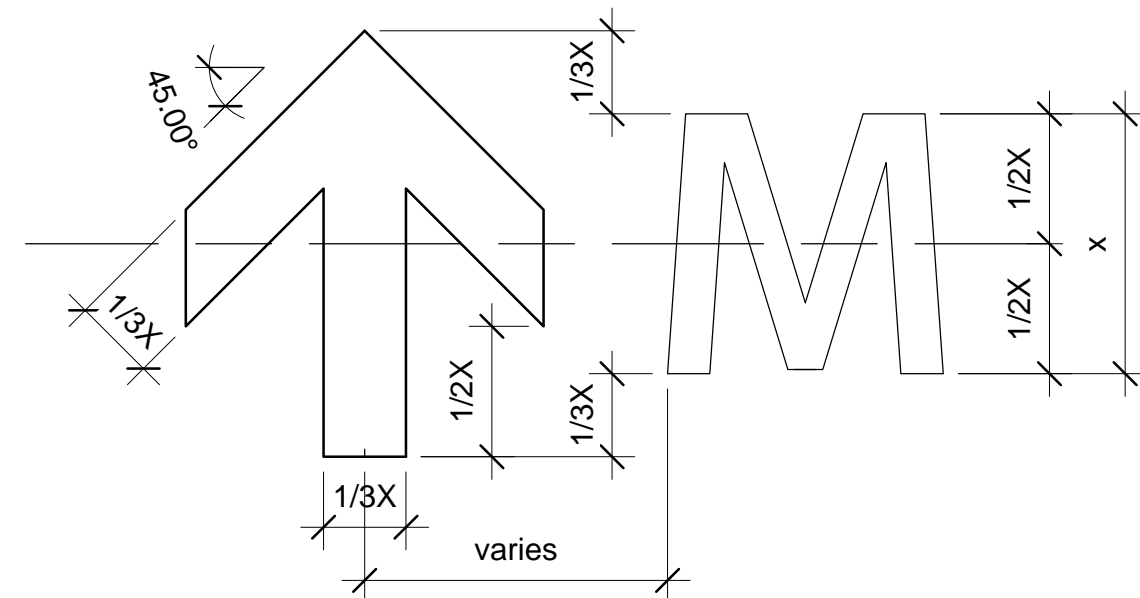

University of Victoria Logo, horizontal standard




University of Victoria



University of Victoria




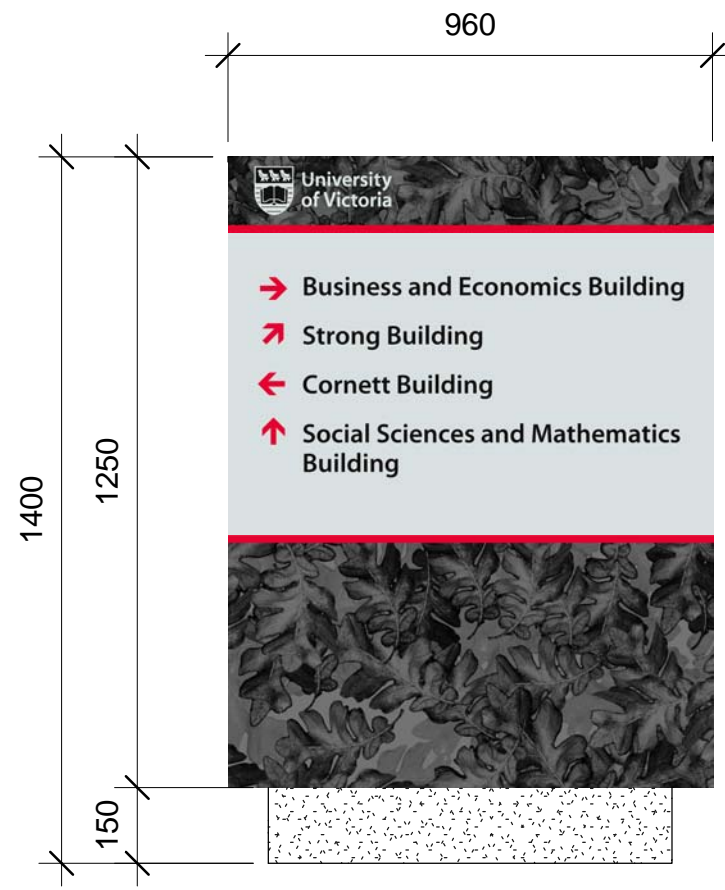

back



side

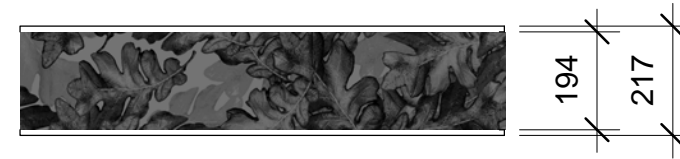

top




front



side

scale 1:15

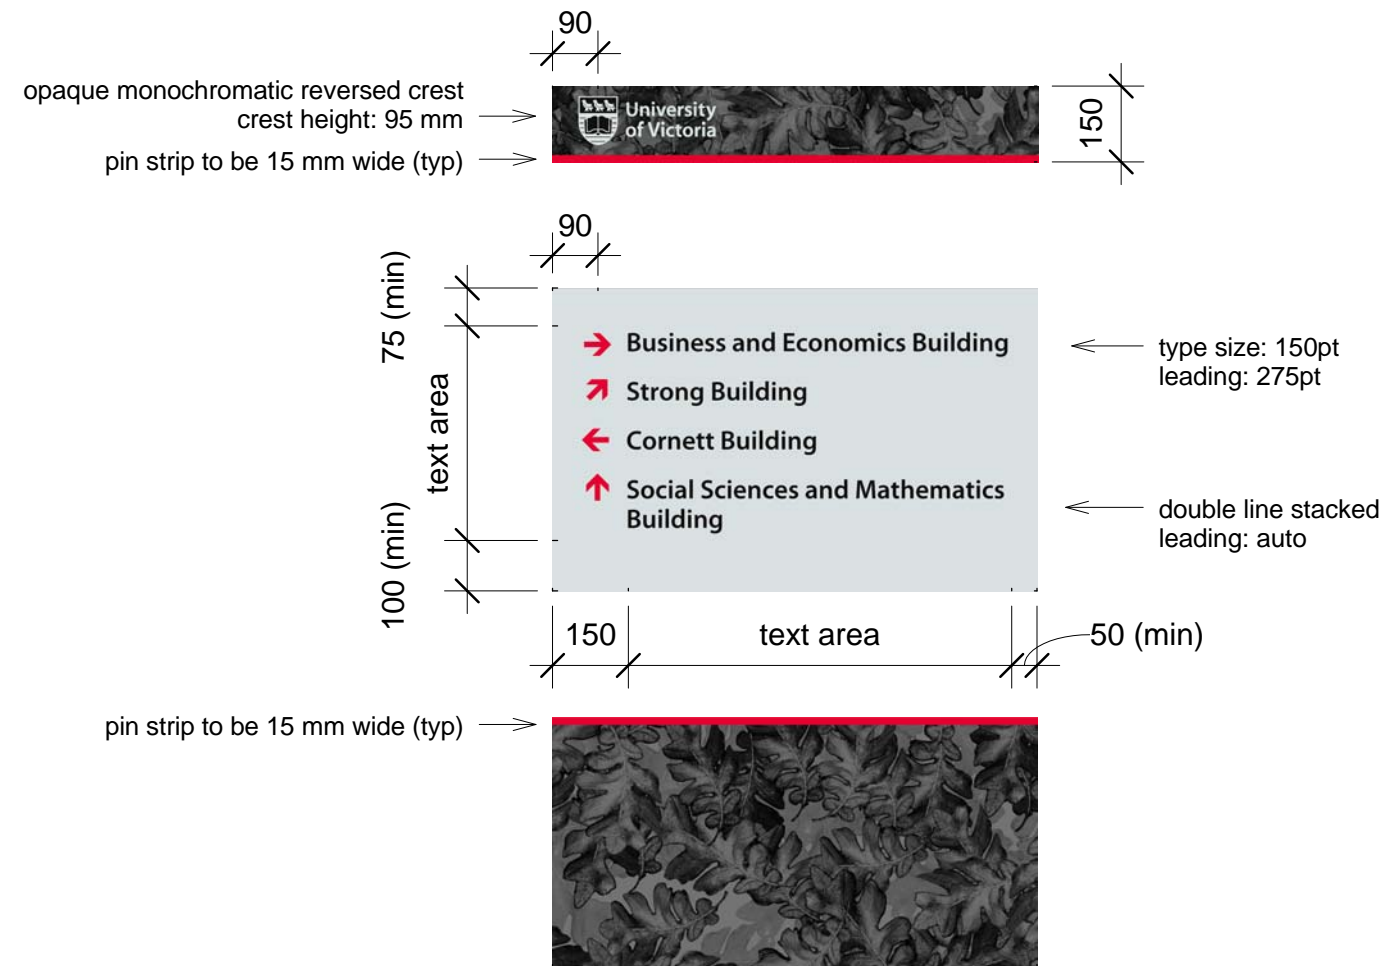


scale 1:15

Description
Digitally printed vinyl protected with
anti-graffiti, optically clear overlaminate
Front/Back aluminum panel size (one piece): 960 mm x 1250 mm x 6.4 mm
Top Aluminum panel size (one piece): 194 mm x 960 mm x 3.2 mm
Side aluminum panel size (one piece): 194 mm x 1243.6 mm x 3.2 mm
See sheet 05 for details.

Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlaminate: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and overlaminate over the edges of the aluminum panels.

Refer to Adobe Photoshop files for detailed sample layout

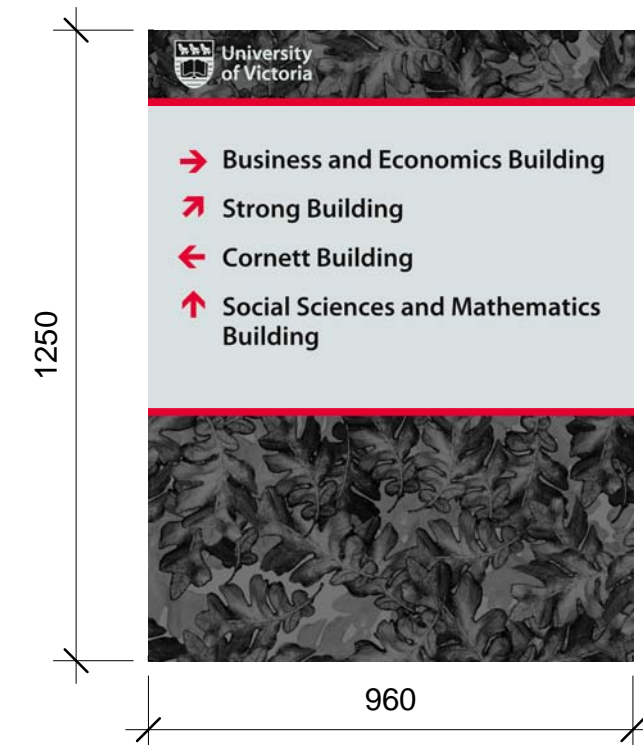

scale 1:15

project: Campus Wayfinding
number: FM 09-8567
issue date: January 31, 2012


sign: Sign No. 10 - Intermediate Directional
sheet name: graphic design details
scale: as noted

sheet
number:


04



**University
of Victoria**

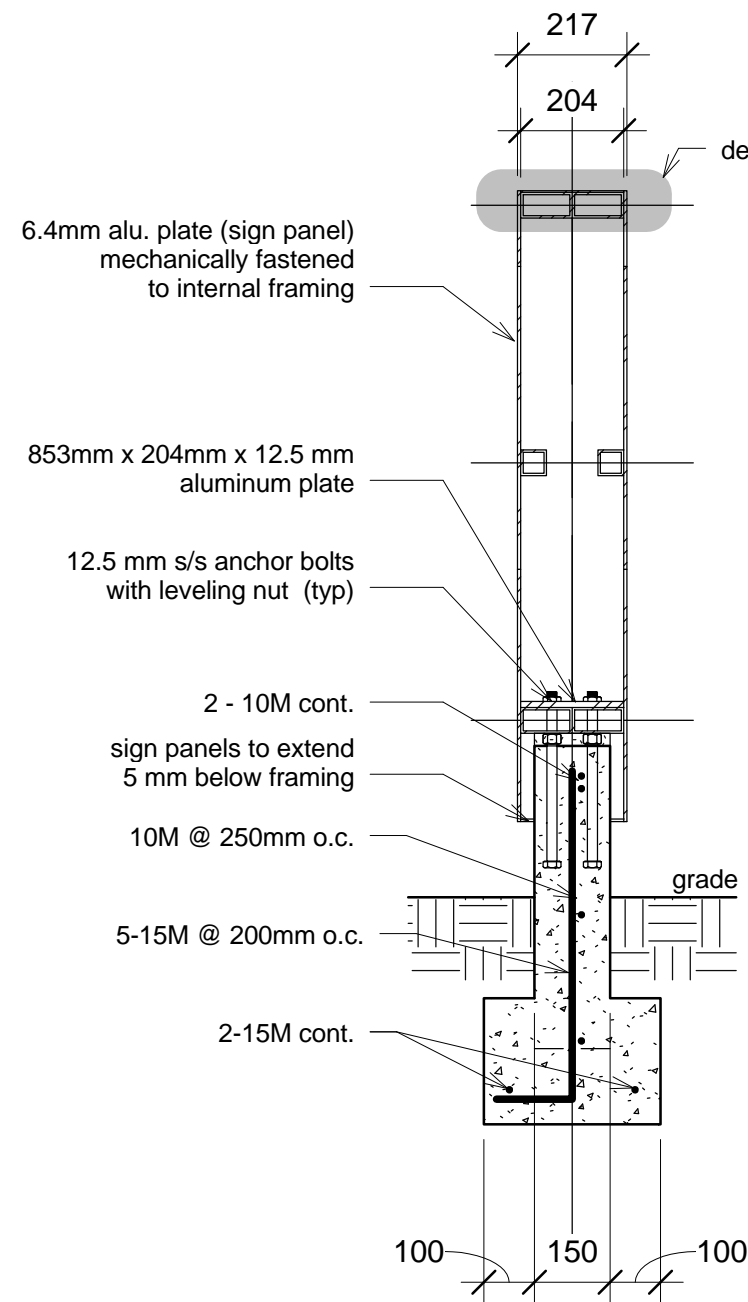


cross section scale 1:15

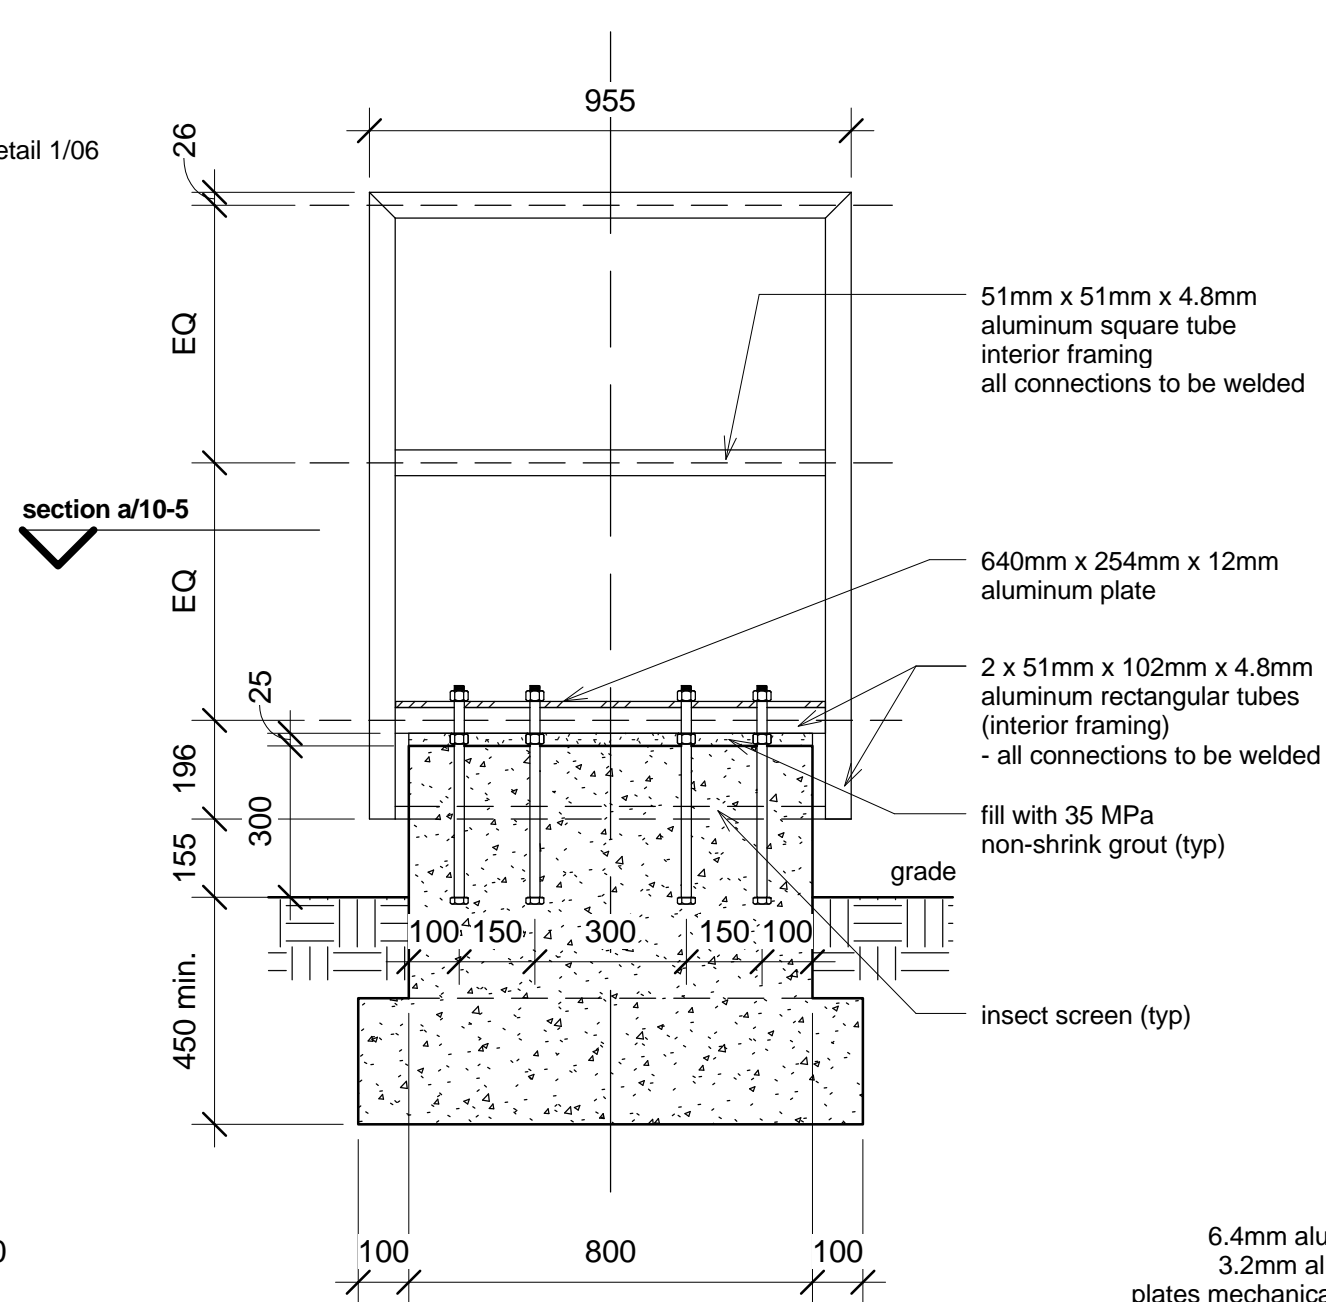

long section scale 1:15

General Note:
Manufacturer to verify all dimensions
prior to sign fabrication. All discrepancies
should be reported to the Architect.

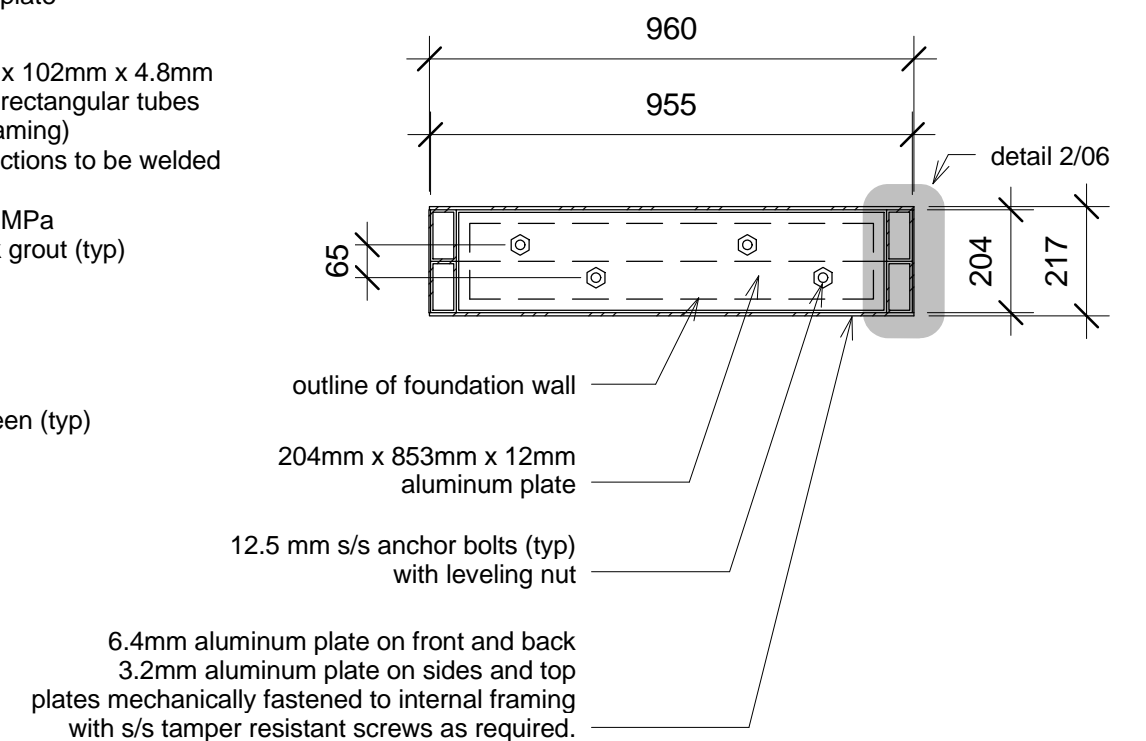

plan section a scale 1:15

project: Campus Wayfinding
number: FM 09-8567
issue date: January 31, 2012


sign: Sign No. 10 - Intermediate Directional
sheet name: sign construction - sections
scale: as noted

sheet
number:


05



**University
of Victoria**

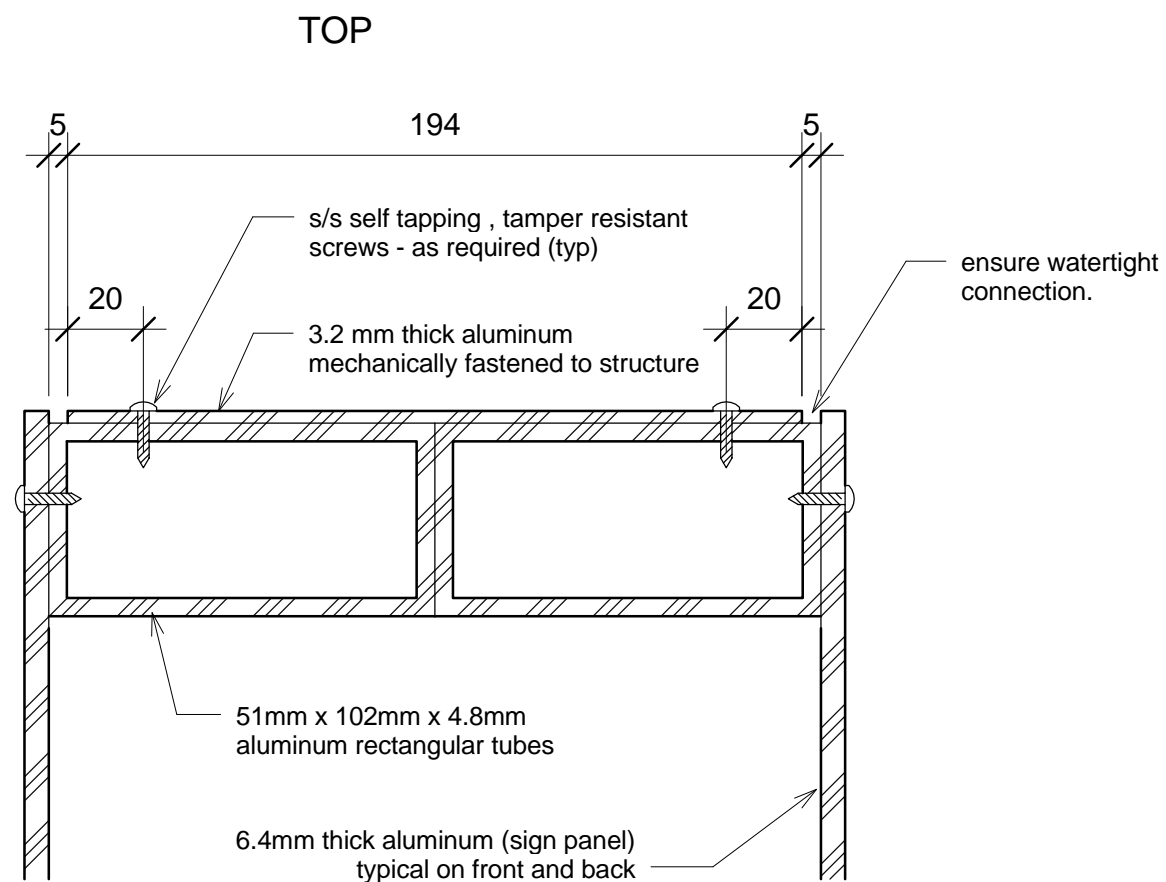

section detail 1 scale 1:2

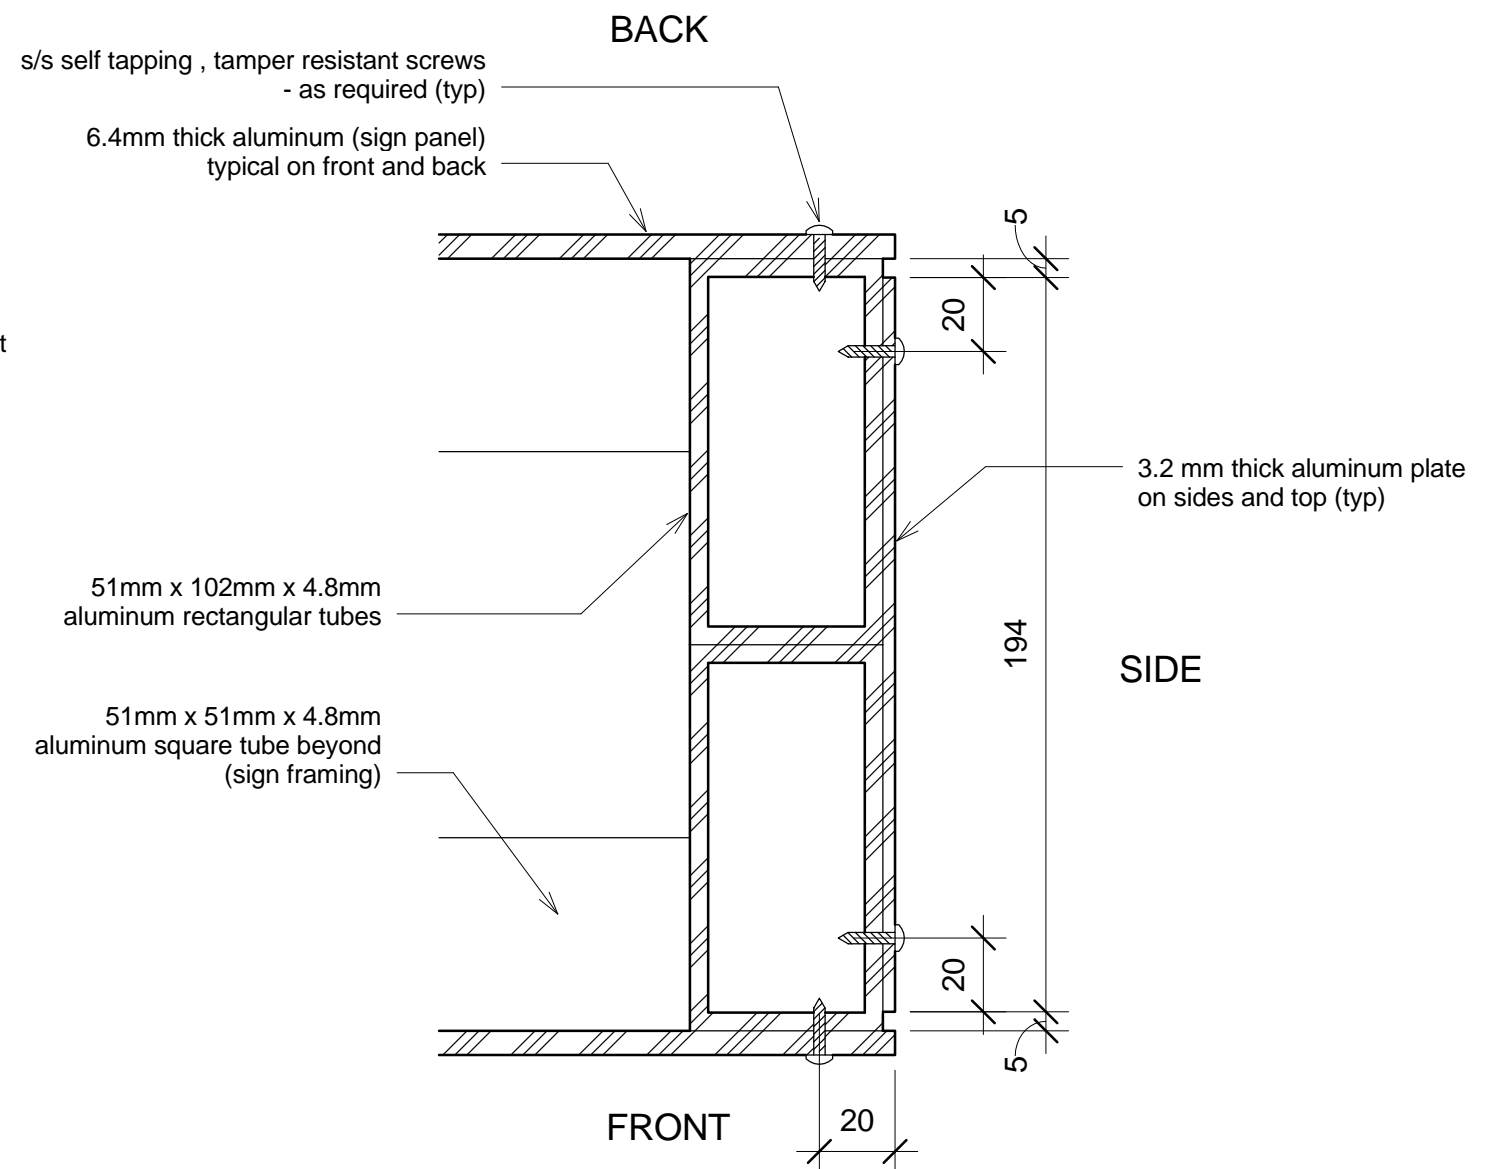

plan detail 2 scale 1:2

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M.
Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
Anchor bolts to be secured with “Pentagon” security nuts.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design/graphic design details
04	sign construction - sections and plans
05	general notes



Sign No. 11 Pedestrian - Street Blade


core colours



clear anodized coating
application: sign structure



PANTONE 185 C
application: pinstrip, arrows



white
application: text



PANTONE Cool Gray 11 C
application: background



PANTONE Black 3 C
application: background




PMS Black 3C
black anodized
application: blade body

samples of typeface family


Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890



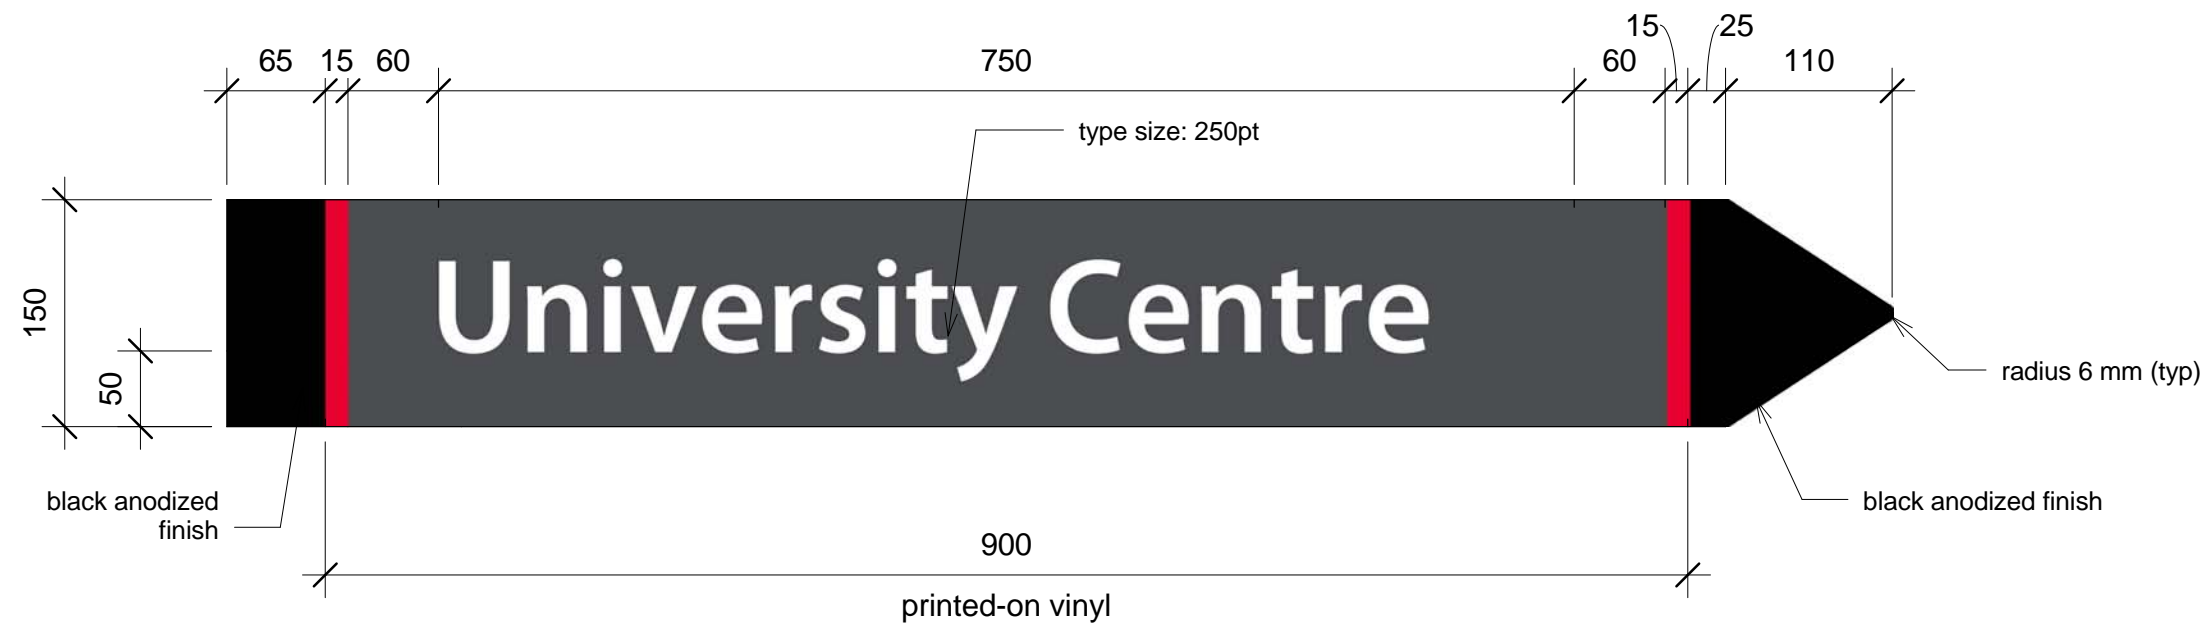

blade type a (long) double sided scale 1:5

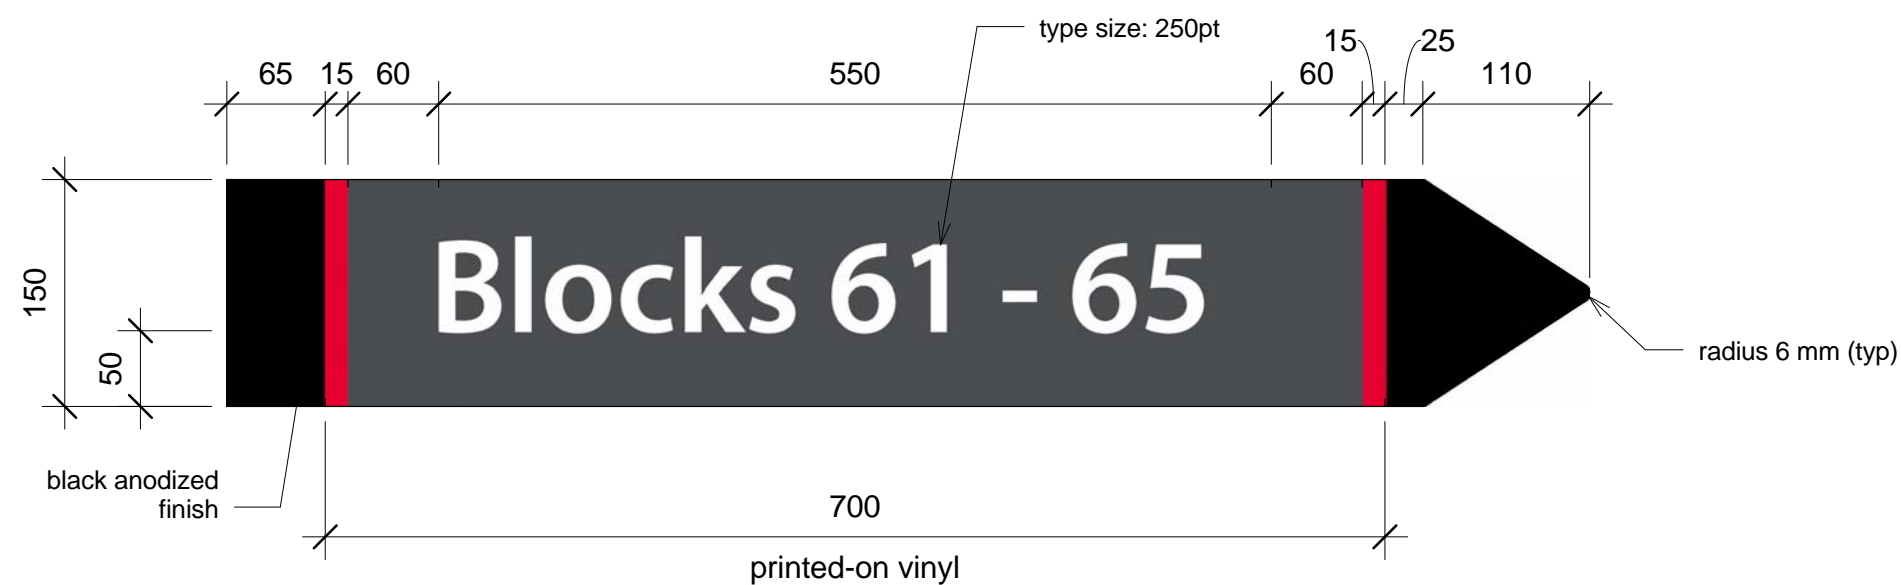


blade type b (short) double sided scale 1:5

Description
Digitally printed vinyl protected with
anti-graffiti, optically clear overlamine


Blade: black anodized aluminum
Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer
- 3) Wrap vinyl and laminate over the edges of the aluminum panel.
- 4) If long text message, then typeset should be scaled down horizontally to fit in the provided space - coordinate all cases with University of Victoria

Refer to Adobe Photoshop files for detailed sample layout

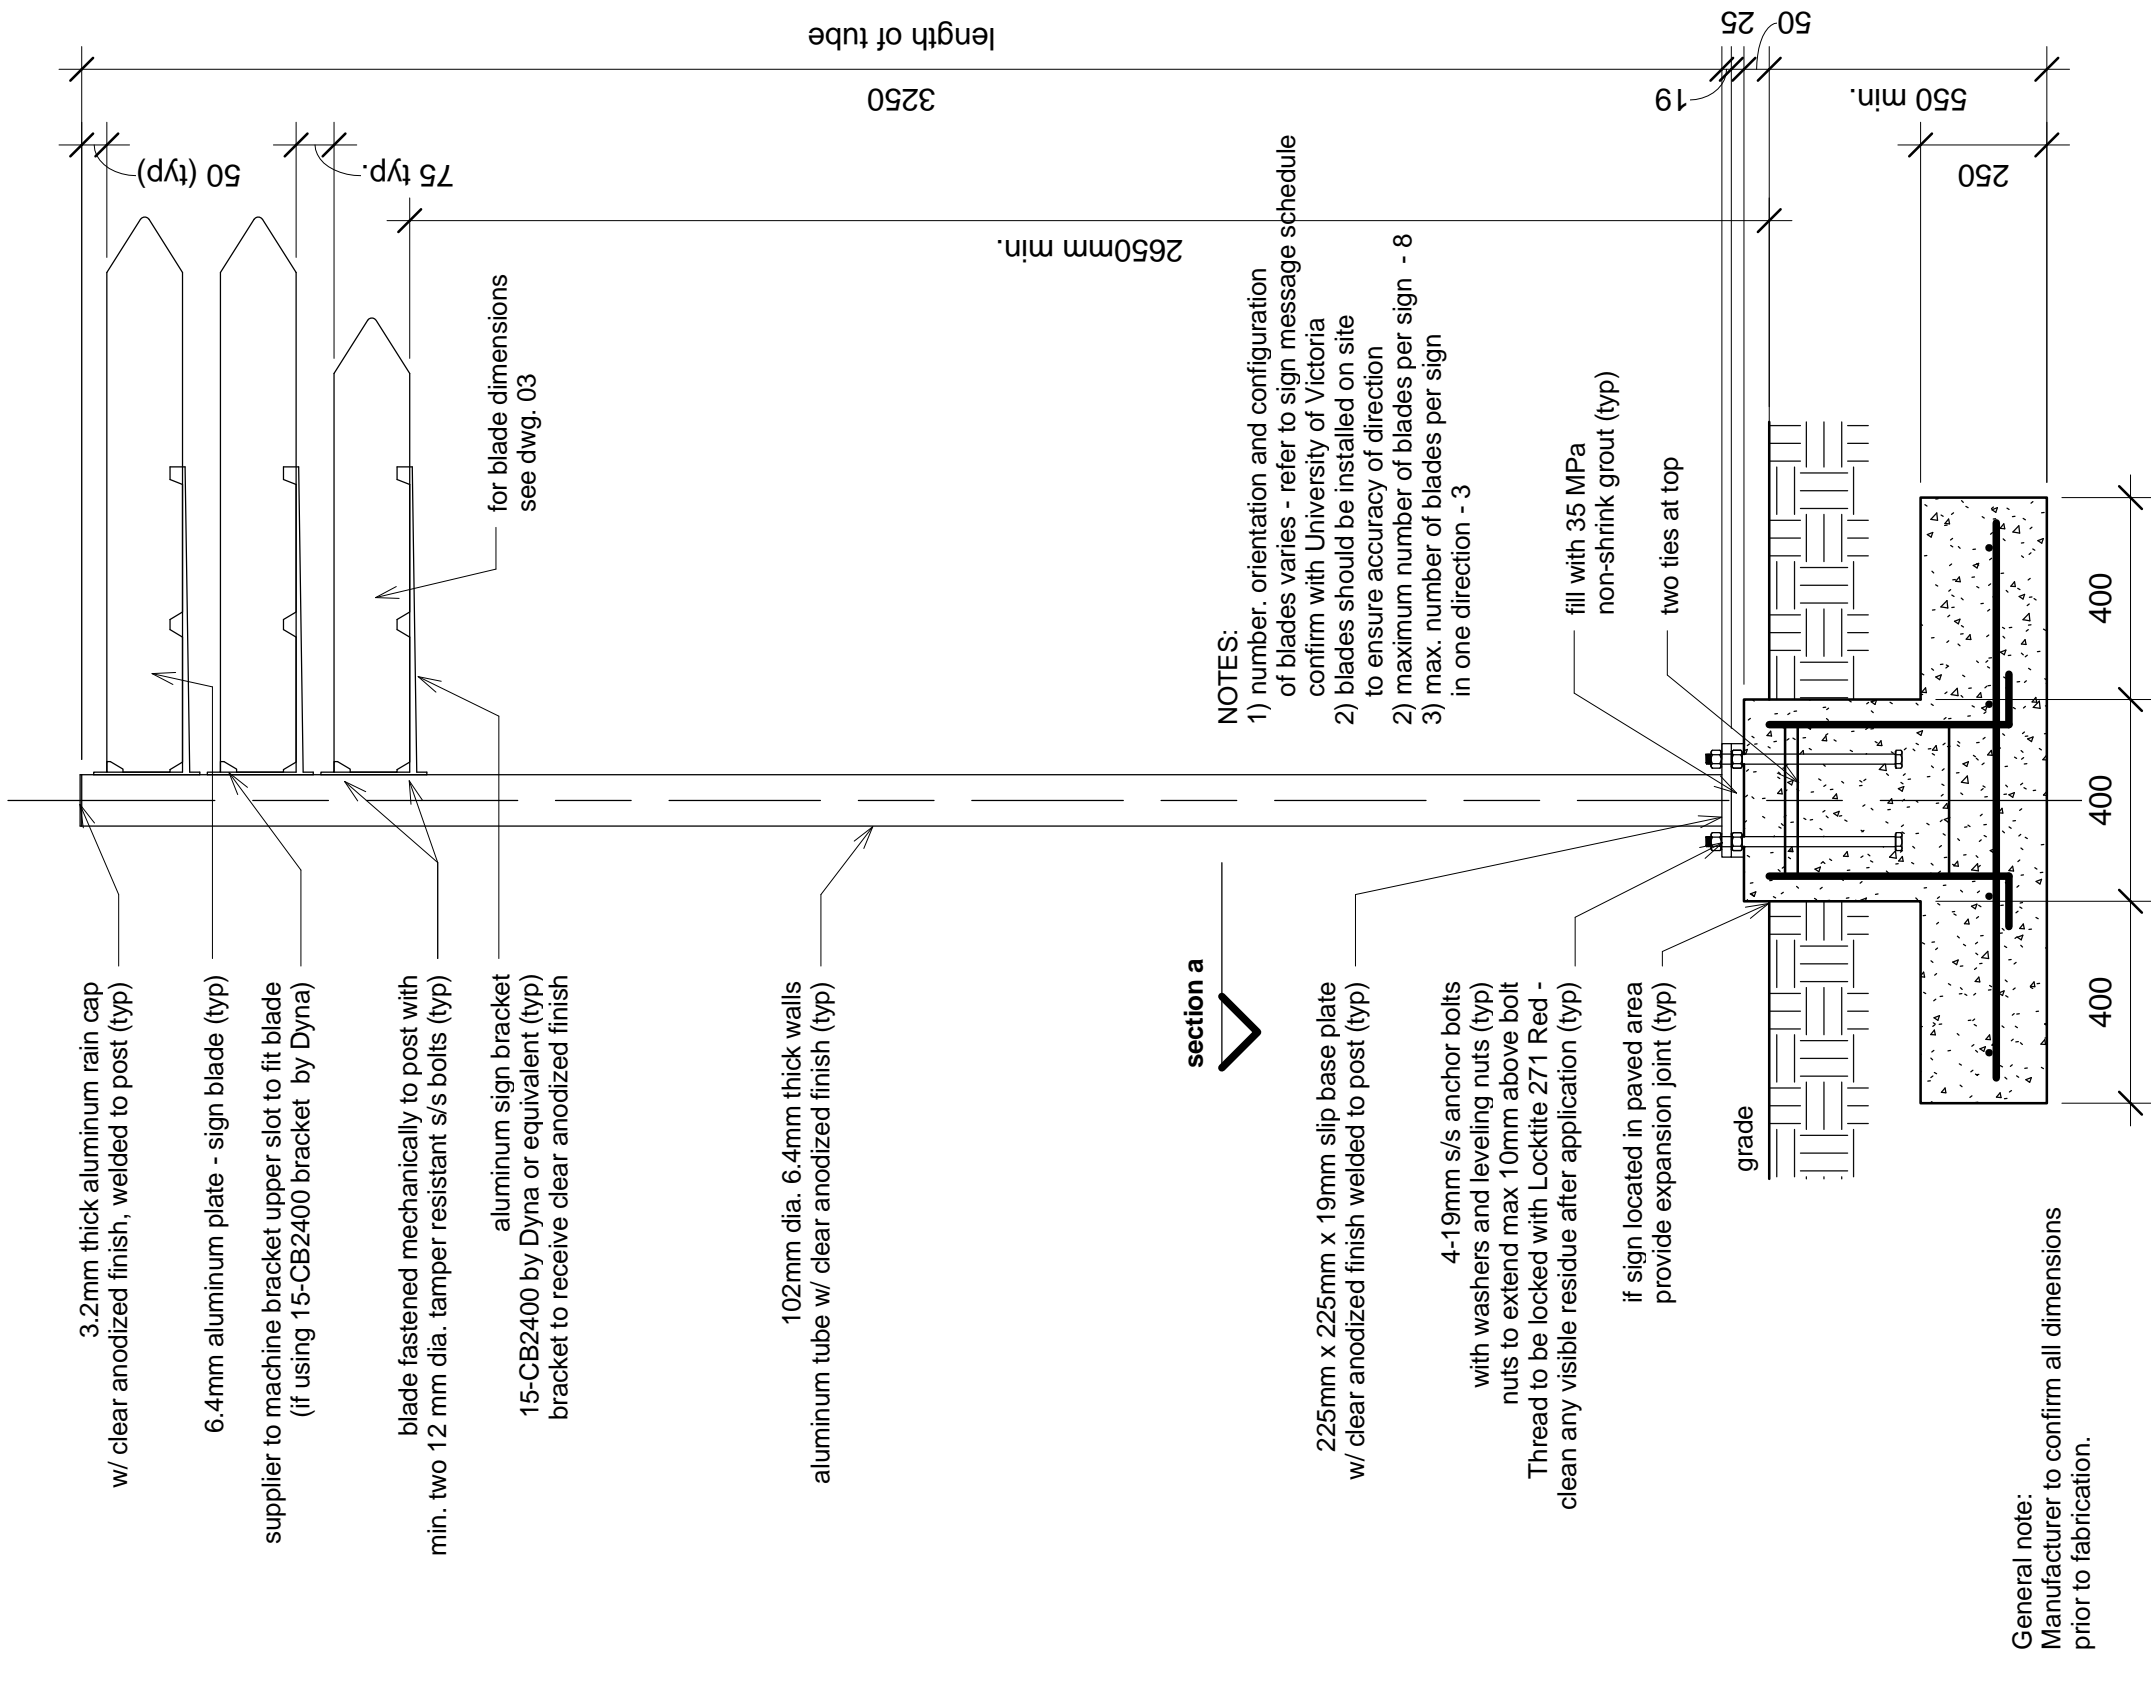

front view/section scale 1:15

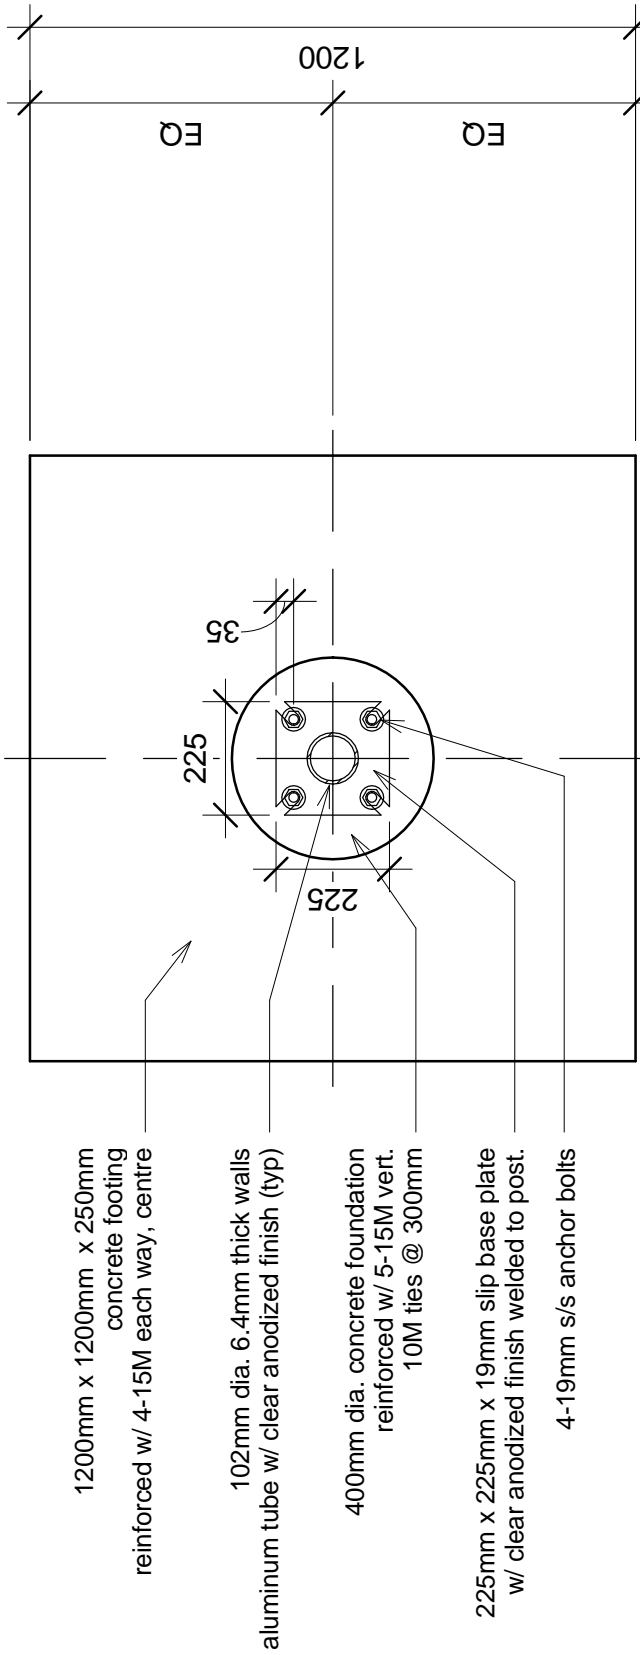

plan a scale 1:15

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - bracket/posts:
 - thru bolts: Fastenal part #73815 (3/8" s/s x 1" button Socket cap screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design - overview
04	sign design - graphic design details
05	sign construction - sections
06	sign construction - details
07	general notes




Sign No. 12

Pedestrian - Minor Wayfinding A

core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
back panel (single sided sign)
crest - reversed monochromatic




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family


Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

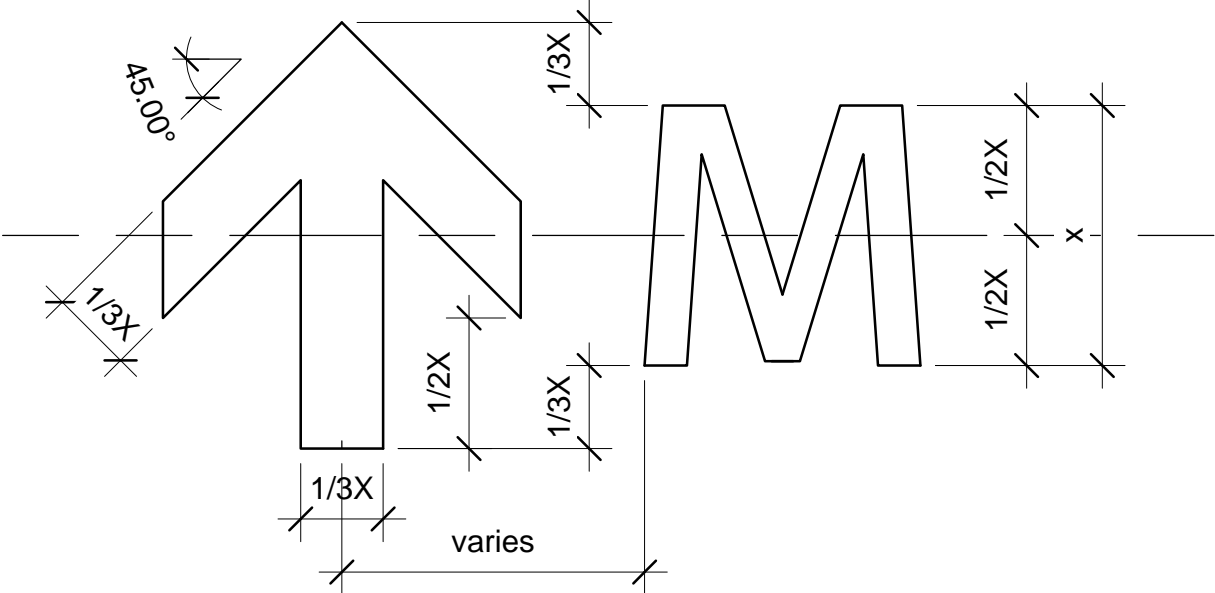


University of Victoria Logo, horizontal standard




University
of Victoria

full colour



University
of Victoria


opaque monochromatic




University
of Victoria

opaque monochromatic reversed



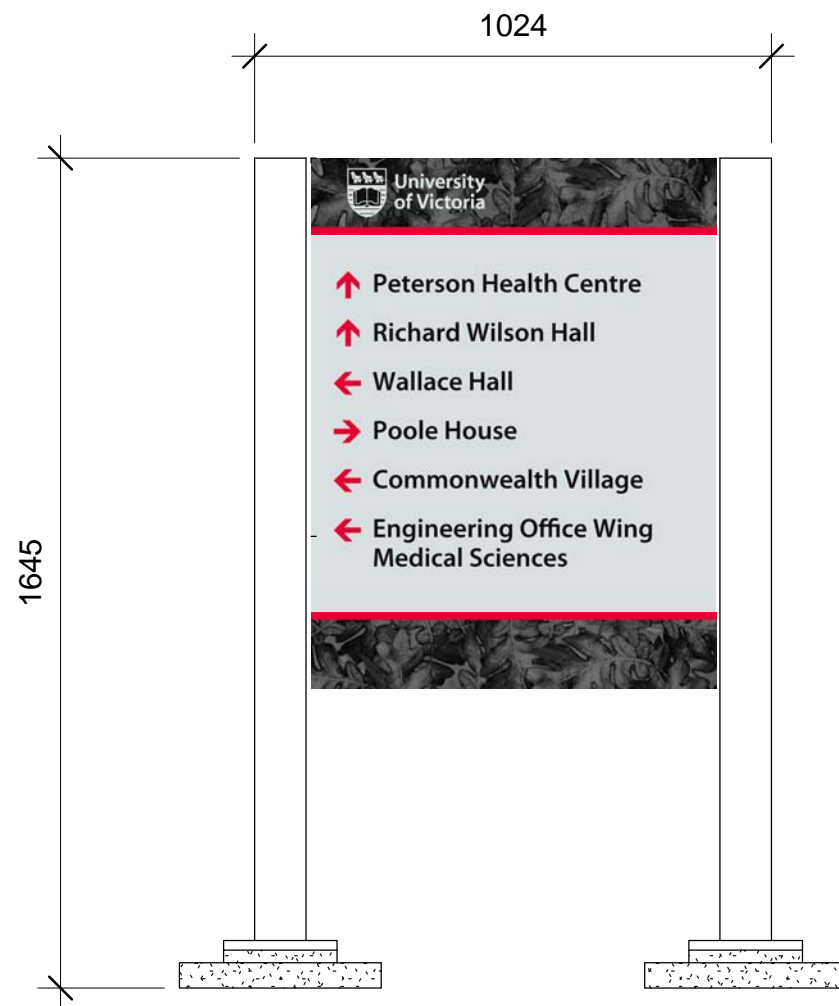


Minor Wayfinding A
scale 1:15



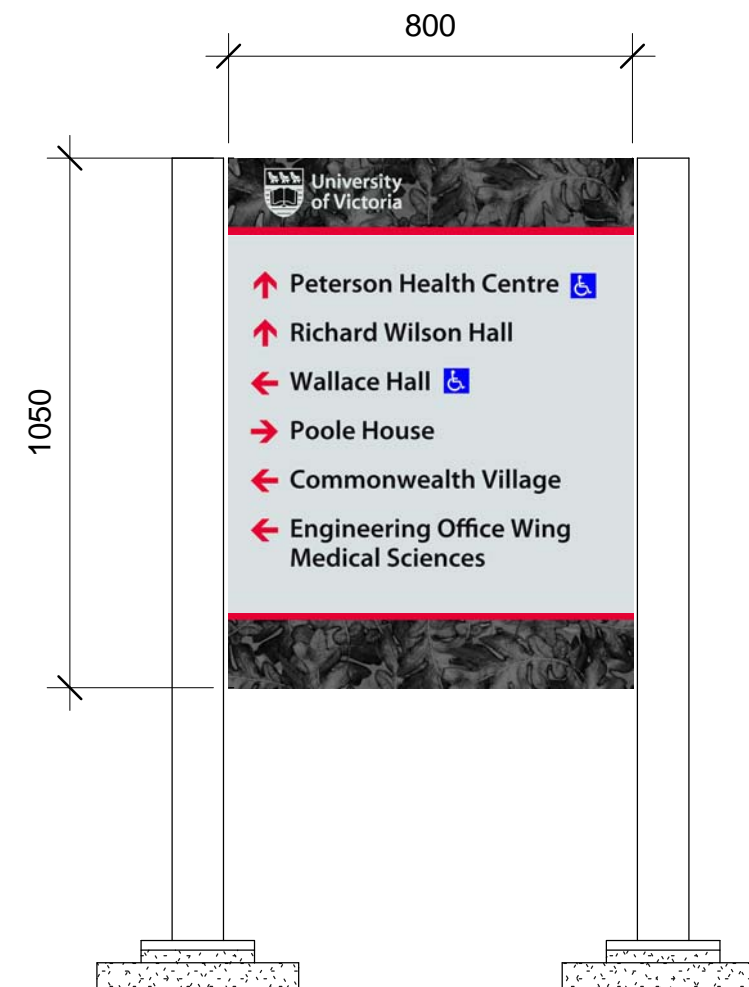


Minor Wayfinding A (with pictograms)
scale 1:15



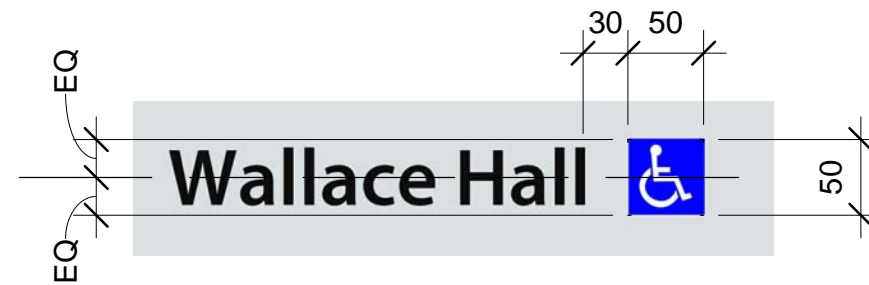

placement of pictogram
scale 1:5

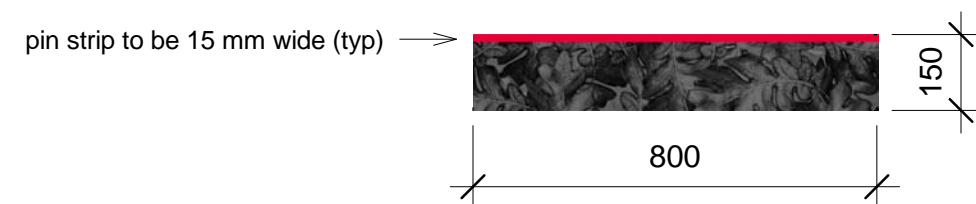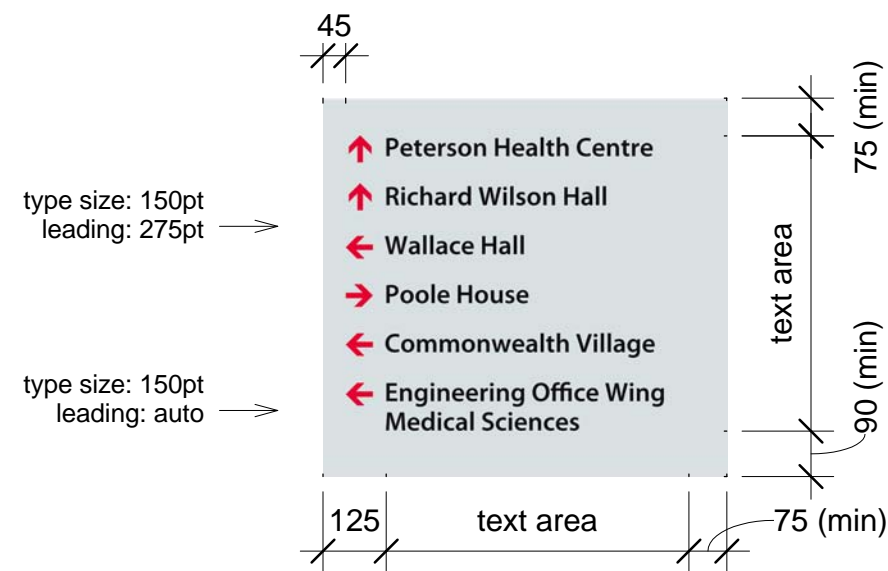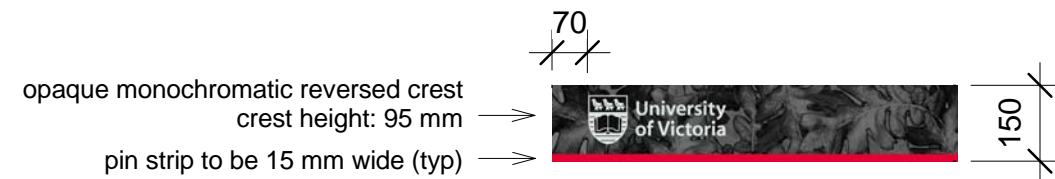


scale 1:15

Description
Digitally printed vinyl protected with
anti-graffiti, optically clear overlamine
Aluminum panel size (one piece): 800 mm x 1050 mm x 6.4 mm
See sheet 05 for details.


Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlamines as recommended by manufacturer
- 3) Wrap vinyl and overlamine over the edges of the aluminum panel.
- 4) If single sided sign then back panel to receive vinyl printed with PANTEONE 7541 C

Refer to Adobe Photoshop files for detailed sample layout



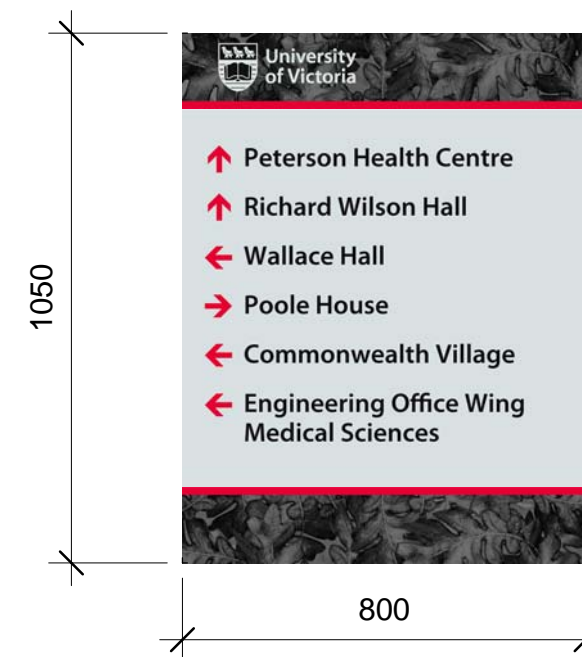


option without pictograms

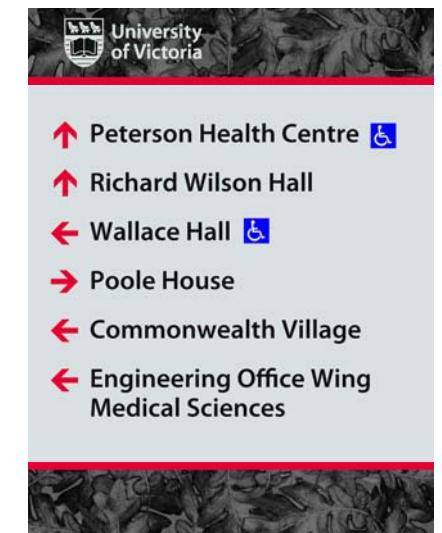

option w/ pictograms

scale 1:15

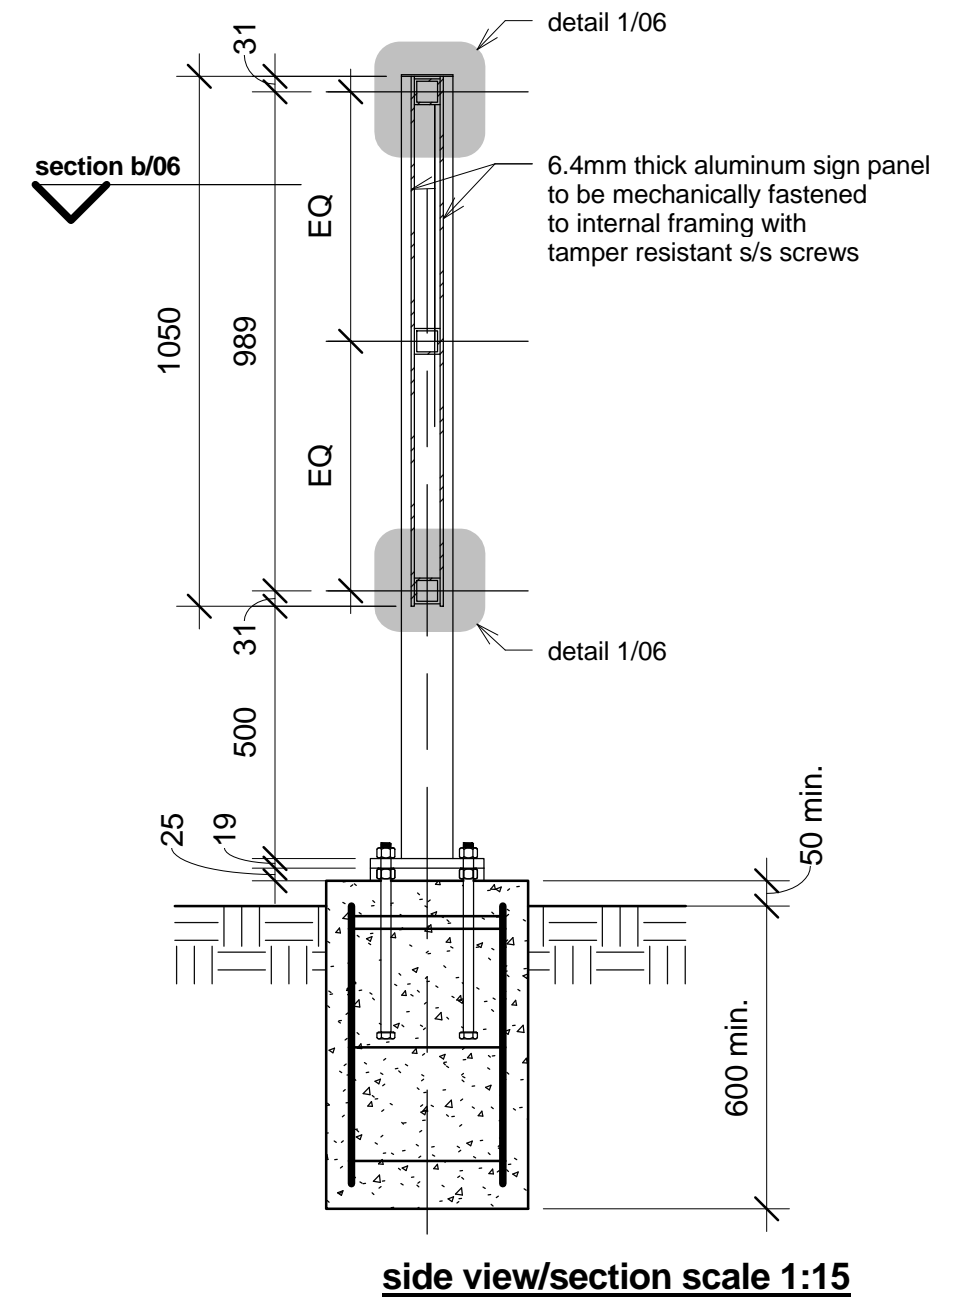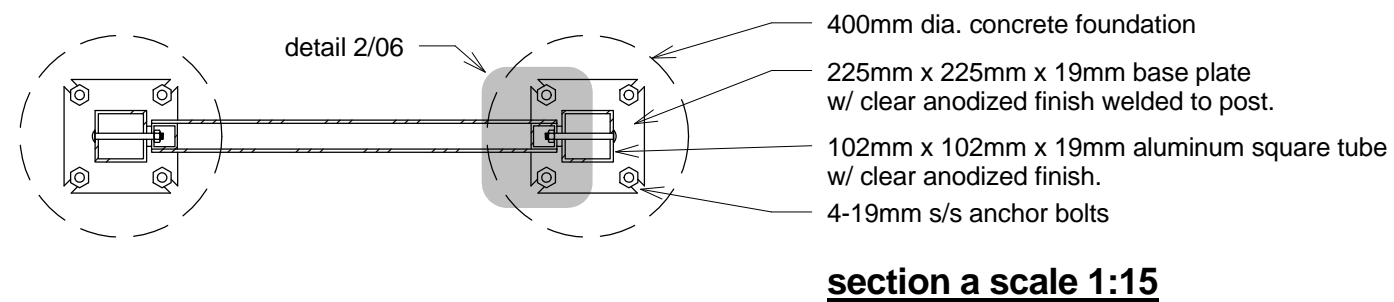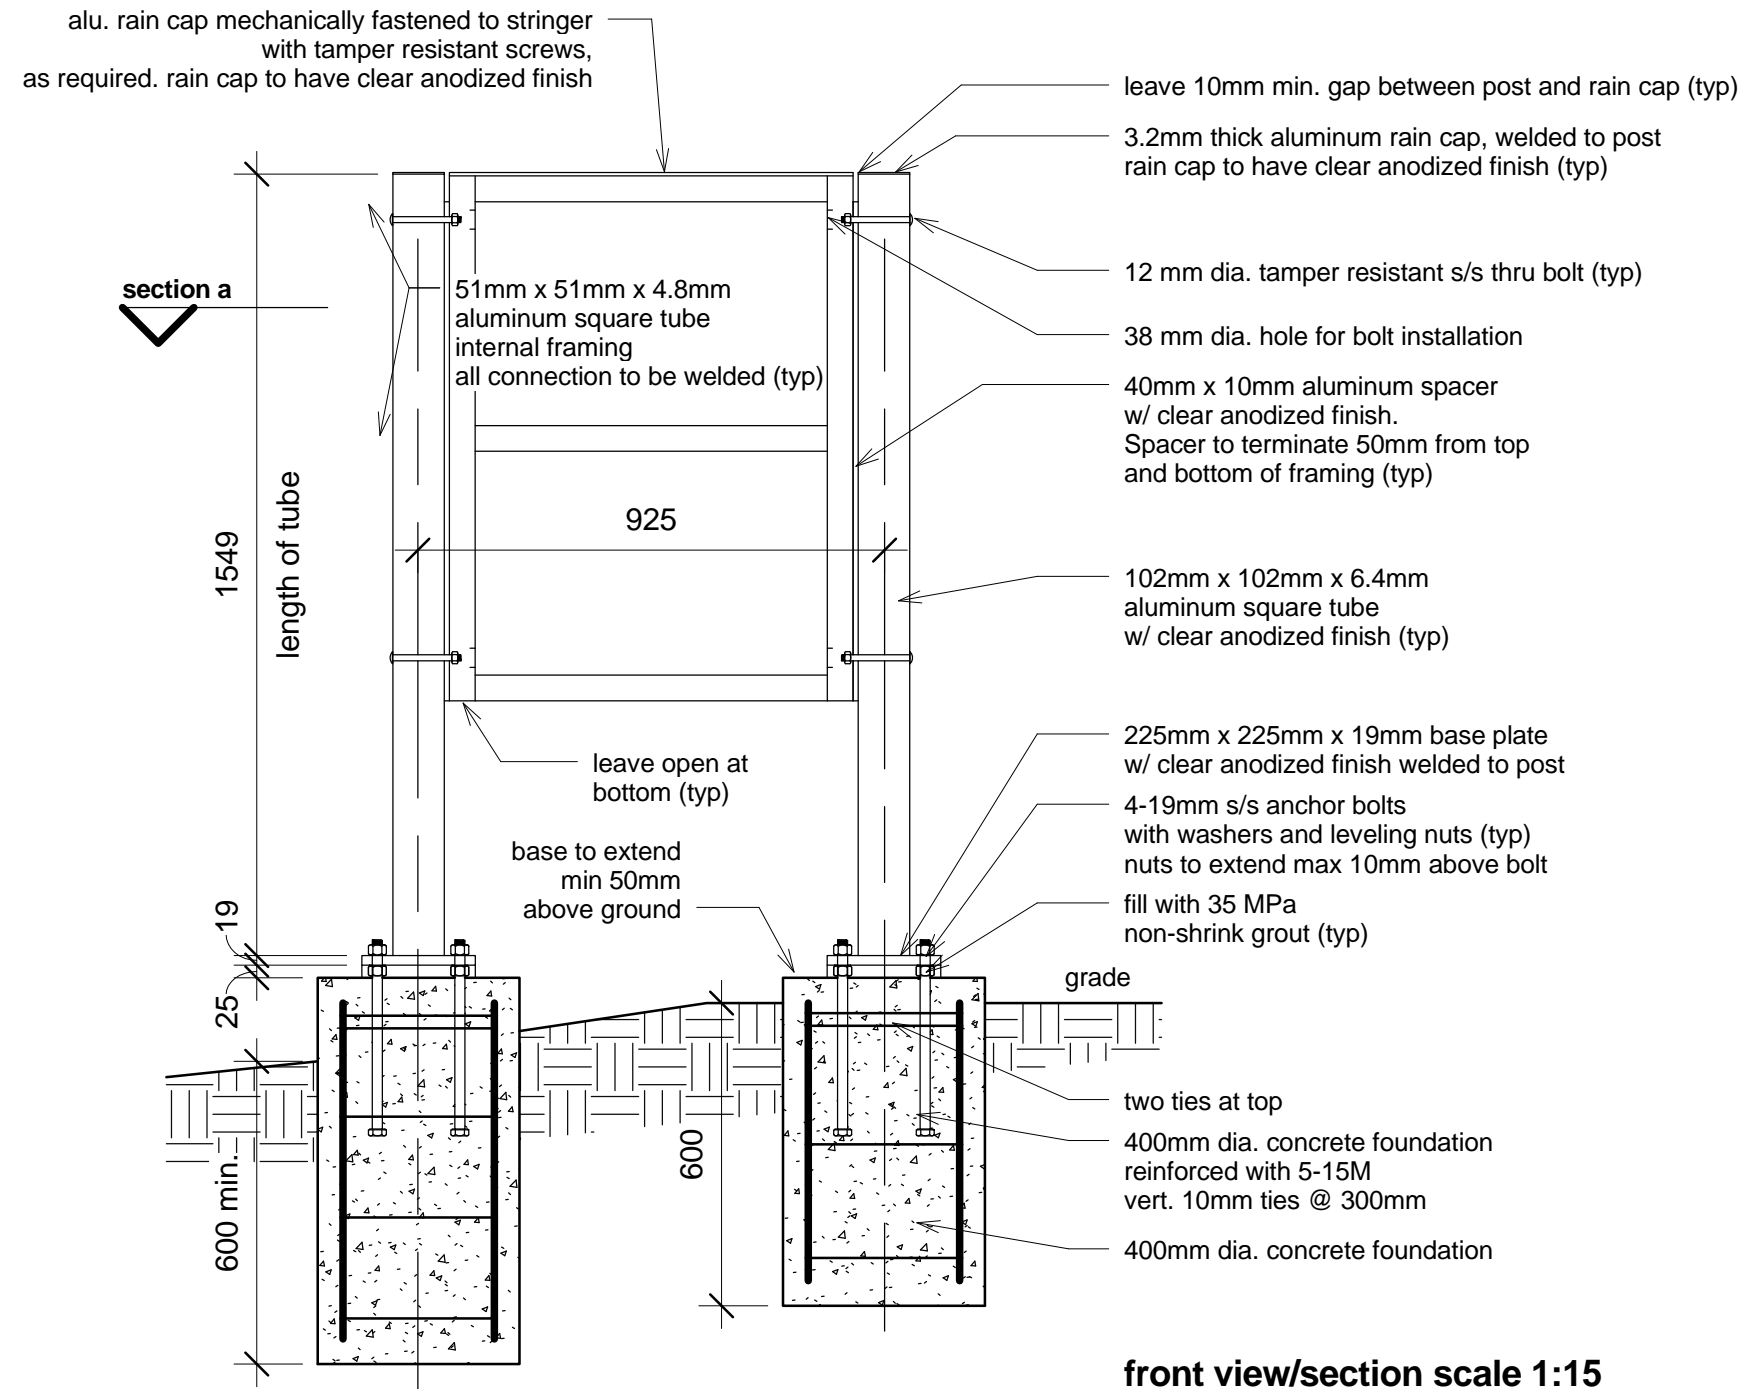

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012


sign: Sign No. 12 - Minor Wayfinding A
sheet name: sign construction - sections
scale: as noted

sheet number:

05




University of Victoria

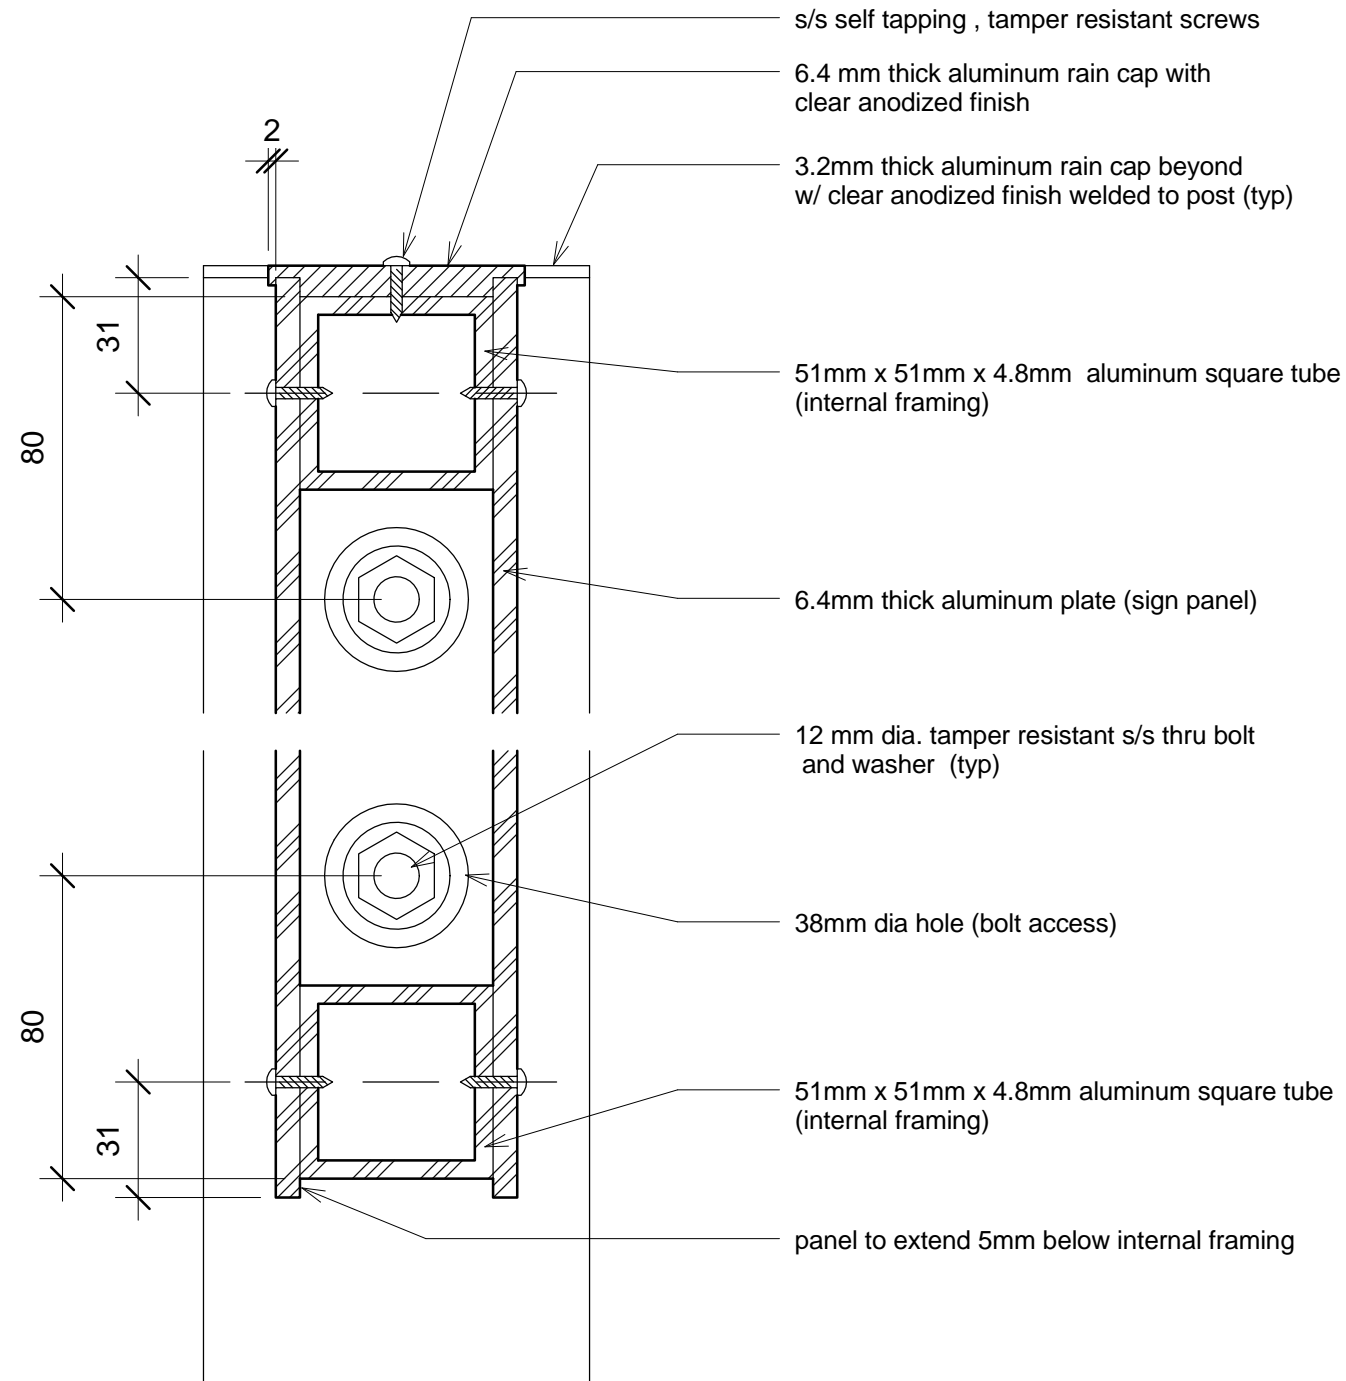


General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

section detail 1 scale 1:2

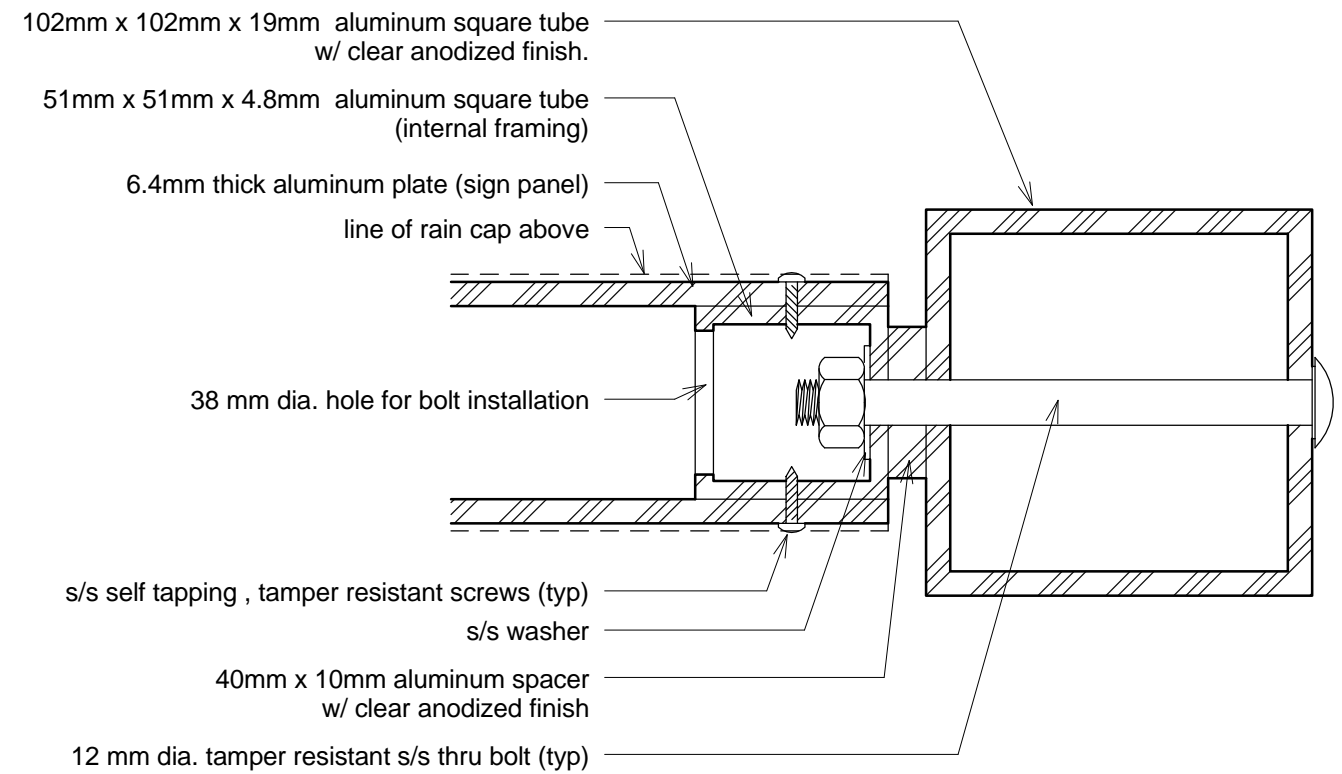

section detail 2 scale 1:2

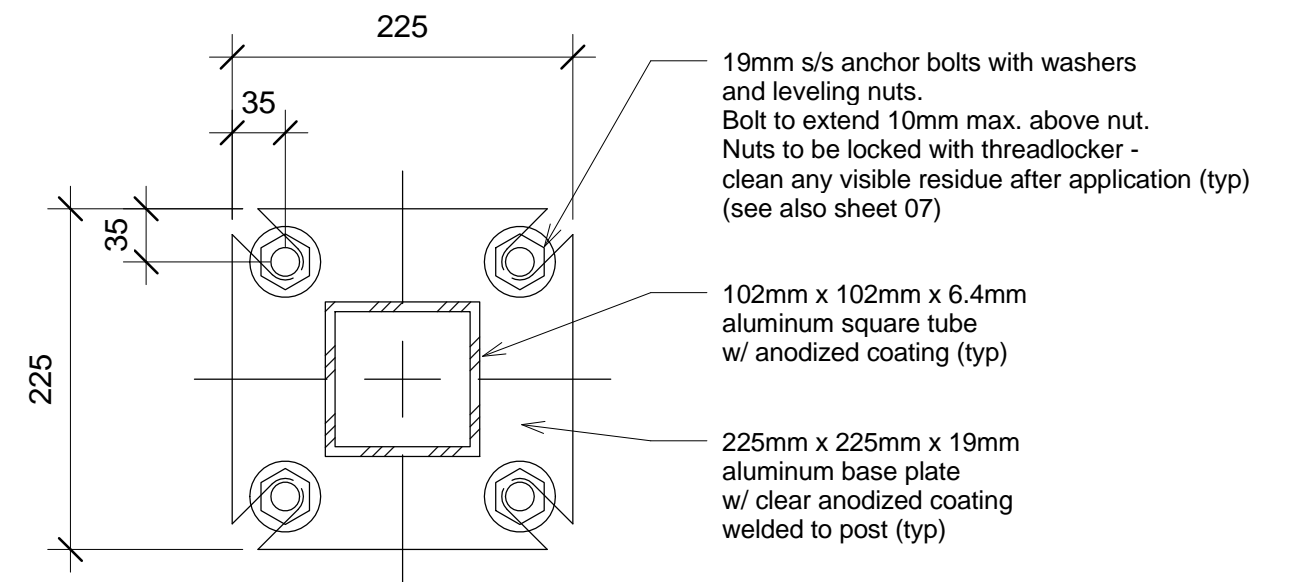

section b (slip base) scale 1:5

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 12 - Minor Wayfinding A
sheet name: sign construction - details
scale: as noted

sheet
number:

06



**University
of Victoria**

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
- Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #174786 (1/2" s/s x 5" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
 - panels:
 - security screws panel attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
 - rain cap attachment: Fastenal part #BS0160024SSH200 (10-24 x 3/4" button head security screw)
- 3. Threadlocker: Locktite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.





Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	sign design/graphic design details
03	sign and graphic design
04	sign and graphic design, mounting details
05	general notes


Sign No. 13

Pedestrian - Minor Wayfinding B


core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
crest - reversed monochromatic




garry oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family


Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

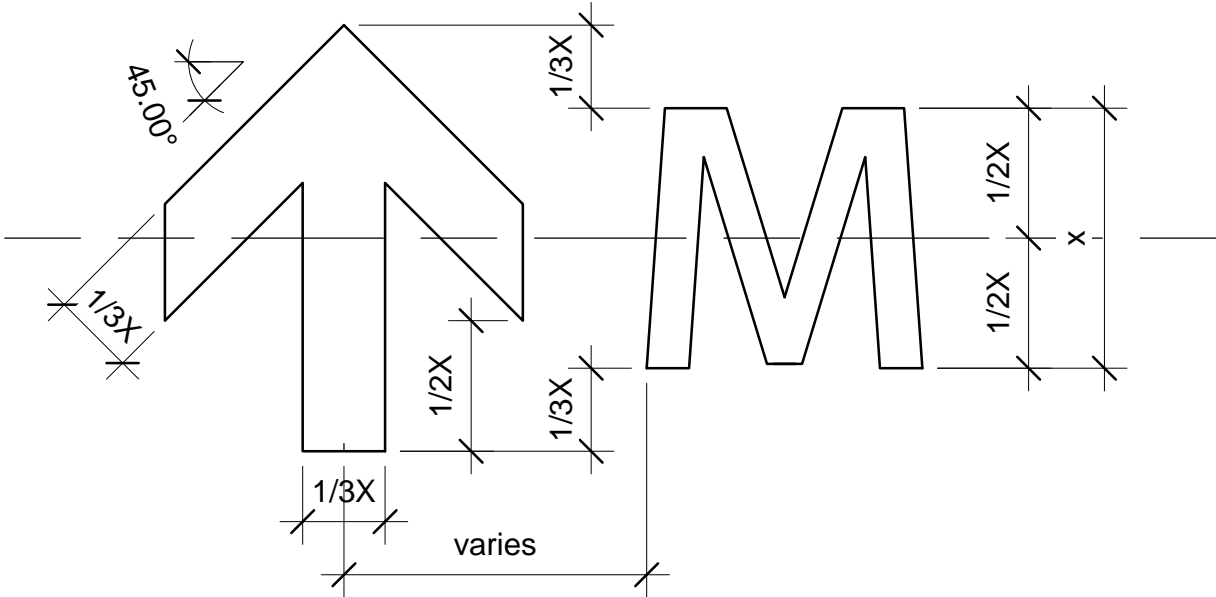

University of Victoria Logo, horizontal standard




University
of Victoria

full colour




University
of Victoria

opaque monochromatic



University
of Victoria

opaque monochromatic reversed

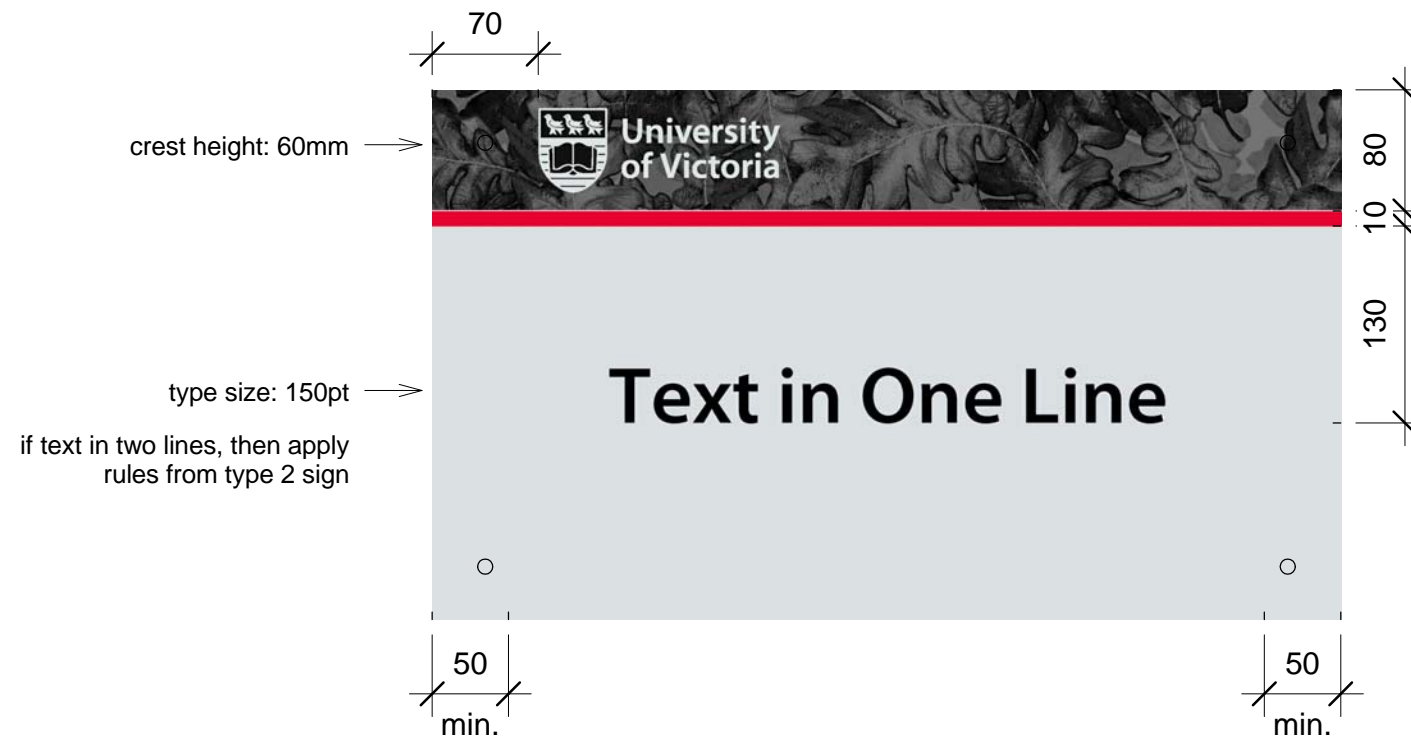

type 1 sign scale 1:5


Aluminum panel size:
600 mm x 350 mm x 6.4 mm

Description:
One sided sign.
Digitally printed vinyl protected with anti-graffiti, optically clear overlamine. Vinyl and overlamine to lap over the sign edges.

Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlamine: 3M 8914, Avery DOL 6060 or equivalent.


- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates as recommended by manufacturer

Refer to Adobe Photoshop files for detailed sample layout

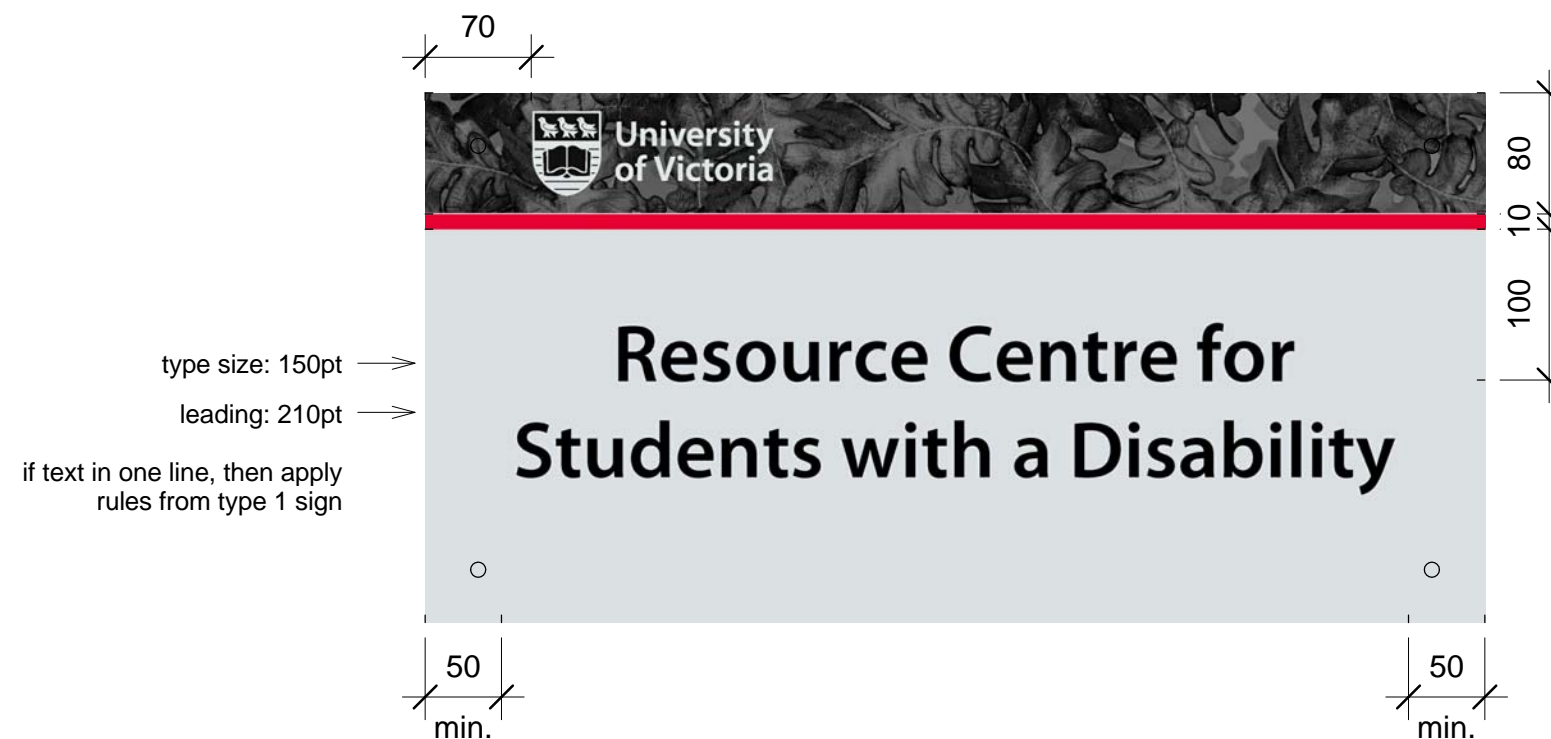


type 2 sign scale 1:5


Aluminum panel size:
700 mm x 350 mm x 6.4 mm

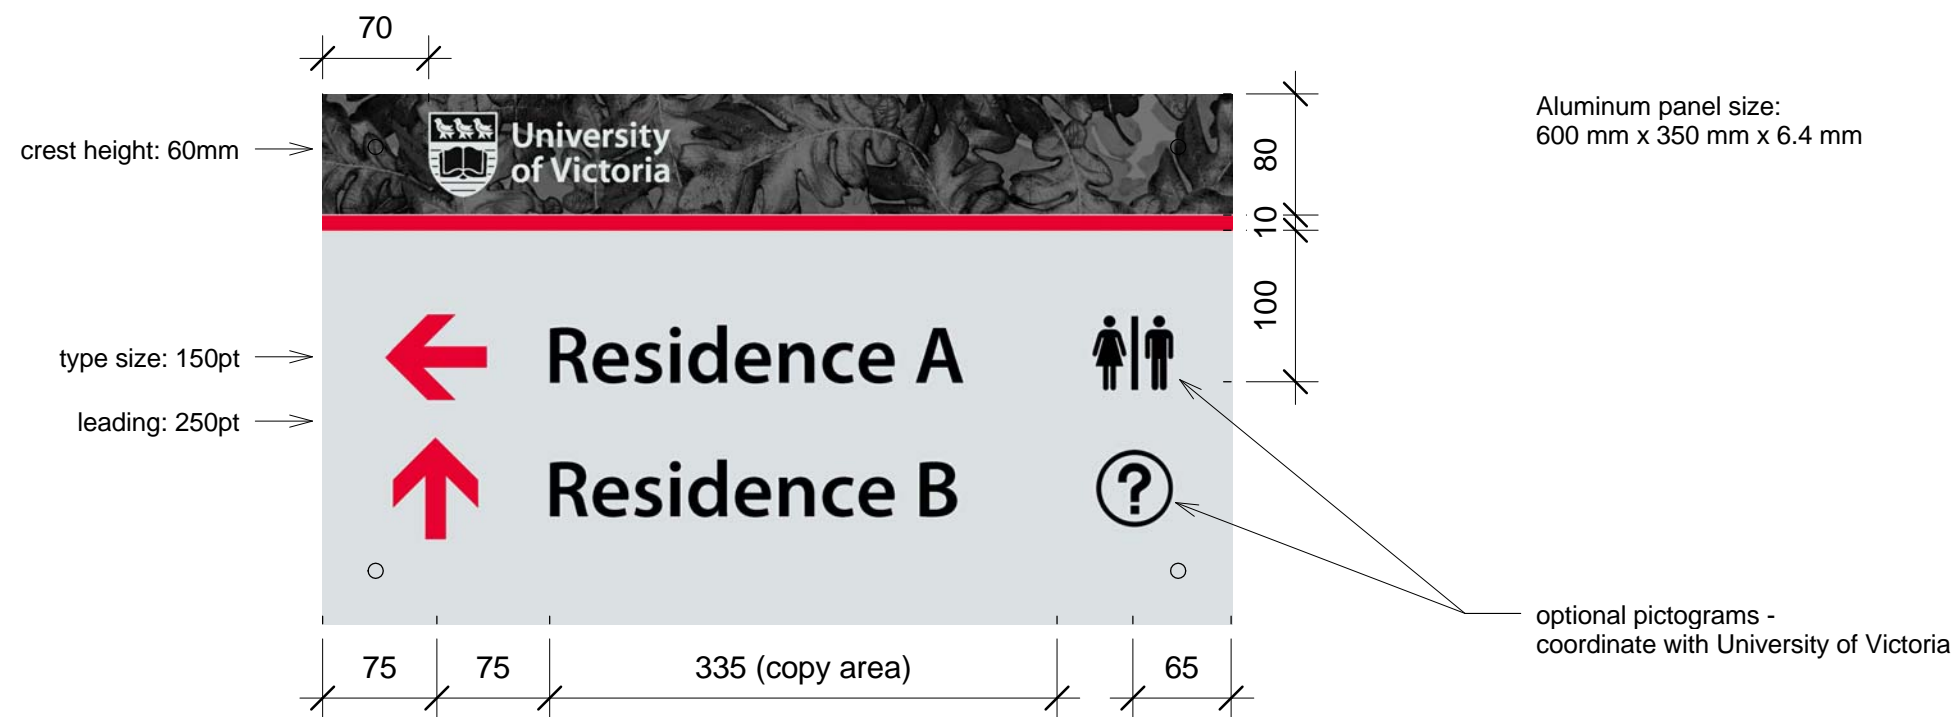


type 3 sign scale 1:5

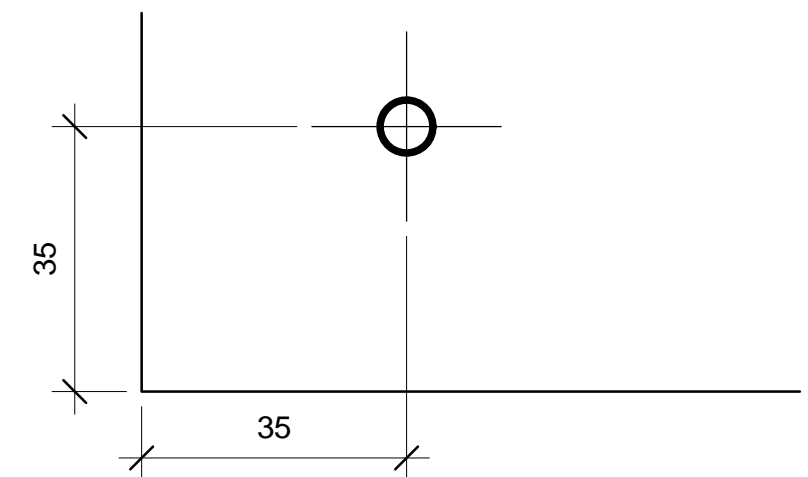

fastener typical location on sign
scale 1:1

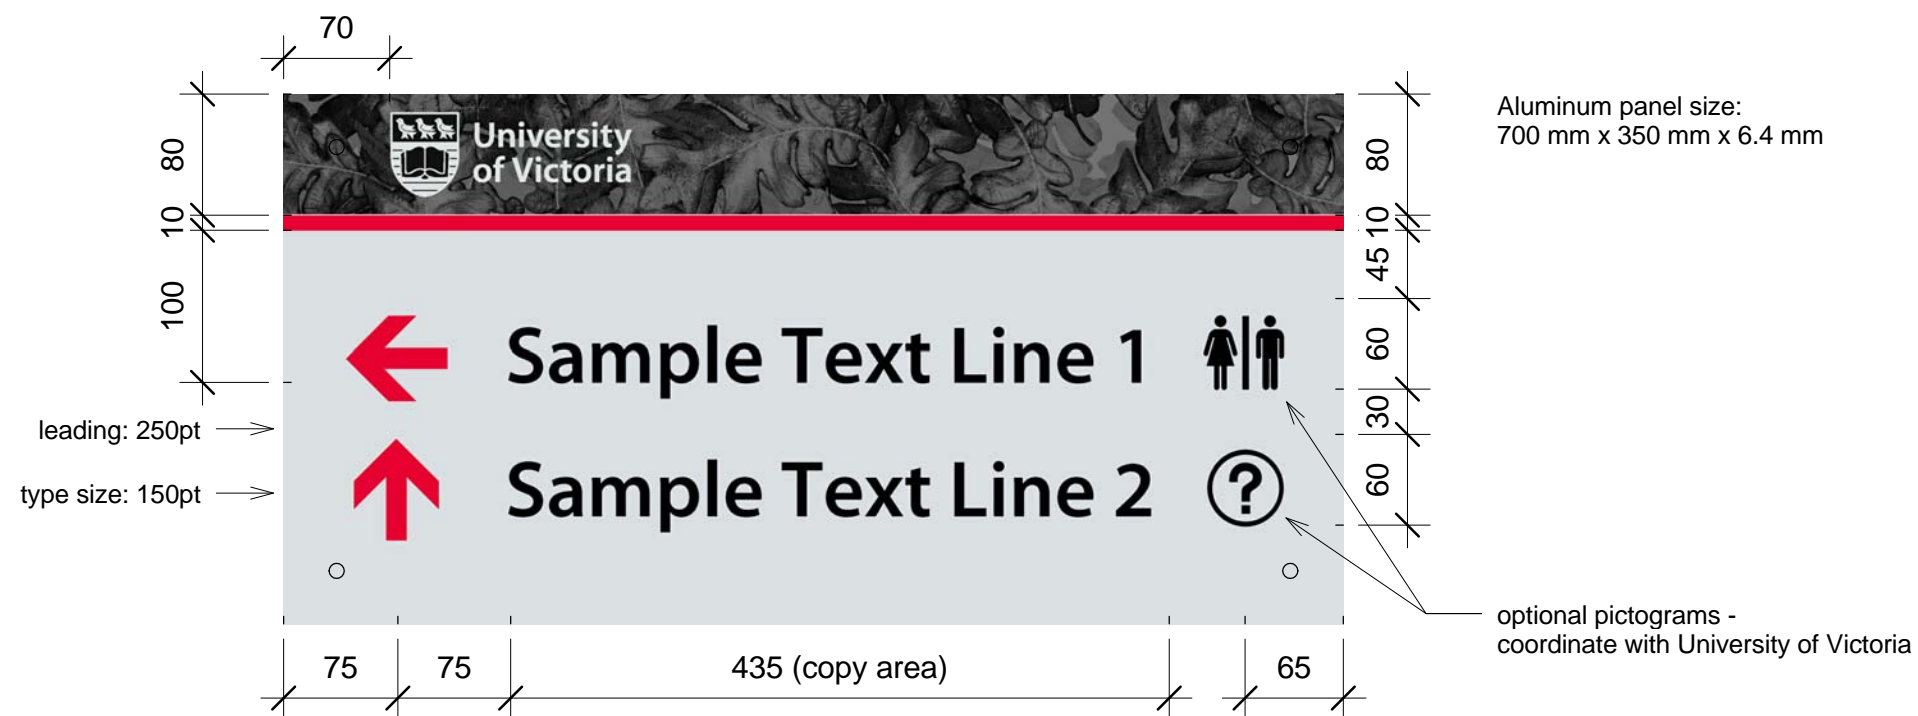

type 4 sign scale 1:5

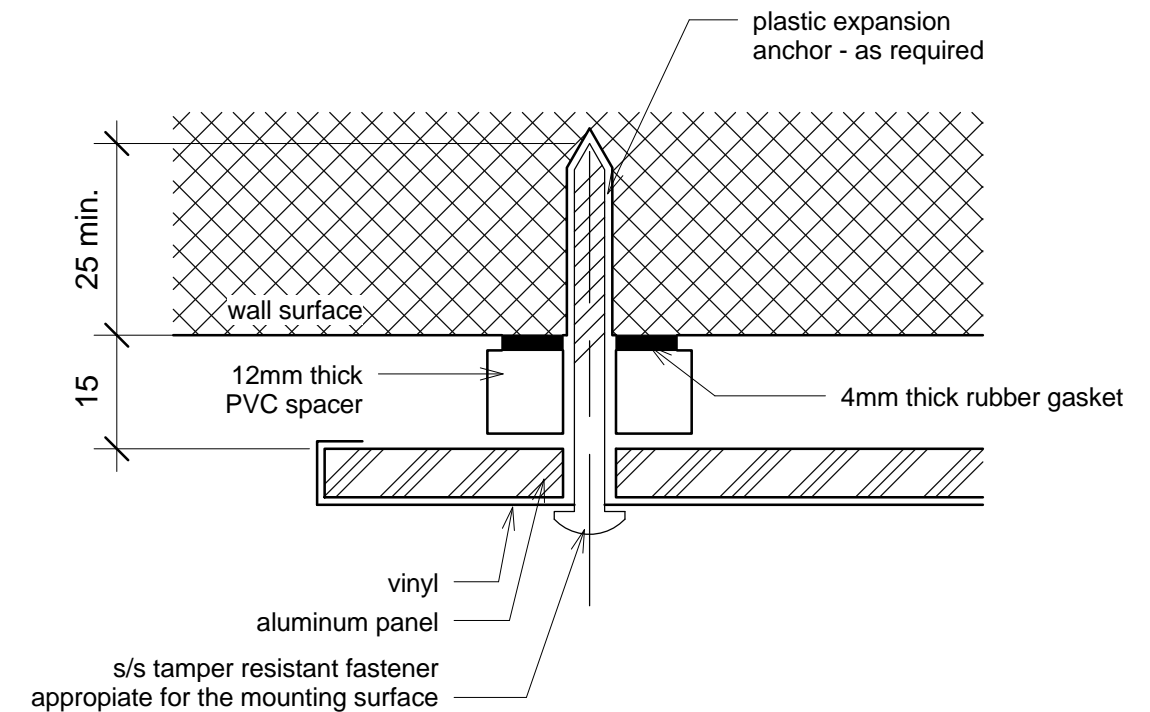

typical mounting detail
scale 1:1

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
panels:
security screws panel attachment: Fastenal part #160951 (10 x 2" button head tapping screw s/s 6 lobe)
- 3. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM


- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant “Torx-Pin” screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be “Pentagon” tamper resistant bolts, with “Pentagon” nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with “Pentagon” security nuts.



Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	sign design/graphic design details
03	sign and graphic design
04	sign construction

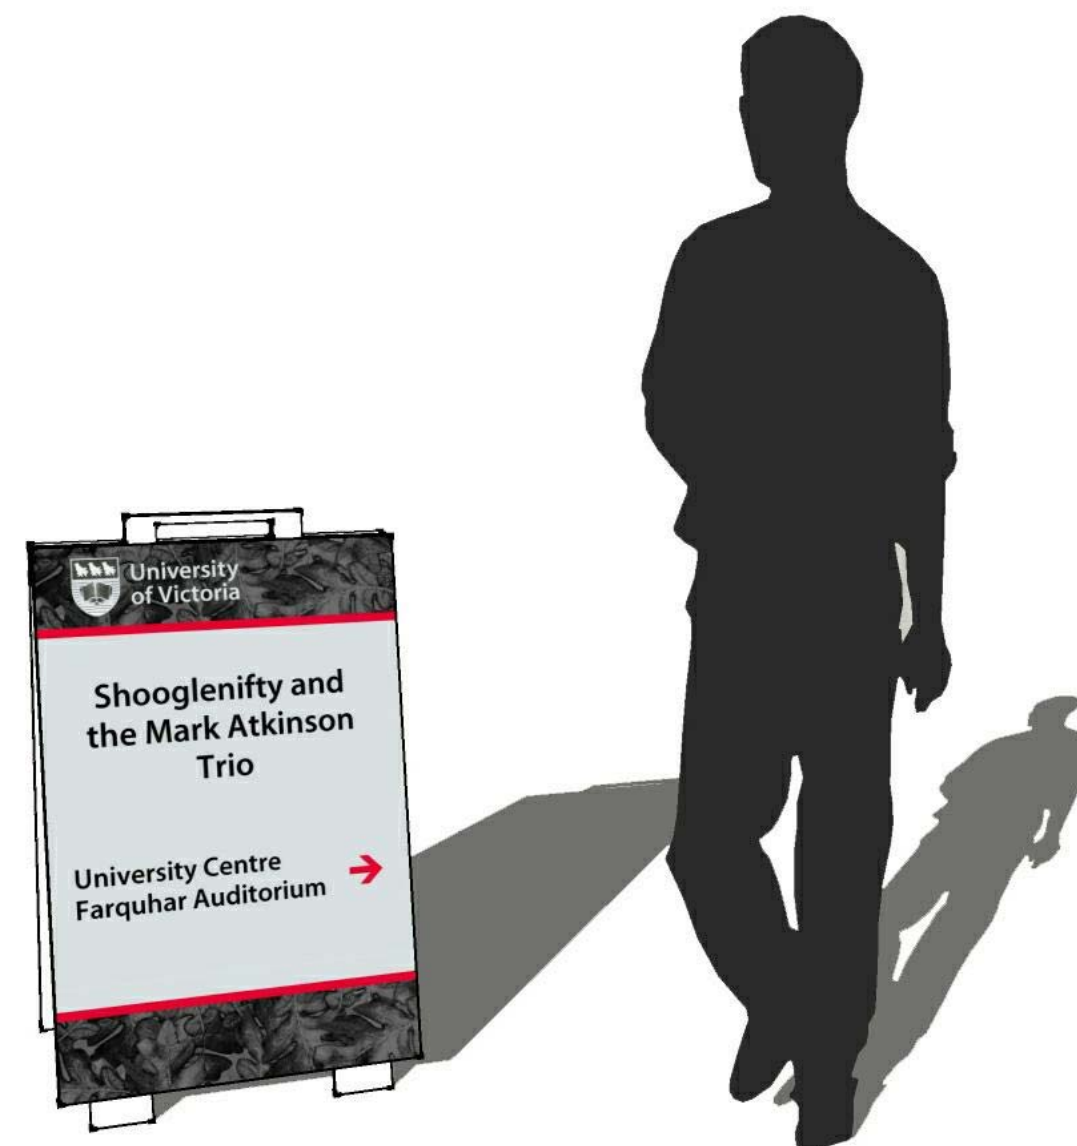


Sign No. 14 - Event Sign

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 14 - Event Sign
sheet name: title sheet and drawing list
scale: as noted

sheet number: 01


core colours



PANTONE 185 C
pinstrip, arrows



PANTONE 426 C
text



PANTEONE 7541 C
background, UVic Logo




gary oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family

Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

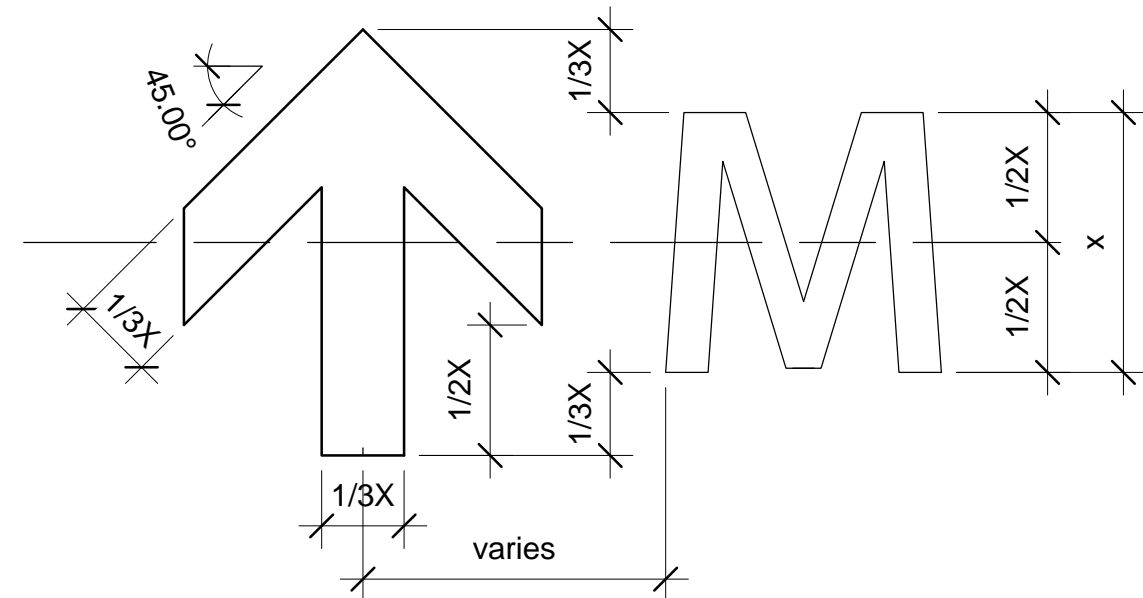

University of Victoria Logo, horizontal standard




University of Victoria



University of Victoria




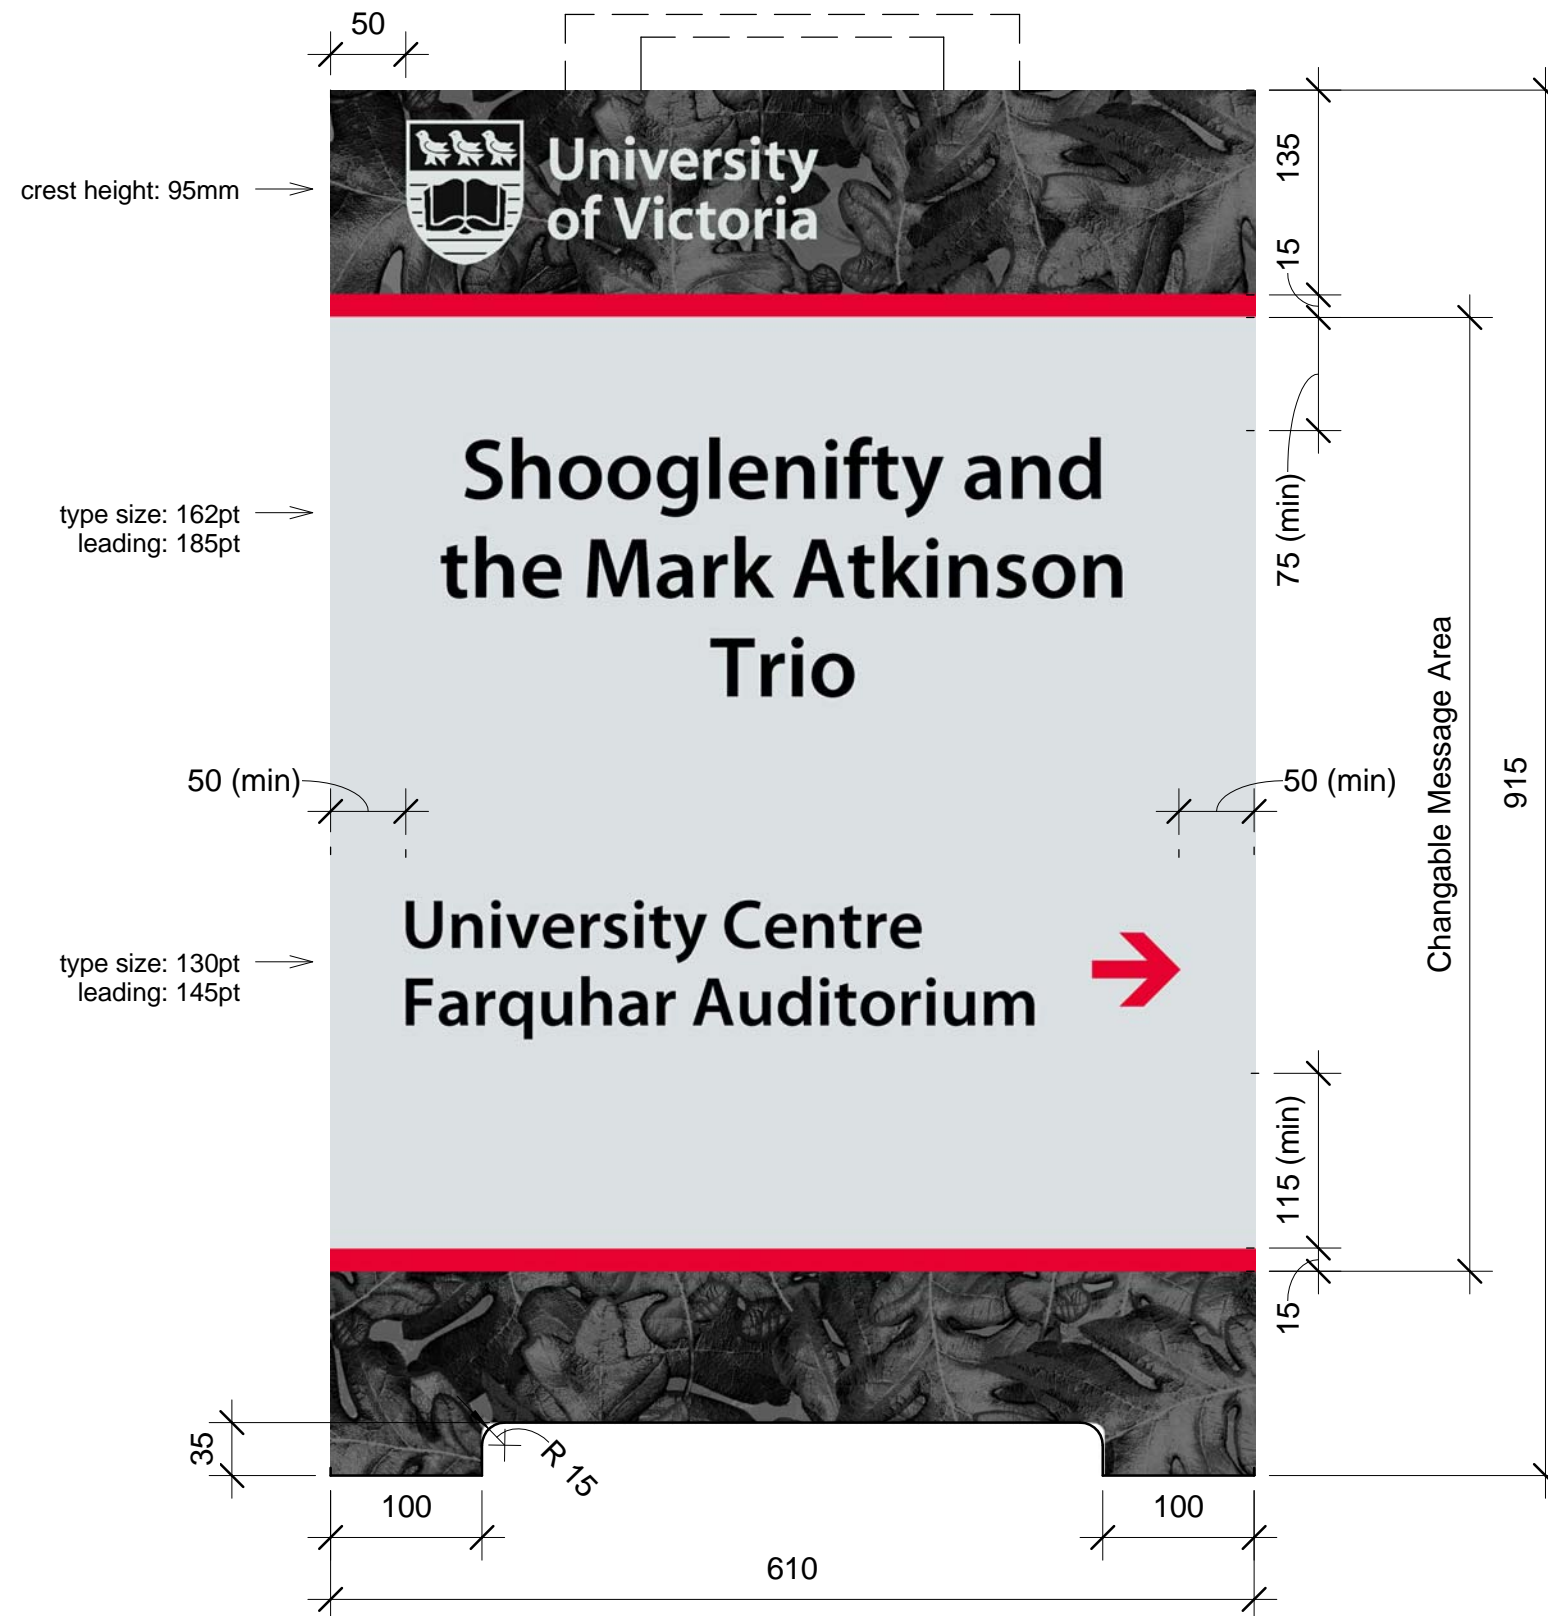


Description
 Digitally printed vinyl protected with anti-graffiti, optically clear overlaminate - vinyl and overlaminate to be applied on both sides of the panels.
 D/S Crezon plywood sandwich board 610 x 915 mm by Proveer
 3/16" thick clear Lexan protection panel

Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlaminate: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per manufacturer's recommendations.
 - 2) Use compatible UV inks and overlaminates as recommended by manufacturer
 - 3) Wrap vinyl and overlaminate over the edges of the aluminum panel.
 - 4) Message to be printed on changable graphic film by 3M or Avery or paper
- Refer to Adobe Photoshop files for detailed sample layout

scale 1:5

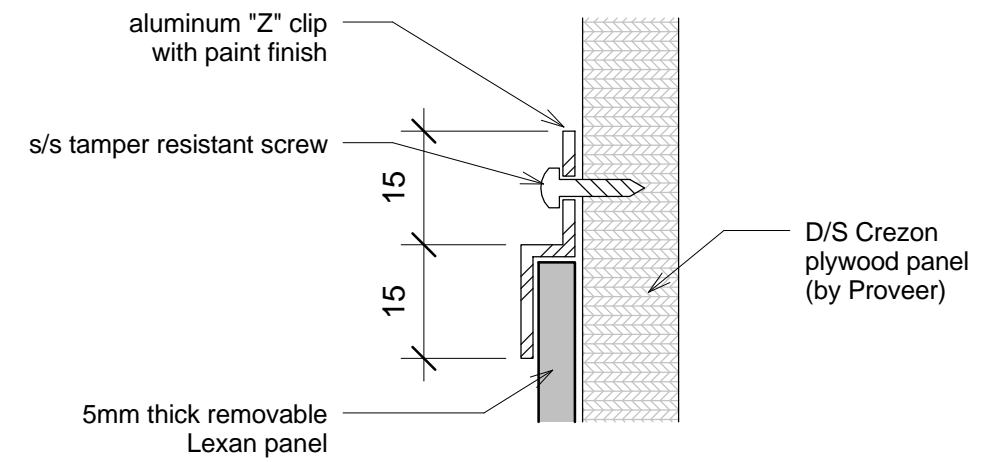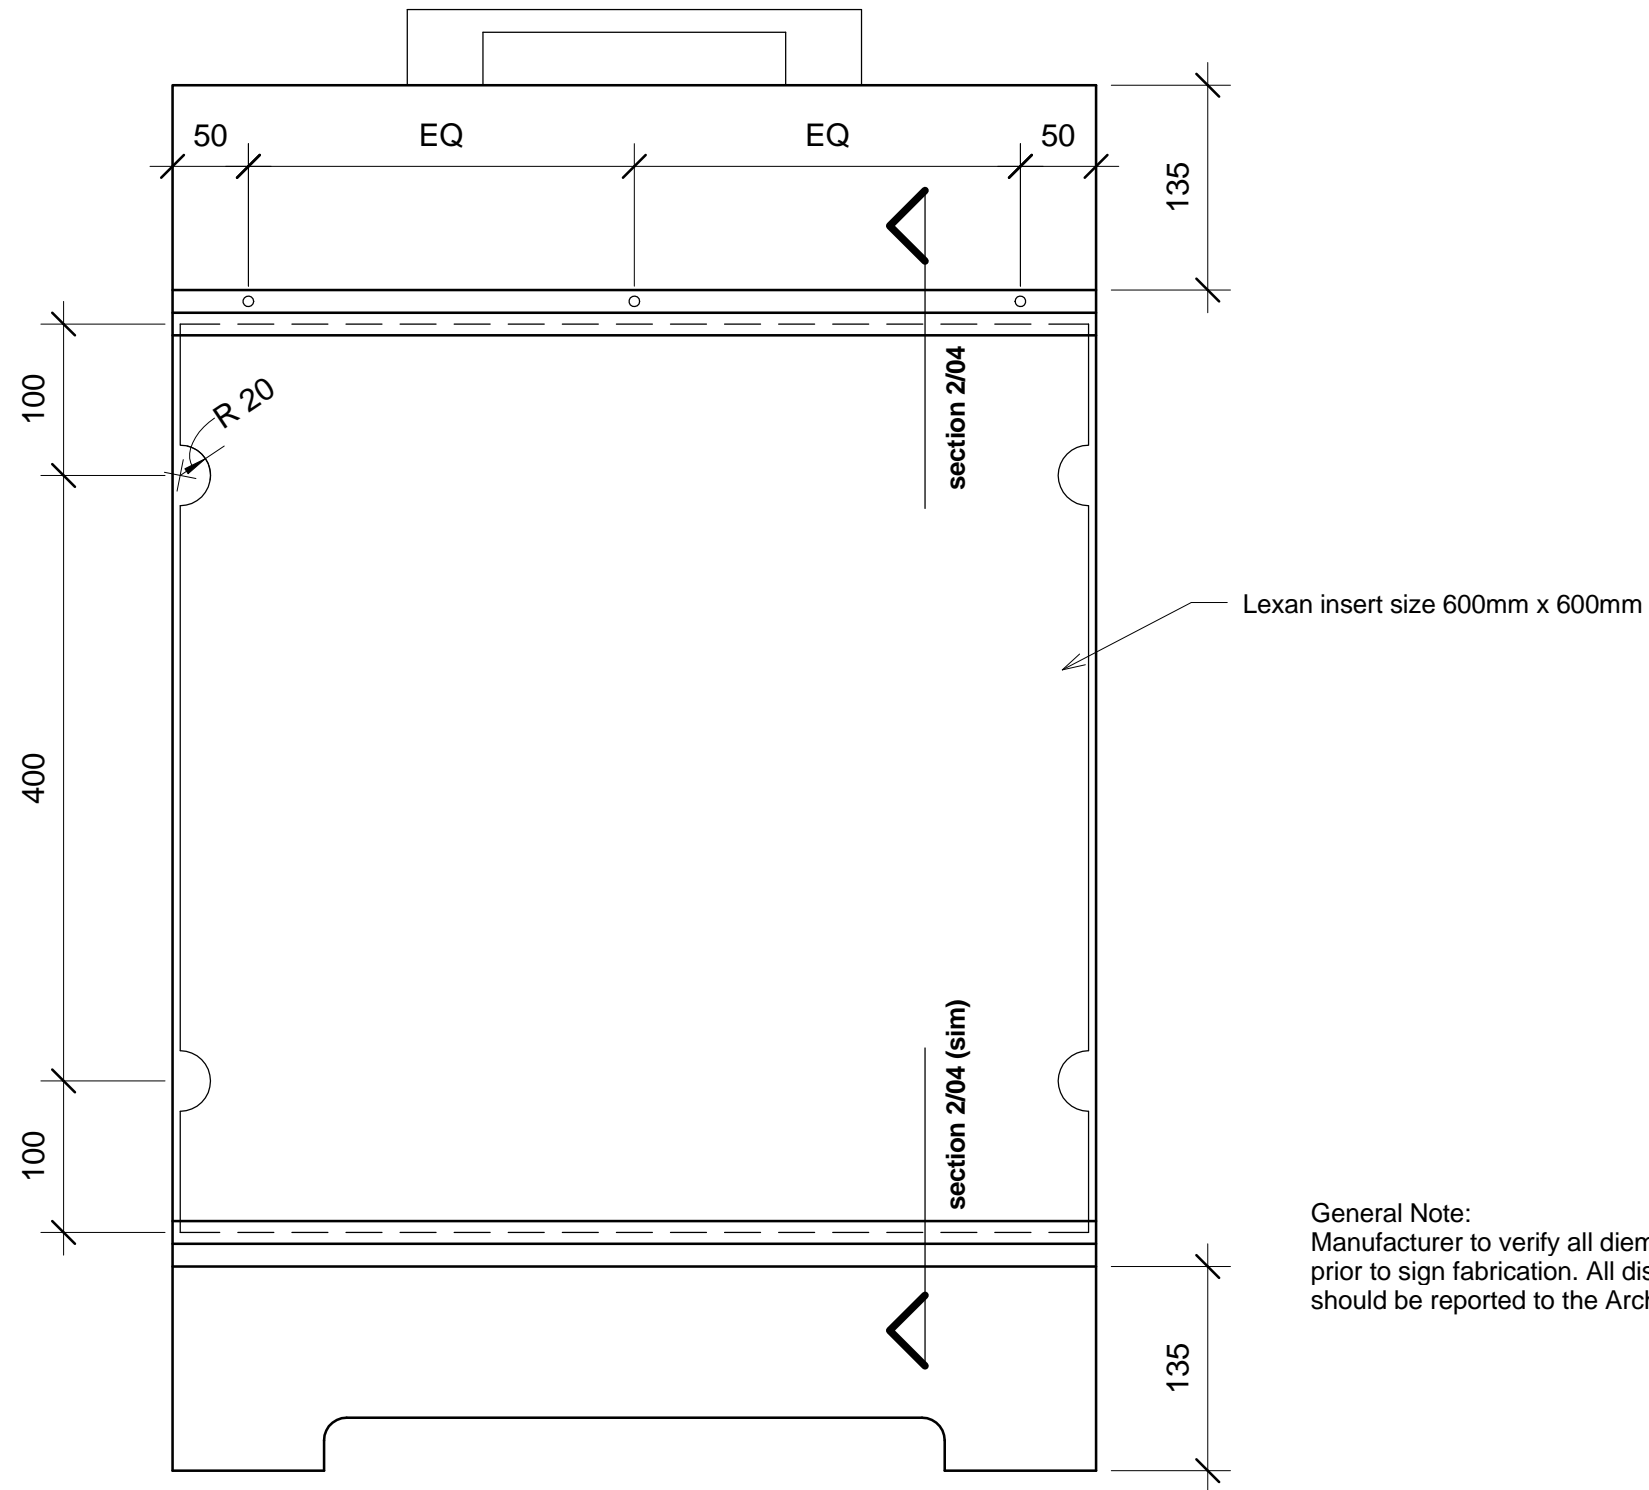

2 aluminum retainer detail
1 : 1

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

scale 1:5

1 Sign Construction
1 : 5

Sheet List	
Sheet Number	Sheet Name
01	title sheet and drawing list
02	typography, colours and pictograms
03	sign design/graphic design details
04	sign construction - sections and details
05	general notes




Sign No. 15 Minor Pedestrian Map

core colours




clear anodized coating
application: sign structure



PANTONE 185 C
application:
pinstrip, arrows



PANTONE 426 C
application: text,
crest - monochromatic



PANTONE 7541 C
application: background,
crest - reversed monochromatic




garry oak motif - digital file is to be delivered
by University of Victoria

samples of typeface family


Myriad Pro Semi Bold

ABCDEFGHIJKLMNOPQRSTUVWXYZ
abcdefghijklmnopqrstuvwxyz
1234567890

arrow style and arrow size in relation to text height

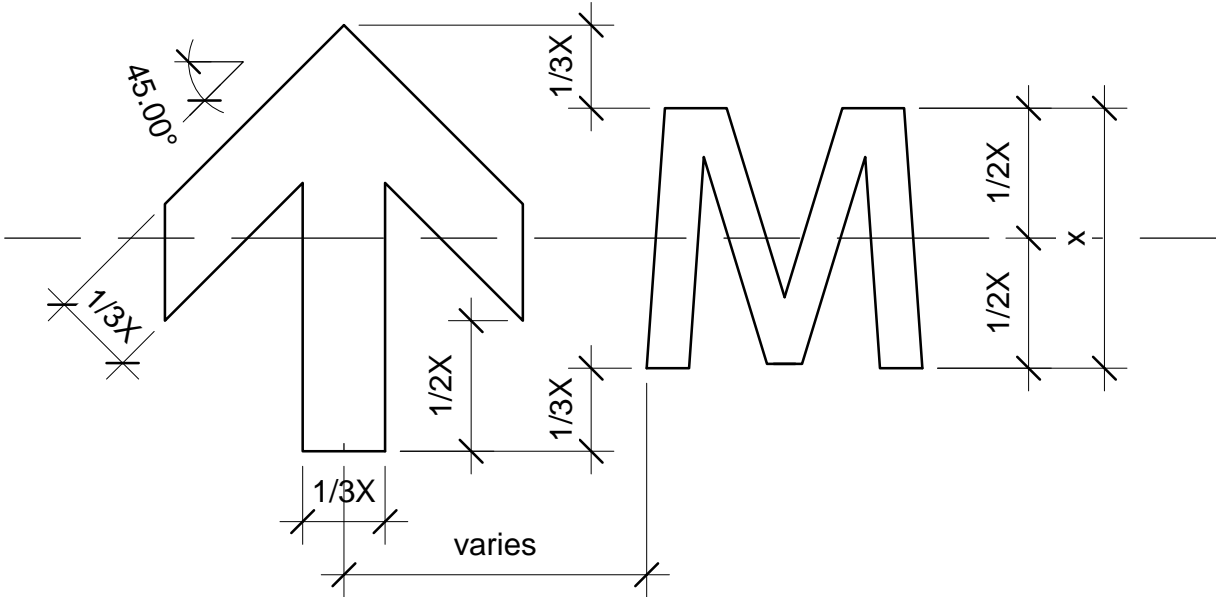

University of Victoria Logo, horizontal standard



University
of Victoria

full colour




University
of Victoria

opaque monochromatic




University
of Victoria


opaque monochromatic reversed

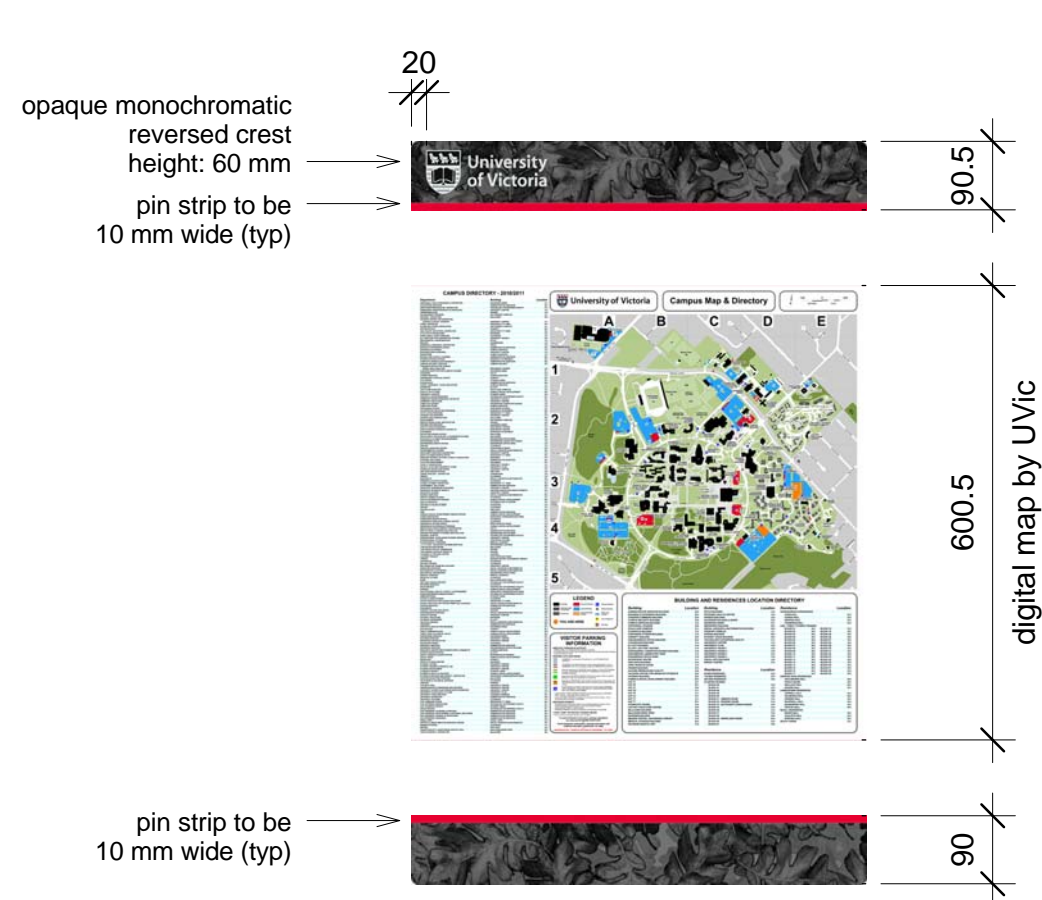

panel front view scale 1:10

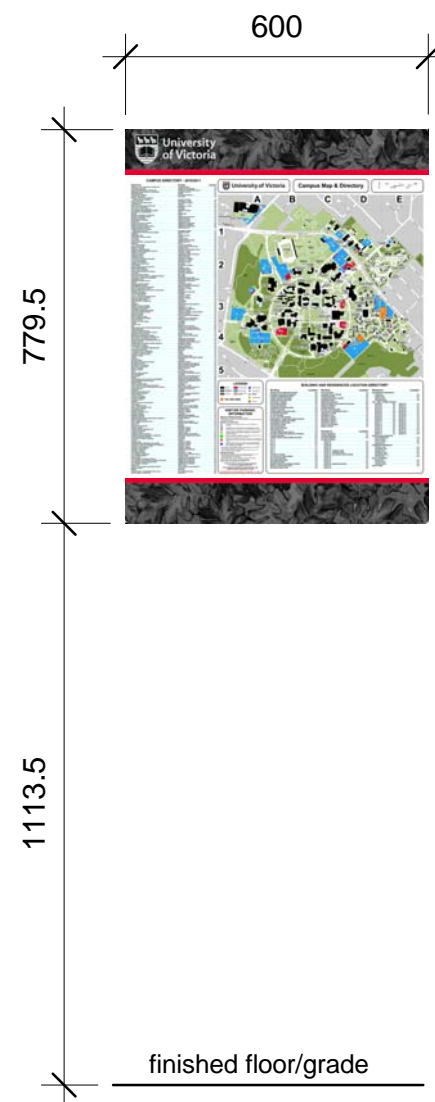

wall mounted option

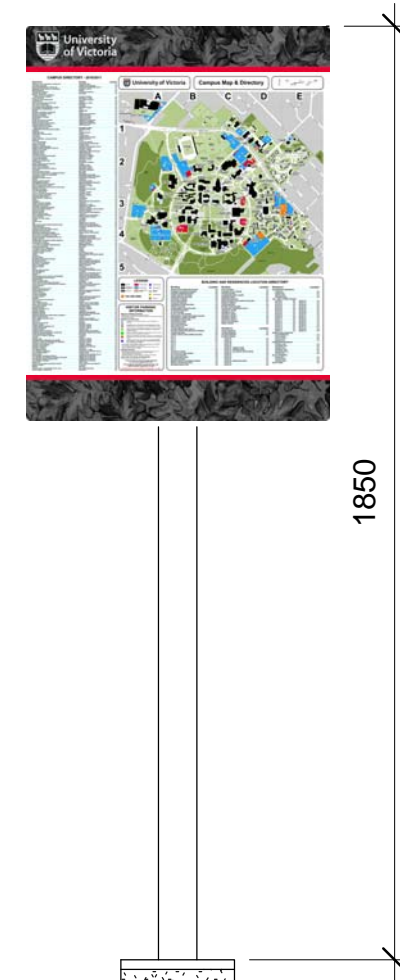

post mounted option

scale 1:15


Description

Digitally printed vinyl protected with
anti-graffiti, optically clear overlaminate
on front and back of panel.
Edges of the panel to be spray painted with
Mathews, two part Acrylic Polyurethane or equivalent
Aluminum panel size: 780 mm x 600 mm x 6.4 mm


Vinyl: 3M IJ180, MPI 2005 or equivalent
Overlaminate: 3M 8914, Avery DOL 6060 or equivalent.

- 1) One piece vinyl to be printed on, installed as per
manufacturer's recommendations.
- 2) Use compatible UV inks and overlaminates
as recommended by manufacturer
- 3) Edges of the aluminum panel to be spray painted
with PANTEONE 7541 C colour
- 4) Back of the panel to receive vinyl with printed
PANTEONE 7541 C colour
- 4) Digital file with Directory Map is to be delivered
by University of Victoria


Refer to Adobe Photoshop files for detailed sample layout

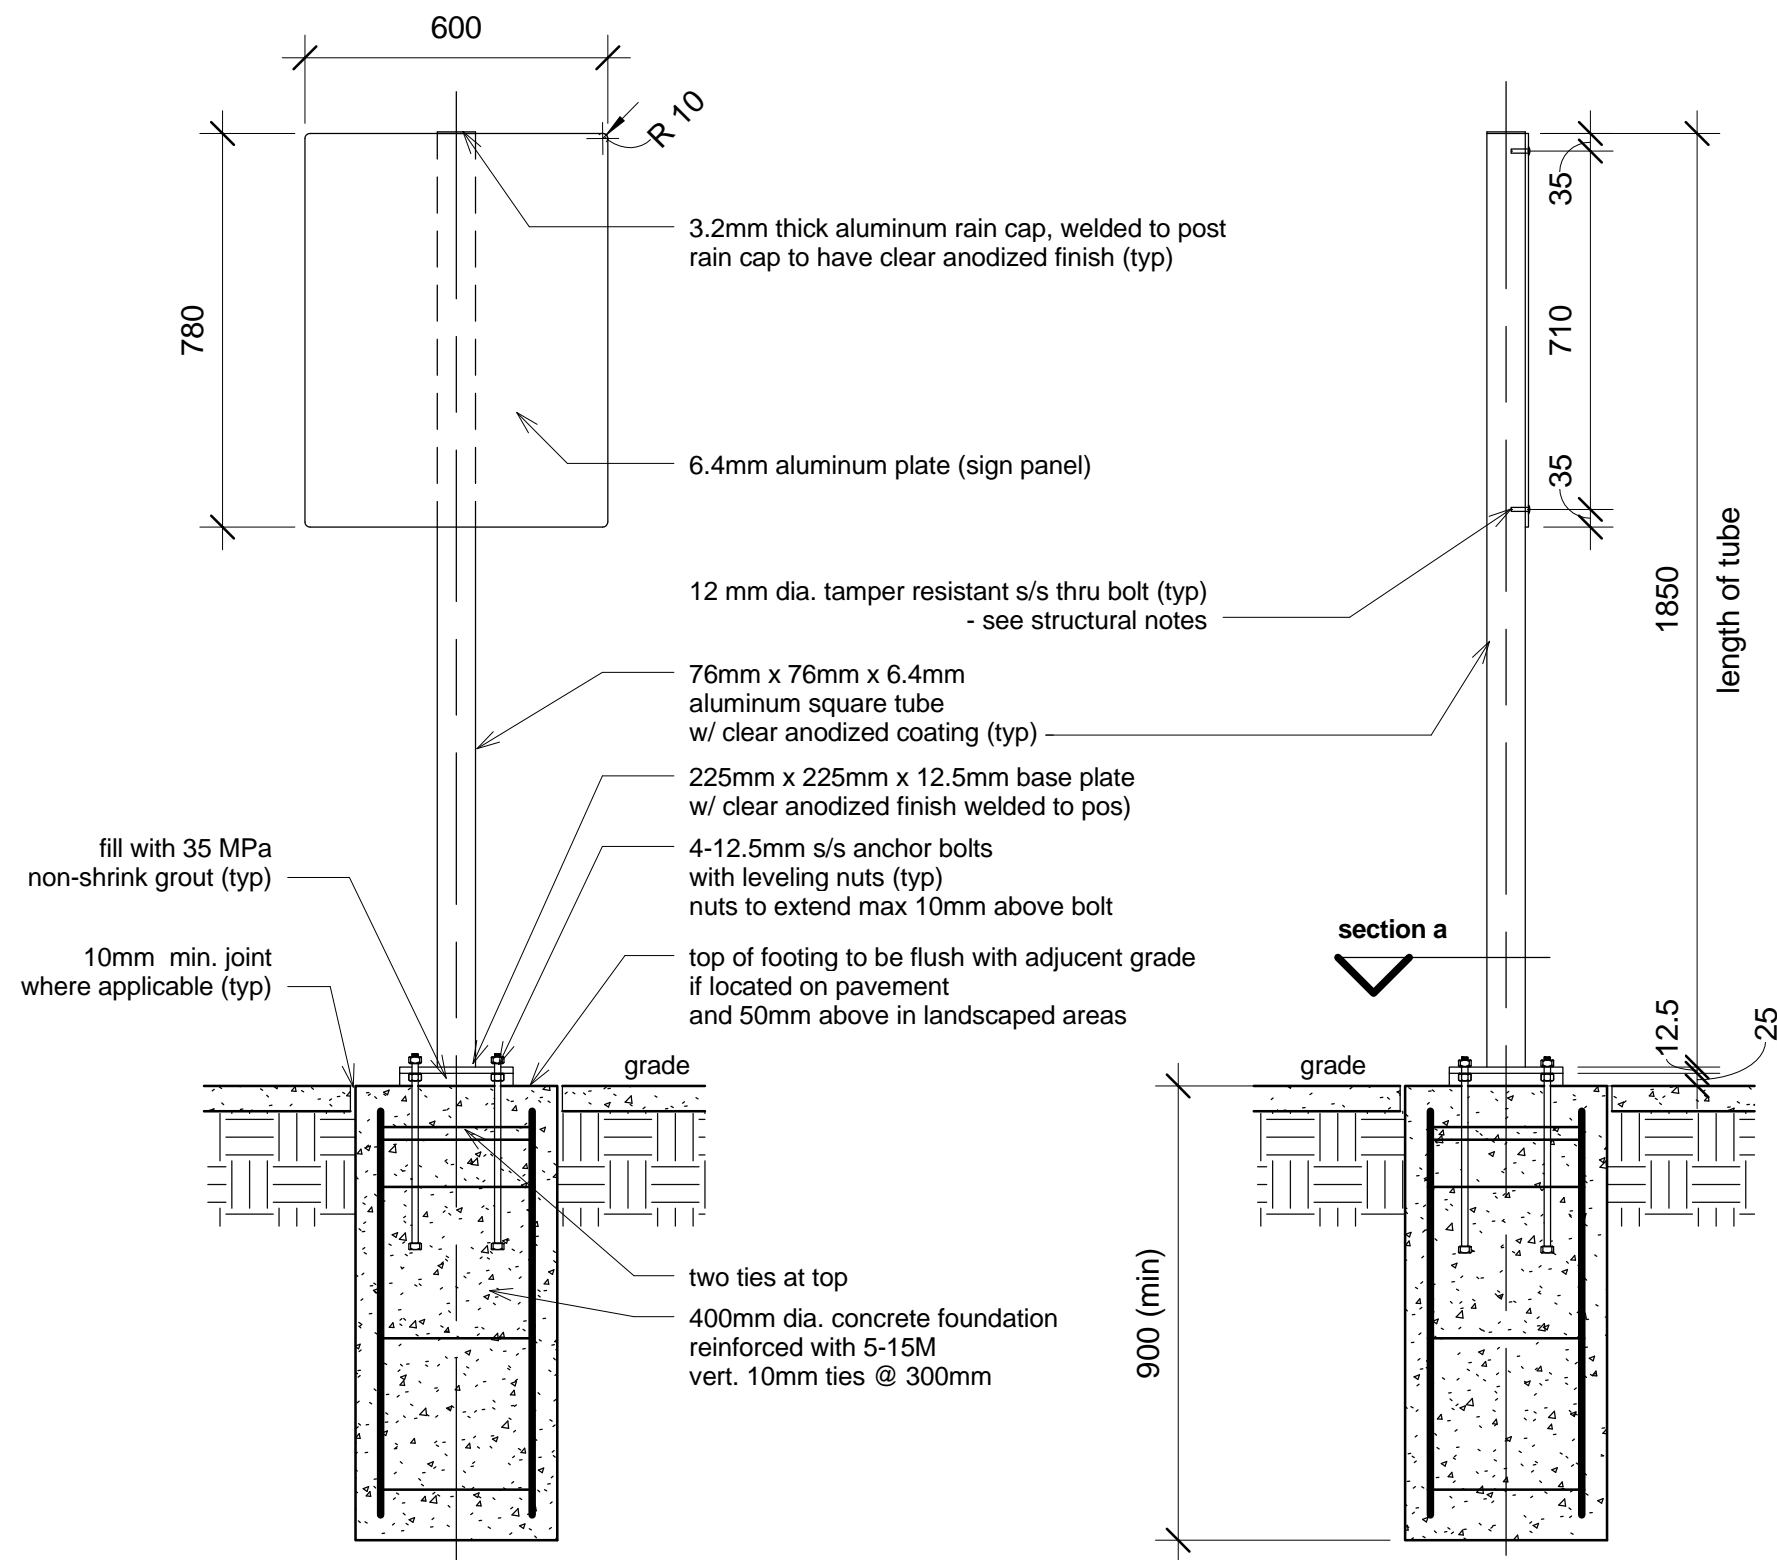

front view/section scale 1:15

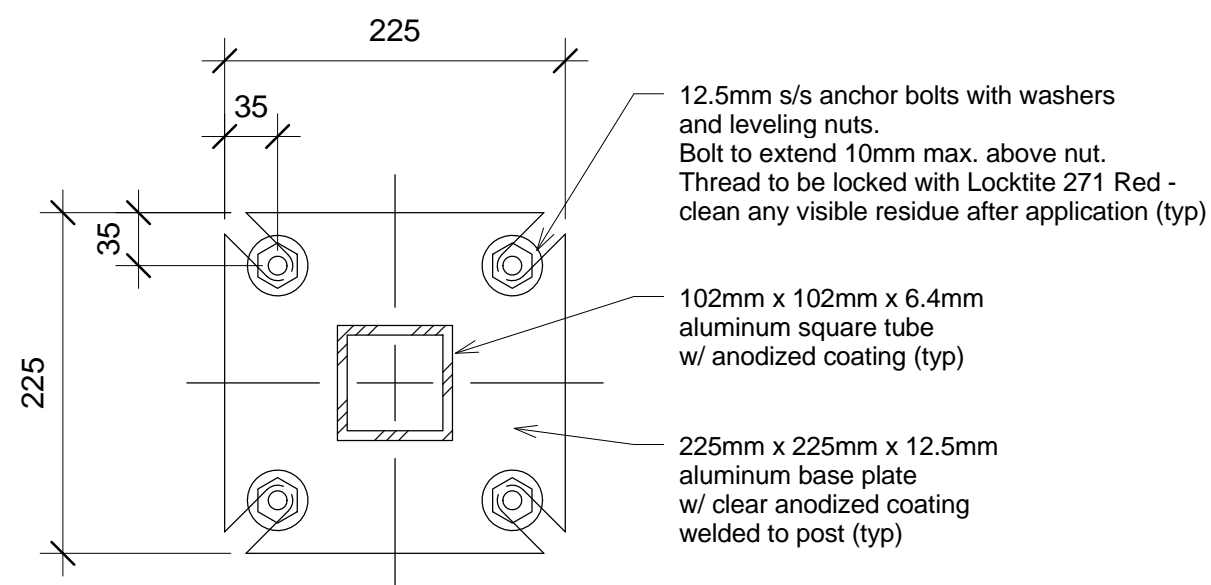

section a (slip base) scale 1:5

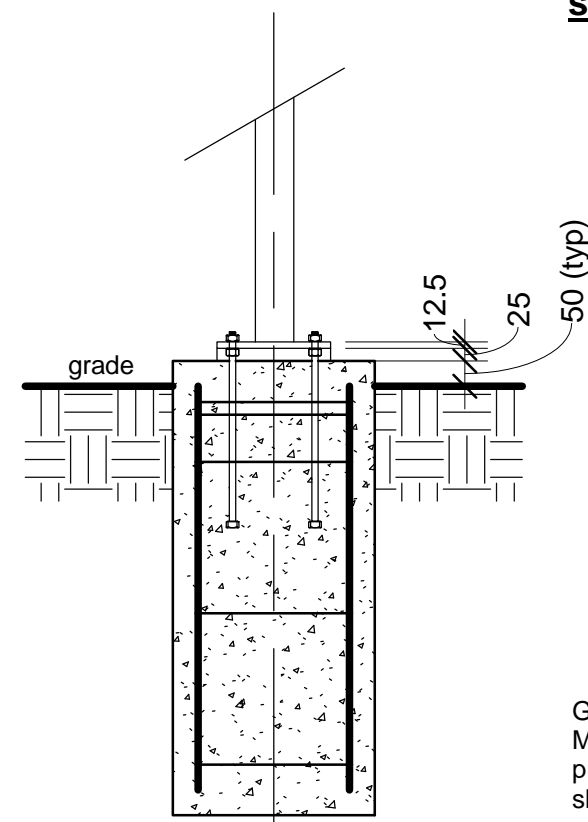

**side view/section scale 1:15
(sign located in landscaped areas)**

General Note:
Manufacturer to verify all dimensions prior to sign fabrication. All discrepancies should be reported to the Architect.

project: Campus Wayfinding
number: FM 09-8567
issue date: Jan 31, 2012

sign: Sign No. 15 - Minor Pedestrian Map
sheet name: sign construction - sections and details
scale: as noted

sheet number:

04



University of Victoria

GENERAL NOTES

- 1. Provide self adhesive sign ID stickers. ID's should correspond with ID's shown on location plan
- Form and placement of stickers on signs is to be coordinated with University of Victoria
- 2. Fasteners:
 - foundation (anchor bolts):
 - bolts: Fastenal part #47406 (1/2" s/s threaded rod)
 - washers: Fastenal part #71021 (1/2" s/s washers)
 - nuts: Fastenal part #70714 (1/2" s/s nuts)
 - posts:
 - thru bolts: Fastenal part #10630-04183 (1/2" s/s x 4" button Socket Cap Screw)
 - thru bolt washers: Fastenal part #71021 (1/2" s/s washers)
 - thru bolt nuts: 70714 (1/2" s/s nuts)
- 3. Threadlocker: Loctite 271 Red
- 4. Whenever anchor bolts are cut, contractor to ensure cut surfaces (terminated coating) are protected against rusting.
- 5. Manufacturer to verify all diemnsions prior to sign fabrication. All discrepancies should be reported to the Architect.

STRUCTURAL NOTES

DRAWINGS

- 1. These drawings show the completed project. The drawings do not show components that may be necessary for construction safety, which is the responsibility of the contractor.
- 2. The use of these drawings is limited to that indicated in the revisions column.
- 3. The information on these drawings shall not be used for any other project or works.

DESIGN

- 1. The structures shown have been designed in substantial accordance with the British Columbia Building Code 2006, which is based on the National Building Code of Canada 2005.
- 2. The following wind loads and factors were used: q50=0.63kPa, lw=1.0-ULS, 0.75-SLS.

FIELD REVIEW BY STRUCTURAL ENGINEER

- 1. Structural Engineer provides field review only for the work shown on these structural drawings, and it is conducted with such frequency as Structural Engineer deems appropriate to ascertain that the work is in general conformance with the documents prepared by Structural Engineer.
Field review by Structural Engineer is not carried out for the Contractor's benefit, nor does it make Structural Engineer guarantors of the Contractor's work. It remains the Contractor's responsibility to build the work in conformance with the contract documents. Structural Engineer shall not be responsible for the acts or omissions of the Contractor, Sub-Contractor, or any other persons performing any of the work or for the failure of any of them to carry out the work in accordance with the contract documents.
- 2. Provide 24 hours advance notice of each required field review. Field reviews shall be scheduled to be carried out during normal business hours unless special arrangements are made with the Structural Engineer.
- 3. The work to be reviewed shall be generally complete.

STRUCTURAL NOTES (cont)

CONCRETE AND REINFORCING STEEL

- 1. Concrete work shall conform to CAN/CSA-A23.1, CAN/CSA -A23.2, CAN/CSA -A23.3 and referenced documents.
- 2. Reinforcing shall conform to CAN/CSA-G30.18R – Grade 400MPa.
- 3. Cover to reinforcing steel to be 50mm uno.
- 4. Portland cement shall be type gu unless noted otherwise.
- 5. Concrete shall have a unit weight of 23±1 kn/m3/ (145±5 pcf) unless noted otherwise.
- 6. Concrete shall have a compressive strength of 35MPa at 28 days, and conform to exposure class C-1 with a maximum water-cement ratio of 0.40 and air content of 5-8%. Maximum aggregate size to be 19mm.
- 7. No calcium chloride is permitted, in any form, in any concrete mix. Curing and protection of concrete for hot, cold or dry weather is to be as per clauses 7.4.1.8 and 7.4.2 of CAN/CSA.

STRUCTURAL ALUMINUM

- 1. Aluminum sections shall be new.
- 2. Aluminum alloys shall conform to the Aluminum Association publication Aluminum Standards and Data ISO 6361-2 or ISO 6362-2.
- 3. Extruded shapes, Tubes, Bolts, and Plate to be 6061 alloy uno.
- 4. Aluminum in contact with concrete or grout shall be given a heavy coat of alkali-resistant bituminous paint or other equivalent coating before installation.
- 5. Welding operators and procedures shall be qualified according to CSA W47.2.
- 6. Submit shop drawings for review prior to start of steel fabrication.
- 7. Fabrication practices and tolerances shall be in accordance with CAN/CSA-S16, except bolt holed edge distance tolerance to be -0, +2mm.
- 8. Anchor and connection bolts to be ASTM A193 Stainless Steel. Anchors shall be embedded 300mm into concrete, complete with a nut and washer each end.
- 9. Unless noted otherwise, column base plates shall be 20 mm minimum thick. Anchor bolt holes shall be punched undersize and reamed to size.
- 10. Provide 6 mm cap plates for all tube members uno.
- 11. Aluminum shall be connected with fillet welds all-around uno. Weld size shall match the wall thickness of the thinnest part being connected uno. Welds to be ground smooth.

TAMPER RESISTANCE AND CONNECTIONS

- 1. Connection hardware to be stainless steel uno.
- 2. Aluminum panels to be connected to structure with 6.4mm diameter stainless steel self-tapping screws at 450mm maximum centre to centre spacing.
- 3. Non-removable panels may be welded or glued by the manufacturer, as approved by Structural Engineer.
- 4. Panel connection screws to be tamper resistant "Torx-Pin" screws as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer.
- 5. Visible connection bolts shall be "Pentagon" tamper resistant bolts, with "Pentagon" nuts as supplied by O.E.M. Hardware of Surrey BC, or equivalent as approved by Structural Engineer. Anchor bolts to be secured with "Pentagon" security nuts.

